


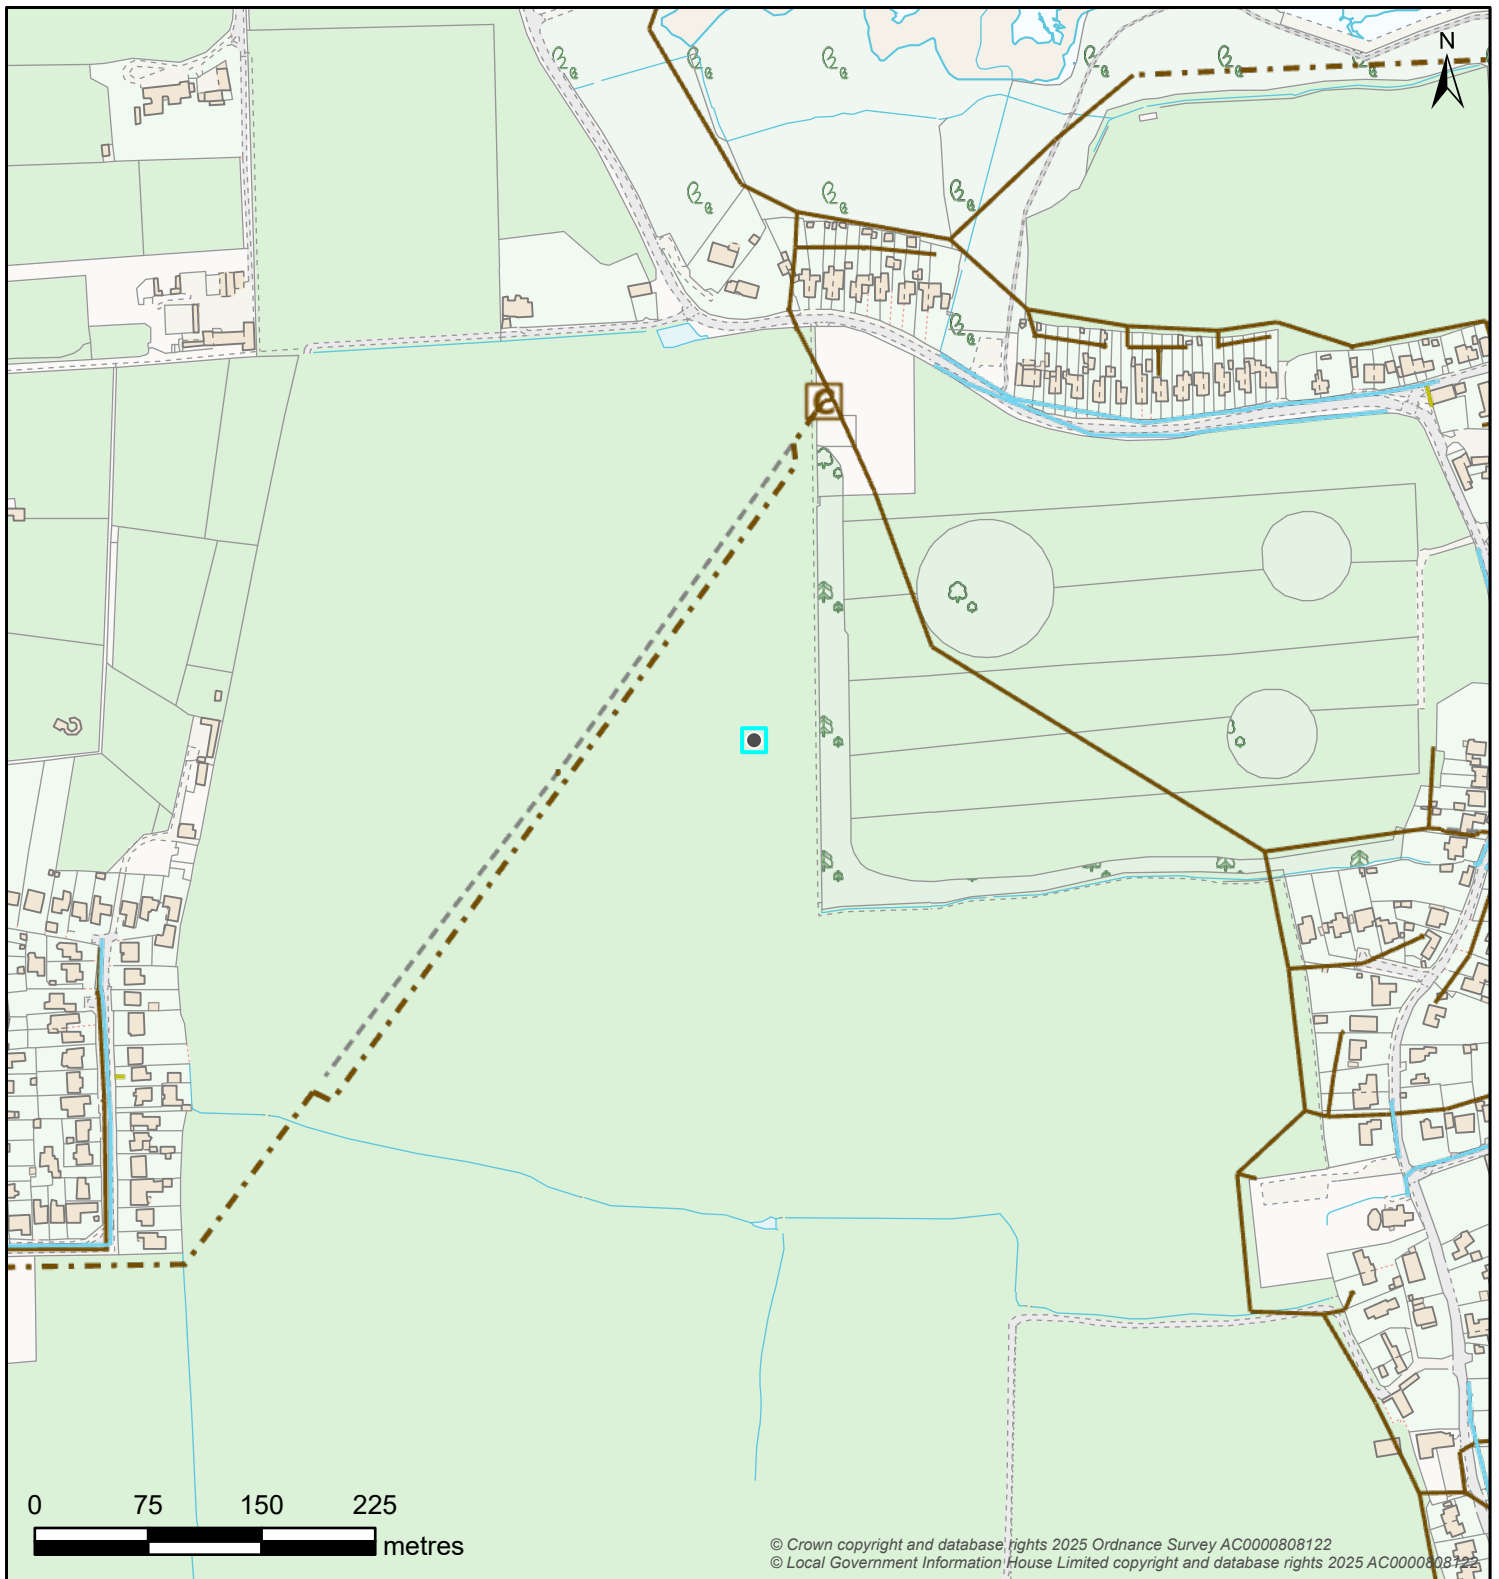

Boundary Box	Break Pressure Tank	Capped End	Hydrant			
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	WOH Washout Hydrant	
Pressure Monitoring	Service Reservoir		Meter	Valve - Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve	Stop Tap
Site			Valve - Flow			
Abstraction Point	Supply Works	AV Air Valve	NRV Non-Return Valve	WO Washout Empty Valve		
Booster Station	Transfer Station	Valve - Pressure		Pipe Bridge		
Surface Reservoir	Underground Source	PRV Pressure Reducing Valve	PSV Pressure Sustaining Valve	Pipe Bridge		
Water Pipe			Water Area			
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area		
Distribution	Raw	Discolouration				
Non-Potable	Private					

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 25/02/2025

Map Scale: 5000

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

