


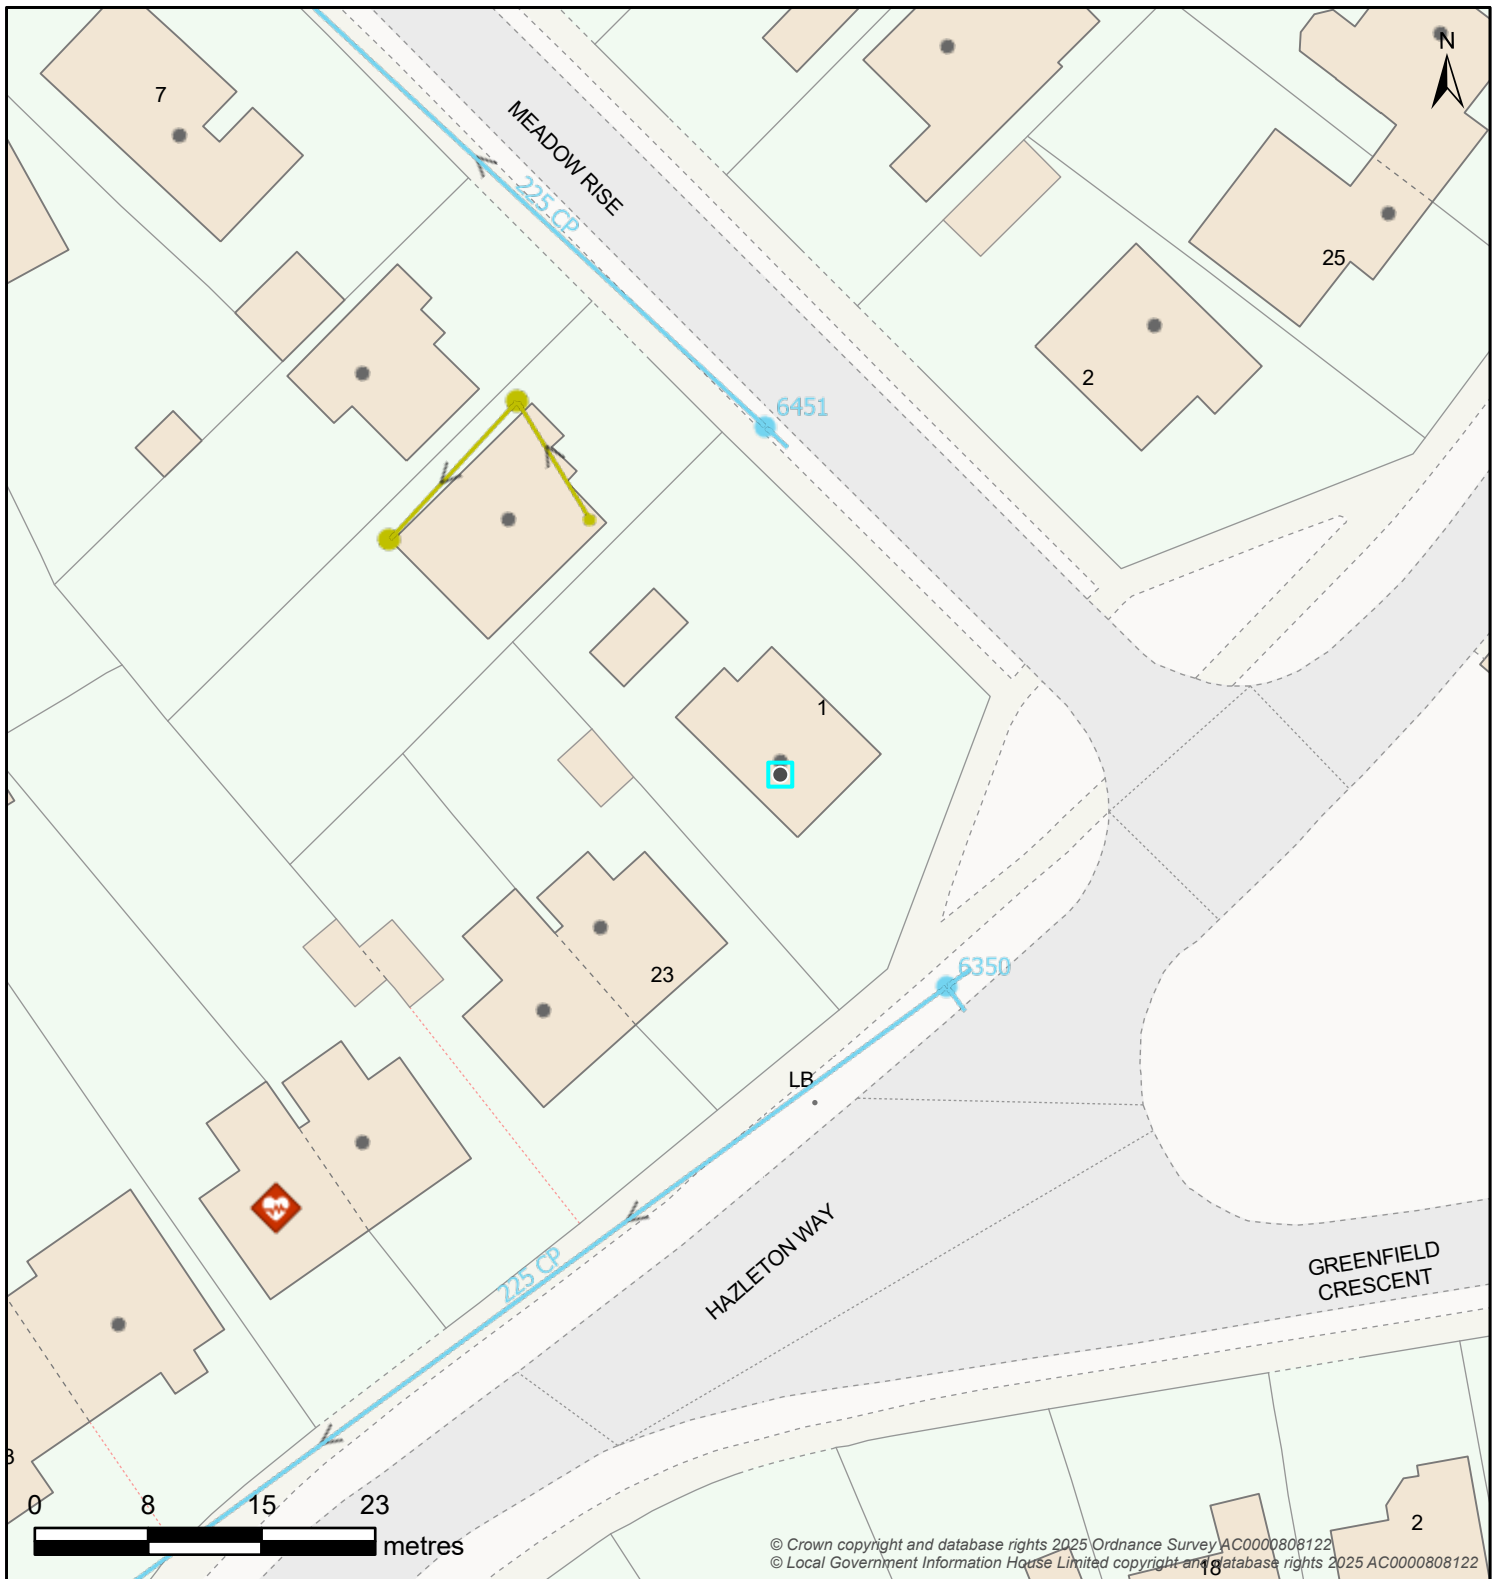

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
Boundary Box		BPT Break Pressure Tank		Capped End		Emptying Plug Fire Hydrant WOH Washout Hydrant		
Pressure Monitoring		Service Reservoir		Meter		Valve - Controllable		
Logger		Covered Tower		Meter		Open Valve Closed Valve Stop Tap		
Site				Valve - Flow				
Abstraction Point		Supply Works		AV Air Valve NRV Non-Return Valve WO Washout Empty Valve				
Booster Station		Transfer Station		Valve - Pressure			Pipe Bridge	
Surface Reservoir		Underground Source		PRV Pressure Reducing Valve PSV Pressure Sustaining Valve		Pipe Bridge		
Water Pipe				Water Area				
Communication		Trunk		Decommissioned		Water Supply Zone District Meter Area		
Distribution		Raw Discolouration						
Non-Potable		Private						

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 17/03/2025

Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

