


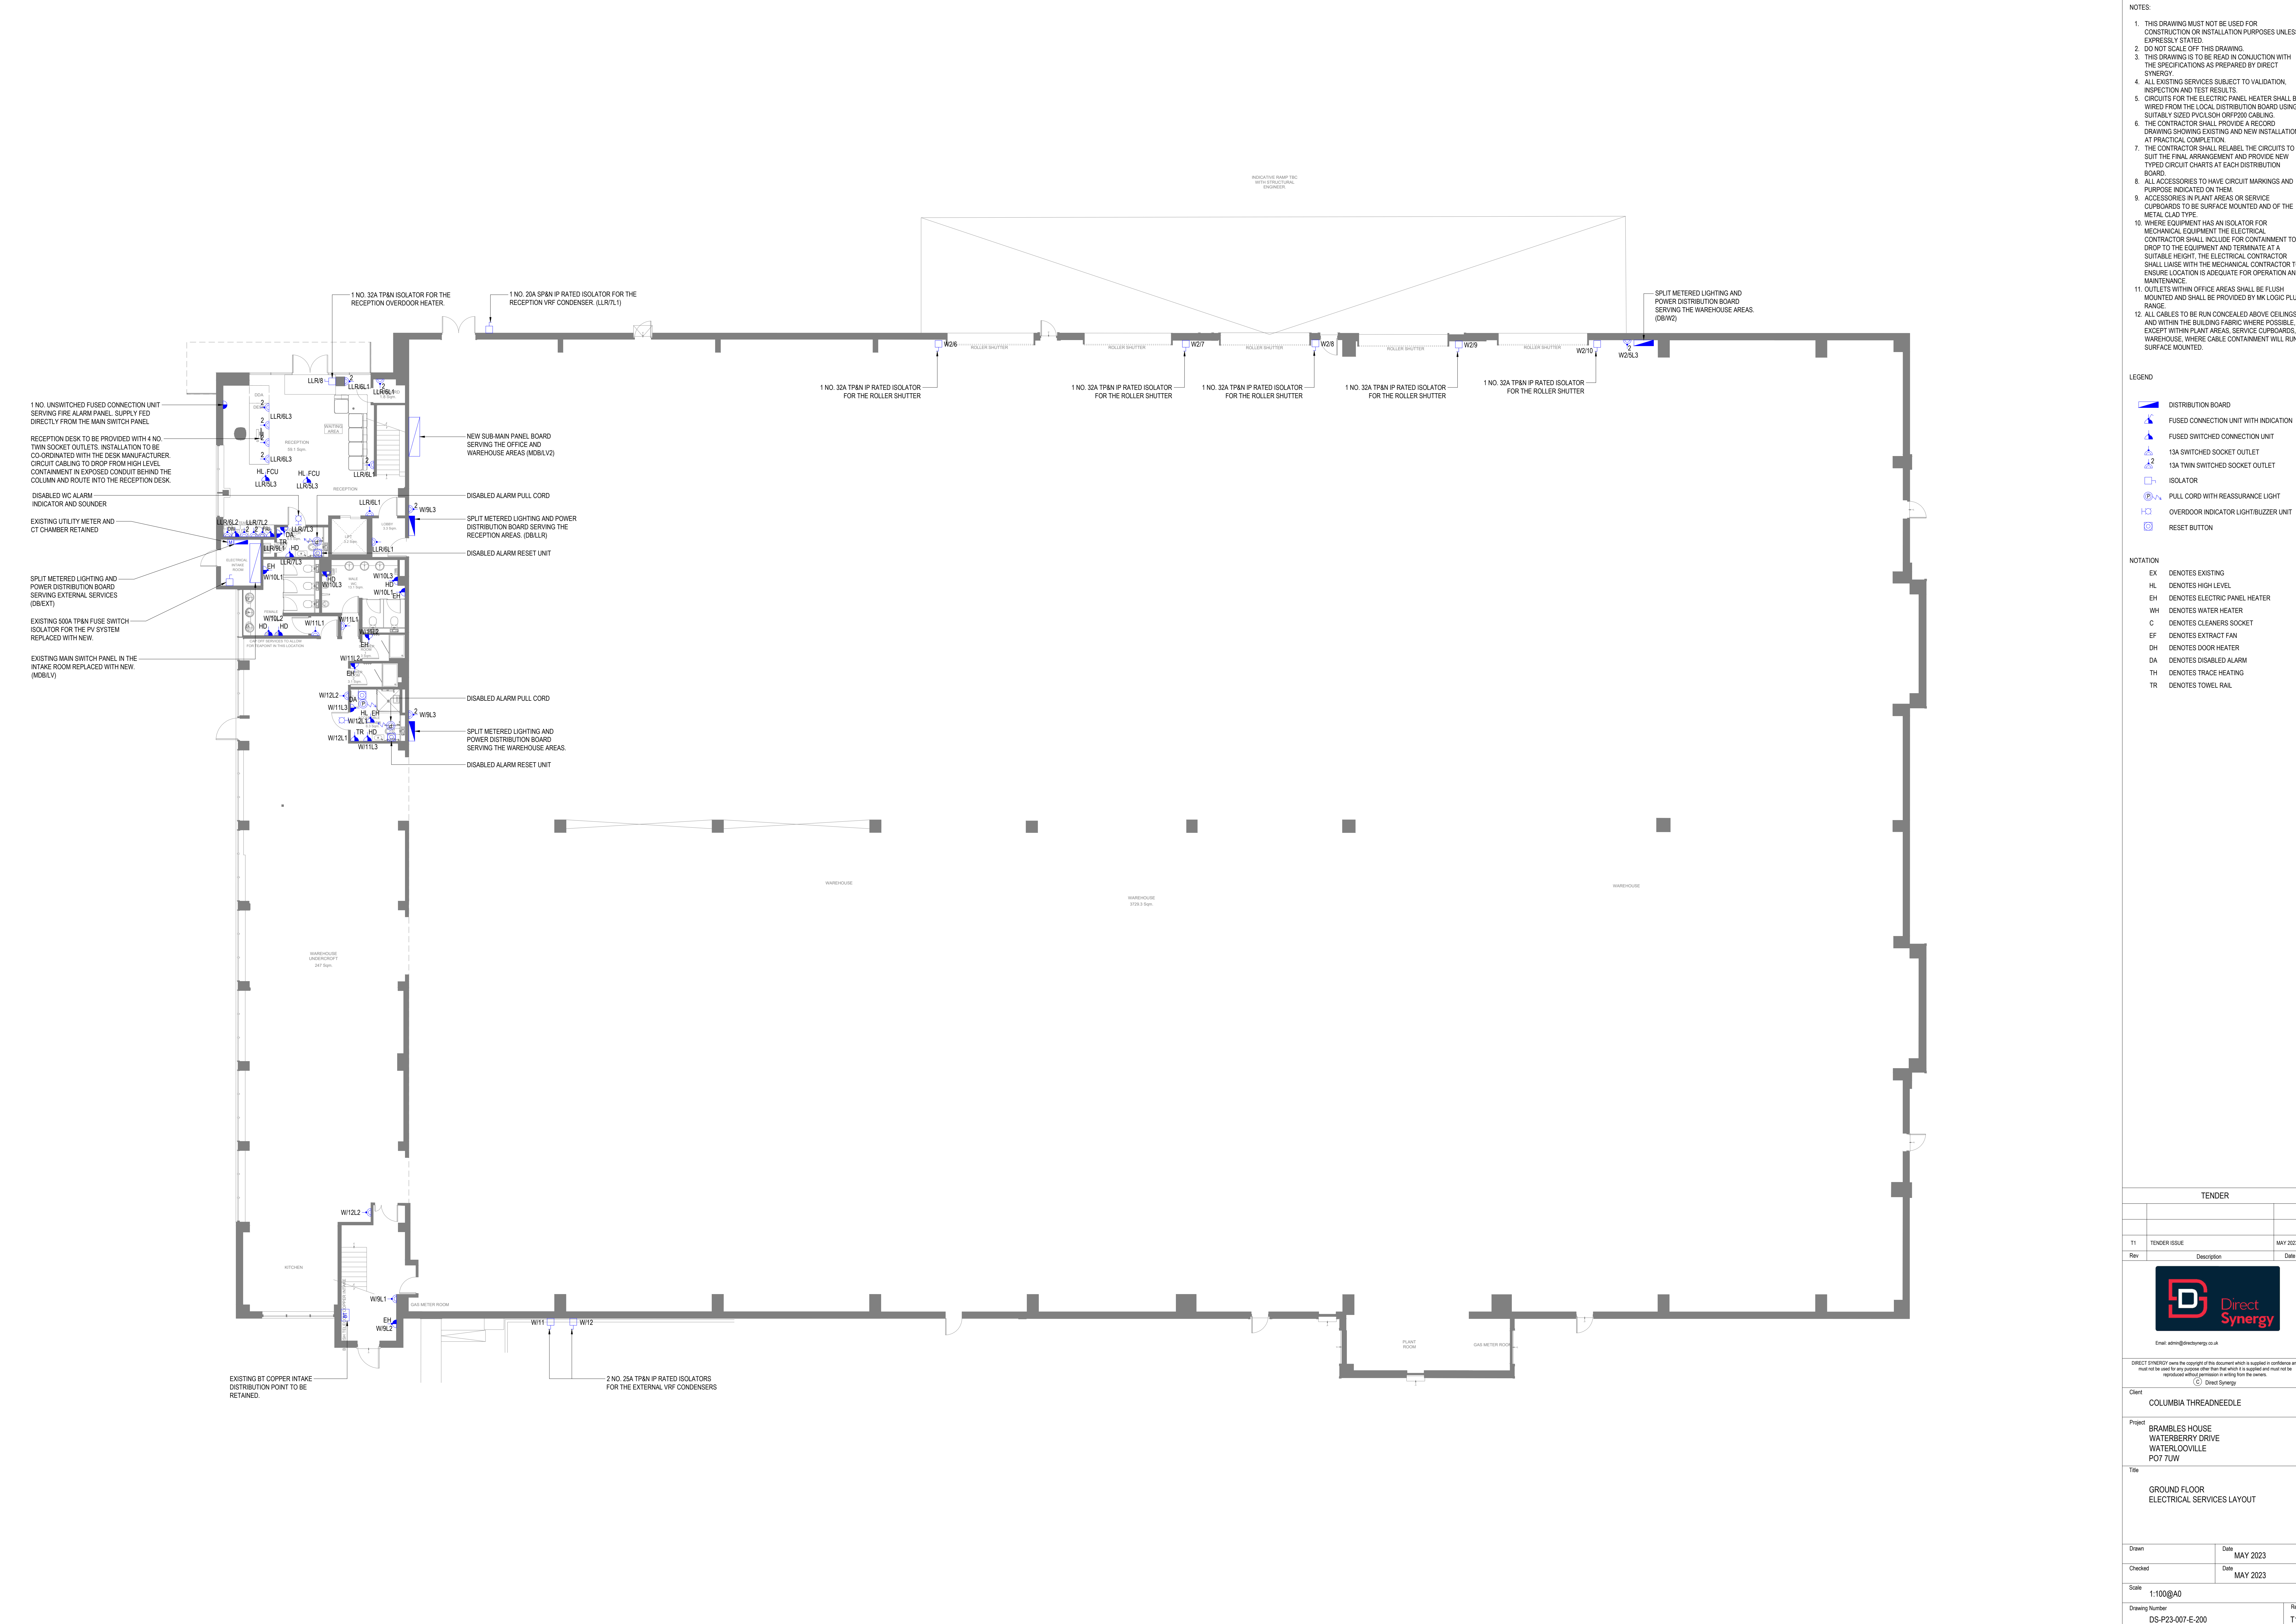

- NOTES:
1. THIS DRAWING MUST NOT BE USED FOR CONSTRUCTION OR INSTALLATION PURPOSES UNLESS EXPRESSLY STATED.
 2. DO NOT SCALE OFF THIS DRAWING.
 3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATIONS AS PREPARED BY DIRECT SYNERGY.
 4. ALL EXISTING SERVICES SUBJECT TO VALIDATION, INSPECTION AND TEST RESULTS.
 5. CIRCUITS FOR THE ELECTRIC PANEL HEATER SHALL BE WIRED FROM THE LOCAL DISTRIBUTION BOARD USING SUITABLY SIZED PVC/LSOH OR FFP200 CABLEING.
 6. THE CONTRACTOR SHALL PROVIDE A RECORD DRAWING SHOWING EXISTING AND NEW INSTALLATIONS AT PRACTICAL COMPLETION.
 7. THE CONTRACTOR SHALL RELABEL THE CIRCUITS TO SUIT THE FINAL ARRANGEMENT AND PROVIDE NEW TYPED CIRCUIT CHARTS AT EACH DISTRIBUTION BOARD.
 8. ALL ACCESSORIES TO HAVE CIRCUIT MARKINGS AND PURPOSE INDICATED ON THEM.
 9. ACCESSORIES IN PLANT AREAS OR SERVICE CLIPBOARDS TO BE SURFACE MOUNTED AND OF THE METAL CLAD TYPE.
 10. WHERE EQUIPMENT HAS AN ISOLATOR FOR MECHANICAL EQUIPMENT THE ELECTRICAL CONTRACTOR SHALL INCLUDE FOR CONTAINMENT TO DROP TO THE EQUIPMENT AND TERMINATE AT A SUITABLE HEIGHT. THE ELECTRICAL CONTRACTOR SHALL LAISE WITH THE MECHANICAL CONTRACTOR TO ENSURE LOCATION IS ADEQUATE FOR OPERATION AND MAINTENANCE.
 11. OUTLETS WITHIN OFFICE AREAS SHALL BE FLUSH MOUNTED AND SHALL BE PROVIDED BY MK LOGIC PLUS RANGE.
 12. ALL CABLES TO BE RUN CONCEALED ABOVE CEILINGS AND WITHIN THE BUILDING FABRIC WHERE POSSIBLE EXCEPT WITHIN PLANT AREAS, SERVICE CLIPBOARDS, WAREHOUSE, WHERE CABLE CONTAINMENT WILL RUN SURFACE MOUNTED.

- LEGEND
- DISTRIBUTION BOARD
 - FUSED CONNECTION UNIT WITH INDICATION
 - FUSED SWITCHED CONNECTION UNIT
 - 13A SWITCHED SOCKET OUTLET
 - 13A TWIN SWITCHED SOCKET OUTLET
 - ISOLATOR
 - PULL CORD WITH REASSURANCE LIGHT
 - OVERDOOR INDICATOR LIGHT/BUZZER UNIT
 - RESET BUTTON

- NOTATION
- EX DENOTES EXISTING
 - HL DENOTES HIGH LEVEL
 - EH DENOTES ELECTRIC PANEL HEATER
 - WH DENOTES WATER HEATER
 - C DENOTES CLEANERS SOCKET
 - EF DENOTES EXTRACT FAN
 - DH DENOTES DOOR HEATER
 - DA DENOTES DISABLED ALARM
 - TH DENOTES TRACE HEATING
 - TR DENOTES TOWEL RAIL

TENDER		
T1	TENDER ISSUE	MAY 2023
Rev	Description	Date
 Email: sales@directsynergy.co.uk DIRECT SYNERGY owns the copyright of this document which is supplied in confidence and must not be used for any purpose other than that which it is supplied and must not be reproduced without permission in writing from the issuer. © Direct Synergy		
Client	COLUMBIA THREADNEEDLE	
Project	BRAMBLES HOUSE WATERBERRY DRIVE WATERLOOVILLE PO7 7UW	
Title	GROUND FLOOR ELECTRICAL SERVICES LAYOUT	
Drawn	Date	MAY 2023
Checked	Date	MAY 2023
Scale	1:100@A0	
Drawing Number	DS-P23-007-E-200	
Rev	T1	