


**PROPOSED SINGLE STOREY FRONT ADDITION.
43, DANCES WAY, HAYLING ISLAND, HANTS.
FOR MR S. BROUGH.**

SECTION DRAWING

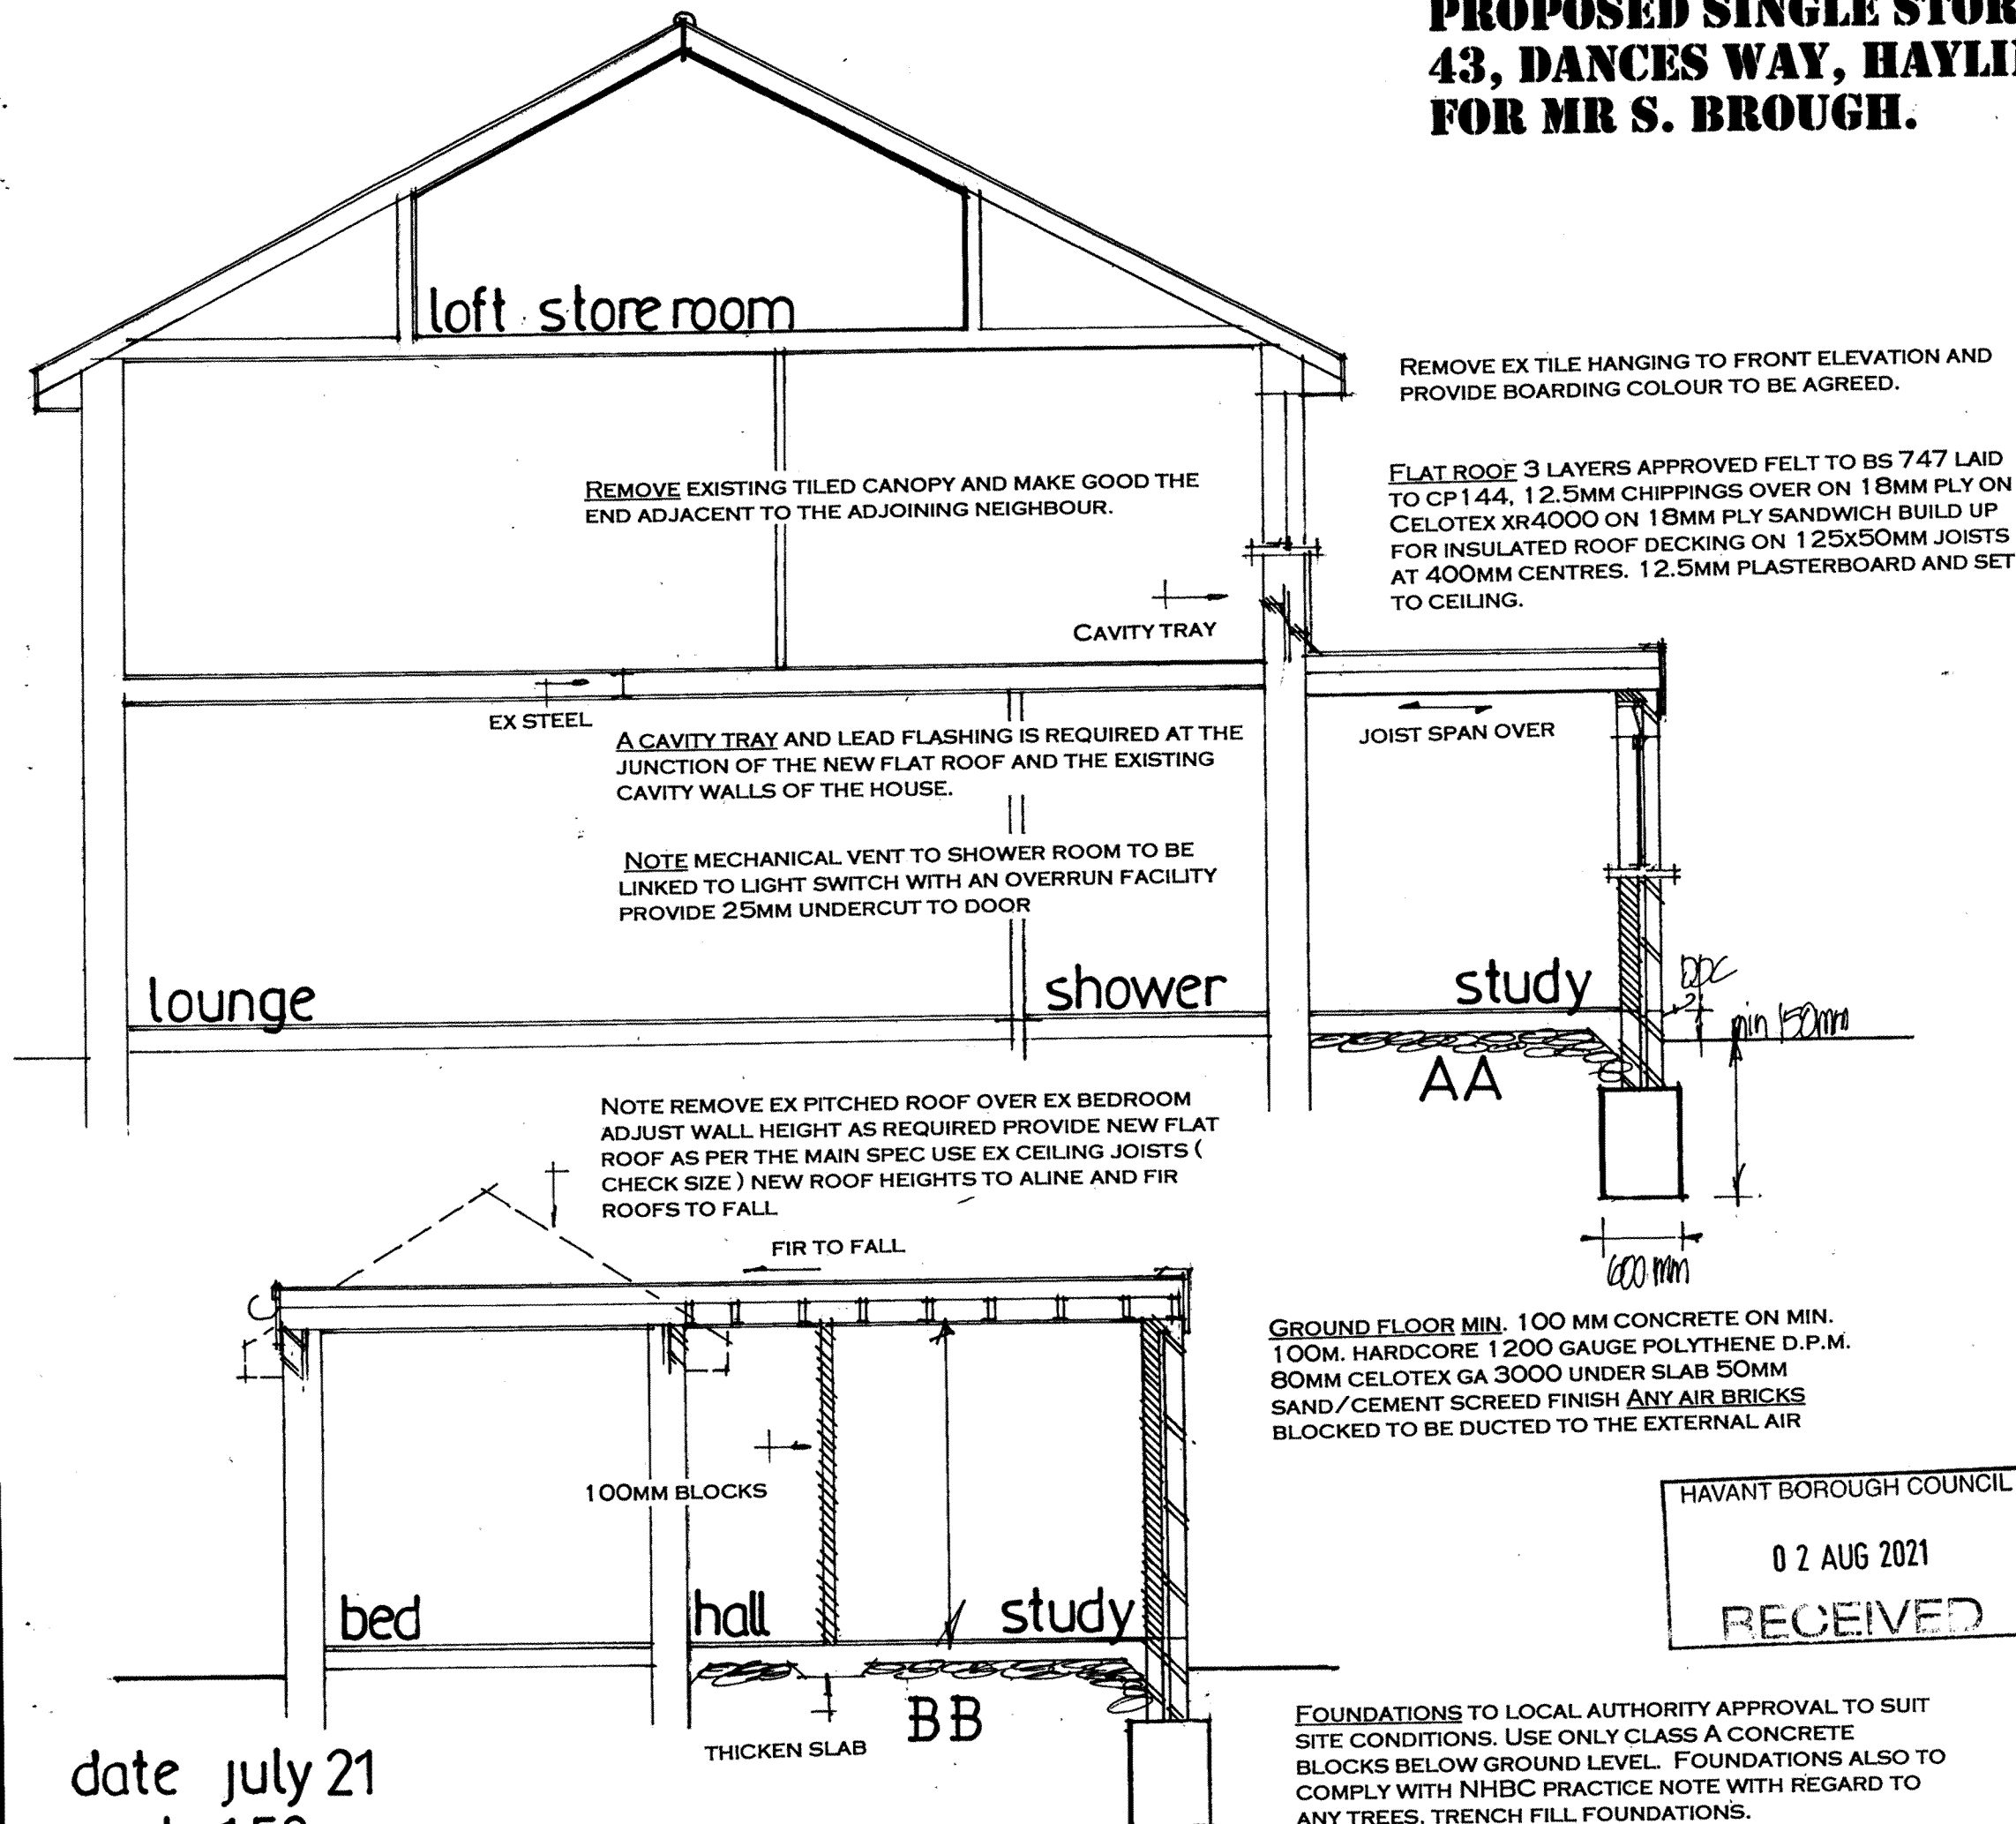

WALLS 100MM BLOCKS RENDERED EXTERNALLY 100MM CAVITY WITH 50MM CELOTEX INSULATION CLIPPED TO AN INSIDE SKIN OF 100MM CELCON SOLAR BLOCKS INTERNALLY RENDER AND SET TIE WALLS WITH APPROVED STAINLESS-STEEL WALL TIES EVERY 750MM HORIZONTALLY AND 450MM VERTICALLY

CATNIC LINTELS OVER ALL NEW OPENINGS, SIZE IN ACCORDANCE WITH THE MANUFACTURERS SPAN TABLES MINIMUM 150MM END BEARINGS.

STRAP DOWN NEW ROOF WITH MILD STEEL ANCHORS MINIMUM CROSS SECTION 30MMX5MM AND AT 1.2M CENTRES. CLOSE TOP OF NEW CAVITY WALLS WITH BRICKWORK.

WINDOWS TO BE DOUBLE AND TO ACHIEVE A U VALUE OF 1.6W/M²K TO GIVE A MINIMUM 1/20TH OF THE FLOOR AREA AS OPENING. PROVIDE 10,000 MM SQ. TRICKLE VENTS TO ALL NEW ROOMS. ANY LOW-LEVEL GLAZING TO CRITICAL AREAS IN DOORS/WINDOWS SIDELIGHTS ETC. TO BE SAFETY GLASS TO B.S 6206

RAINWATER DISPOSAL VIA 100MM DIAMETER GUTTERS AND DOWNPIPE TO PICKUP INTO EXISTING SURFACE WATER DRAINS AND DOWNPIPES TO LA APPROVAL ON SITE, ALTERNATIVELY TO NEW SOAKAWAYS MIN 5M FROM ANY BUILDING AND MIN 1M/3

PROVIDE MECHANICAL VENTILATION TO NEW SHOWER ROOM DUCTED TO THE EXTERNAL AIR MINIMUM CAPACITY 60 LITRES/SEC

NEW DRAINS TO BE 100MM DIAMETER APPROVED PLASTIC LAID 1.40 BEDDED AND SURROUNDED IN 150MM PEASHINGLE HAUNCH IN 150MM CONCRETE UNDER BUILDING PROTECT WITH LINTELS THROUGH FOUNDATIONS

PETER J. WALKER
ISLAND DESIGN
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9AN
TEL : 02392467571

date july 21
scale 1:50