Attenuation tank
to maintain existing storm water run off
10.0x5.0x1.2m depth
Providing 57m3 storage
Using cellular crates with 95% void ratio

New hardstanding cover
to units to be min.500mm in trafficked
areas

Storm IC
CL 9.250
IL 7.575
With storm water flow conctrol device limiting
discharge to 6.42 L/s
Tubosider or similar device

SILT TRAP

INLET

SUMP
MIN.200mm

TANK 1
GL 9.300
CL 8.800
IL 7.600

OUTLET

SECTION


ATTENUATION TANK DETAIL (1/100)

HYDRO-BRAKE
FLOW CONTROL
or orifice plate
to limit discharge
to 6.42L/s to
existing sewer


Hydro-Brake
CTL-SHE-0118-6400-1040-6400
Dim 545W x
125D (mm)
Sump Dlms
WxD(mm)
250x360

POLYPIPE CATCHPIT INSPECTION CHAMBER INCORPORATING FLOW CONTROL AND DEBRISE DEVICE


SCALE 1: 20

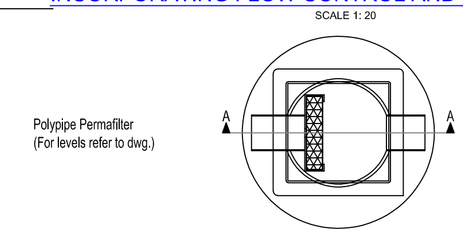

PLAN
SCALE 1: 20

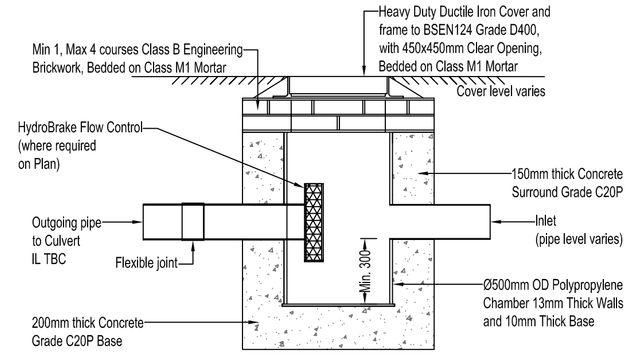


SECTION A-A
SCALE 1: 20

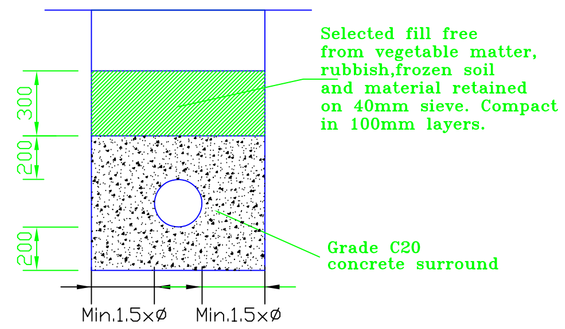


BEDDING FOR FLEXIBLE PIPES LESS THAN 900mm COVER UNDER ROADS

Scale 1:20

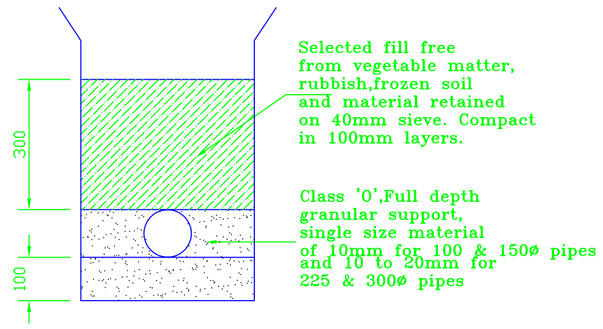


BEDDING FOR FLEXIBLE PIPES UNDER ROADS 900 to 1200mm DEEP

Scale 1:10

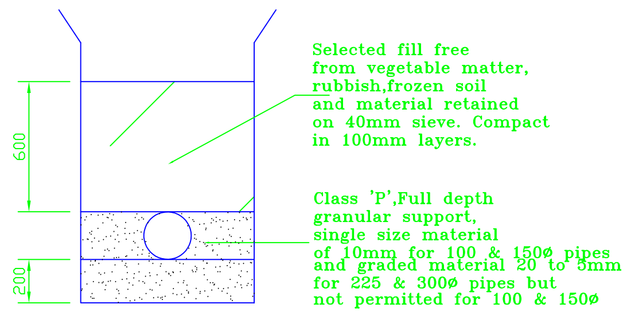


BEDDING FOR OTHER FLEXIBLE PIPES

Scale 1:10

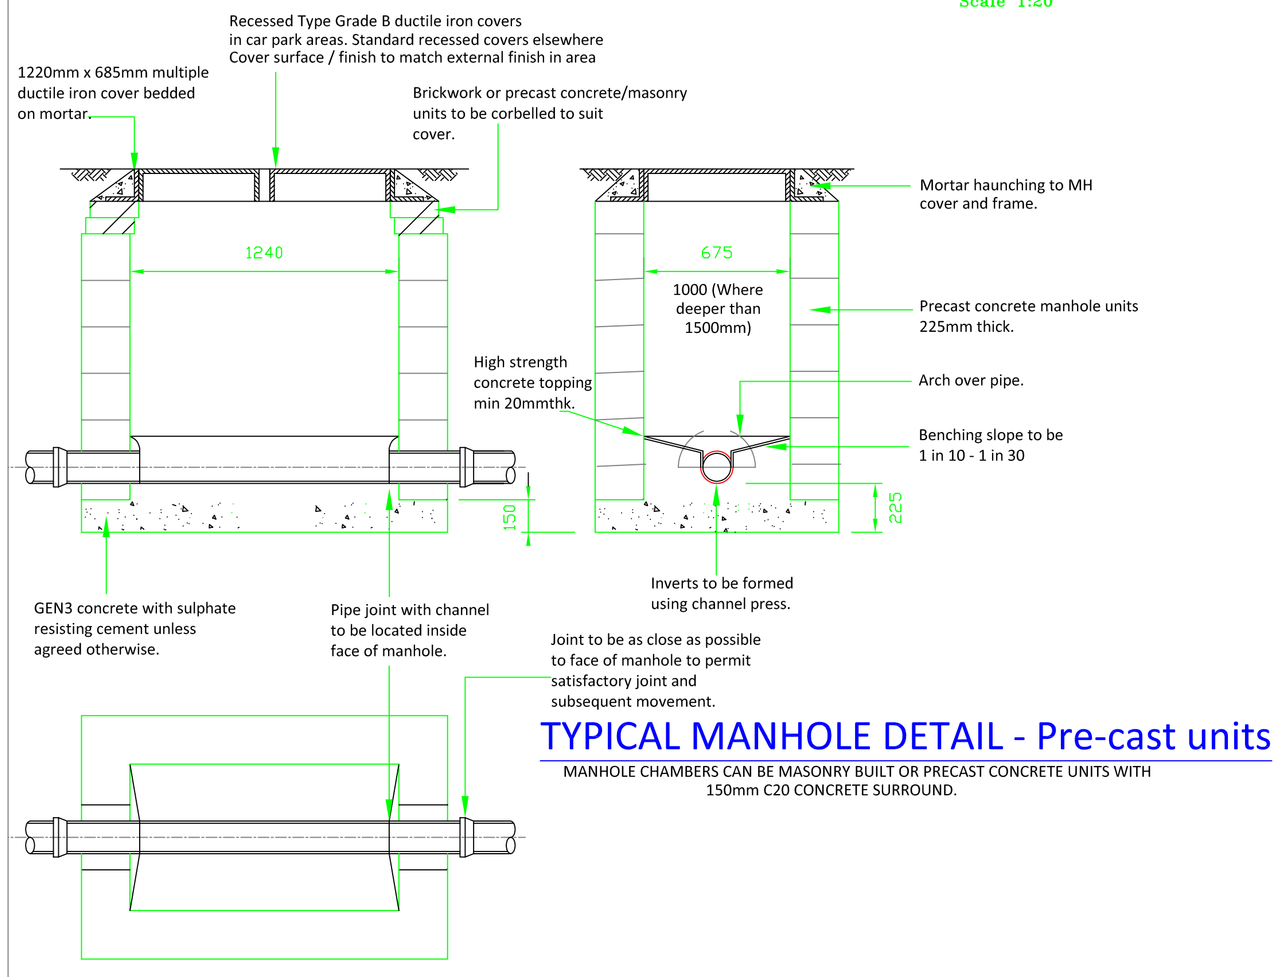

TYPICAL MANHOLE DETAIL - Pre-cast units

MANHOLE CHAMBERS CAN BE MASONRY BUILT OR PRECAST CONCRETE UNITS WITH 150mm C20 CONCRETE SURROUND.

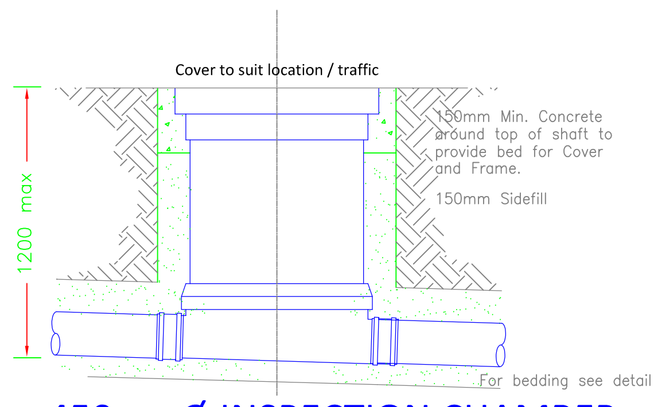

450mmØ INSPECTION CHAMBER TYPICAL INSTALLATION

(1:10)

DO NOT SCALE THIS DRAWING

NOTES

1. This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.

2. All dimensions are in millimetres unless noted otherwise. All levels are in Metres Above an arbitrary datum and not to Ordnance Datum.

3. In accordance with CDM 2015 the Contractor is to:
–Notify HSE of works.
–Comply with the requirements of Health and Safety Plan(if applicable)
–Provide risk accessments and method statements for all potential hazards relevant to this project.

4. The main contractor shall be responsible for the setting out and accuracy of all dimensions. He shall satisfy himself that the information given is correct and any discrepancies should be noted to the Engineer immediately.

5. DO NOT SCALE. If discrepancy or query arises on dimensions consult Engineer.

6. The Contractor is responsible for specifying product and codes and ordering of drainage materials.

7. All drainage to be installed to BS5955 Pt6 and in strict accordance with the manufacturers instructions.

8. All PVCu drainage products to conform to BS EN1401 & Kite mark certified in accordance with specification. If used for connection to public sewer must be able to withstand 4000psi.

9. All drainage pipes on this drwg to be 100mmø unless shown otherwise. Min. falls 1/80 for foul and 1/100 for storm drainage.

10. Cover grades and gulley gratings are in accordance with BS497 Pt 1
Cover Grades :– D400 – carriageways.
B125 – carriageways for slow traffic.
A15 – inaccessible to vehicles

11. Sewer runs and manholes to be adopted are to be in accordance with Sewers for Adoption, 7th Edition.

12. Any drainage laid less than 600mm below FGL to be covered with minimum 150mm Gen 3 grade concrete to half diameter.

13. No foul or storm water drainage sewer connection works to be undertaken until correct permission has been obtained by Contractor and granted by the Southern Water.

14. Provide 100x100 PCC lintel max span 650mm where svp exit the building.

15. ACO channels installed and bedded to manufacturers requirements.

16. External backdrop connection to comply with backdrop detail within Sewers for adoption 7th edition.

KEY

- PROPOSED NEW FOUL SEWER
- PROPOSED STORM DRAINAGE
- EXISTING STORM SEWER (Retained)
- EXISTING STORM SEWER (Removed / relocated))
- EXISTING FOUL DRAINAGE (Retained)
- EXISTING FOUL DRAINAGE (Removed/relocated)
- Proposed permeable paving with voided storm /flood water storage volume (See detail A) Used to drain new building roofs. Req = 390m2 area
- Proposed permeable paving (See detail B)
- R.E SVP or S — RODDING EYE. SOIL/VENT PIPE (WITH ABOVE GROUND ACCESS AT GROUND FLOOR LEVEL)
- R.W.P or R — RAINWATER PIPE (Allinto roddable gullies or where internal with access at G floor level)
- G — GULLY (Trapped and rodddable)
- AAV — AIR ADMITTANCE VALVE
- 450mmØ INSPECTION CHAMBER
- 1200Ø Precast concrete manhole
- Linear drainage channel ACO S100 with ball down grating, outlet into storm system in locations shown on plan,installed to suppliers details
- +47.920 — Proposed levels

Date	By	Revision	QA'D	Chk'd	Ref

Status: PRELIMINARY

Cowan Consultancy
STRUCTURAL, CIVIL AND BUILDING CONSULTANTS
3 Turnberry House
4400 Parkway
Whiteley
Fareham
Hampshire
PO15 7FJ

Also at:
Landguard Manor
Landguard Manor Road
Shanklin
Isle of Wight
PO37 7JB
Tel: 01489 577488
Fax: 01489 579873
consultants@cowanconsult.co.uk
www.cowanconsult.co.uk

Client: JNP Developments

Project: East Street, Havant
Hampshire

Title: Drainage Details

Date	Oct 2020	Scale	As noted	Drg. No.
Drawn	EG	Chk'd	QA'D	414601.11P2