


EXISTING LINTOLS AND FOUNDATIONS TO LOADBEARING WALLS TO BE EXPOSED FOR LOCAL AUTHORITY INSPECTION AND APPROVAL AS REQUIRED. NORMALLY AT THE START OF WORKS WHEN DRAINAGE RUNS ARE CHECKED.

CONTRACTOR IS TO CONFIRM THAT ALL NECESSARY LOCAL AUTHORITY APPROVALS HAVE BEEN OBTAINED BEFORE COMMENCING WORKS. COMMENCEMENT OF ANY WORKS PRIOR TO THIS IS ENTIRELY AT THE CLIENTS OR CONTRACTORS RISK. CHANGES TO THE SCHEME CARRIED OUT WITHOUT THE SURVEYORS APPROVAL MAY INVALIDATE THEIR LIABILITY.


ALL DIMENSIONS TO BE CHECKED ON SITE. ANY DISCREPANCIES ARE TO BE MADE KNOWN TO THE SURVEYOR AS SOON AS POSSIBLE.

SEE STRUCTURAL CALCULATIONS FOR STEEL OR TIMBER DETAILS. THE CONTRACTOR IS TO SITE MEASURE ALL STRUCTURAL MEMBERS AND/OR STAIRCASE, BEFORE ORDERING.


THE PROPERTY OWNERS ARE TO ENSURE THAT ANY/ALL REQUIREMENTS OF THE PARTY WALL ACT ARE COMPLIED WITH. ADVICE CAN BE OBTAINED FROM THE SURVEYOR.

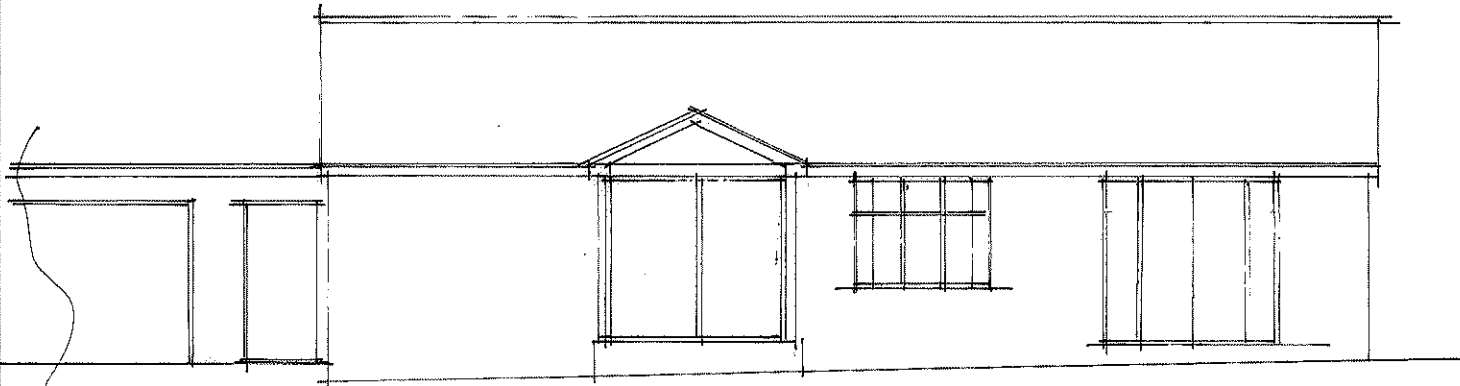


north

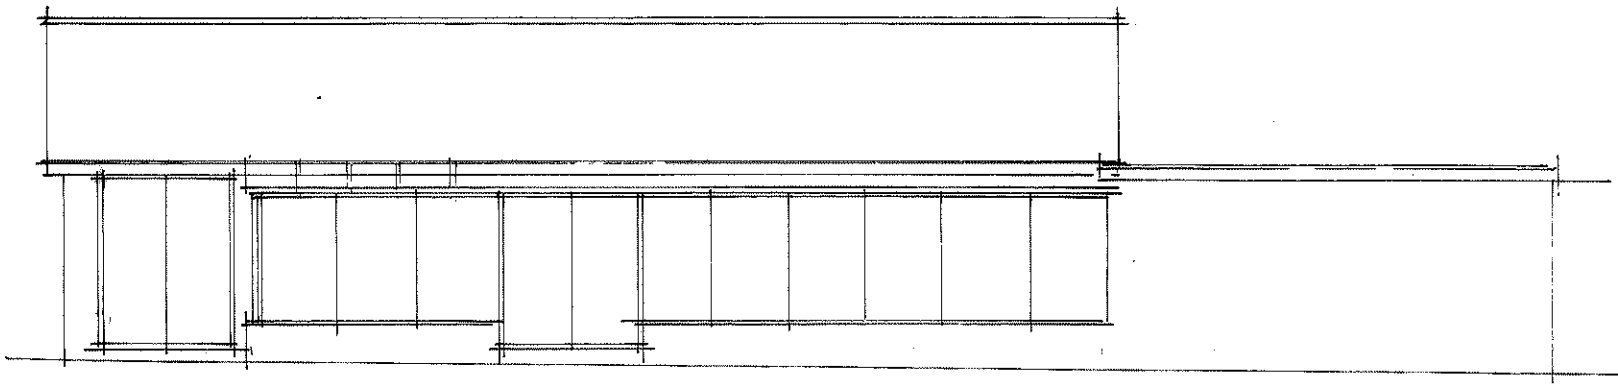

south

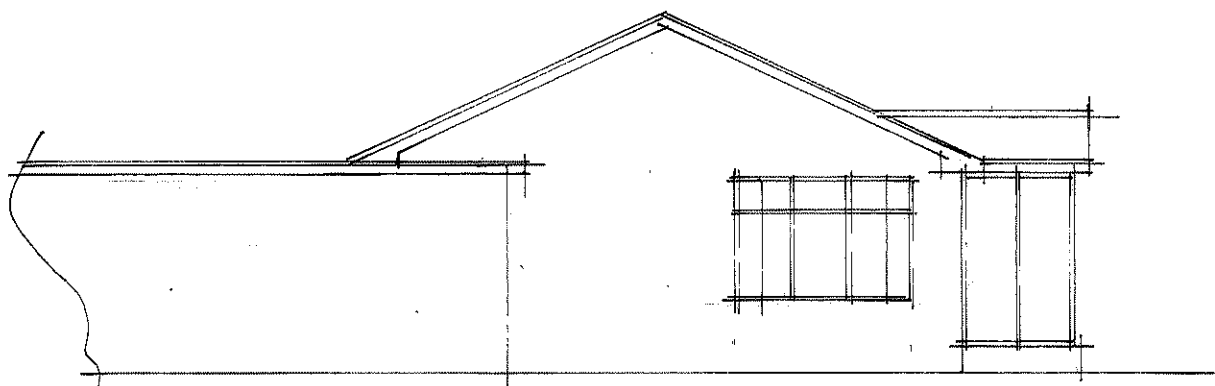

east

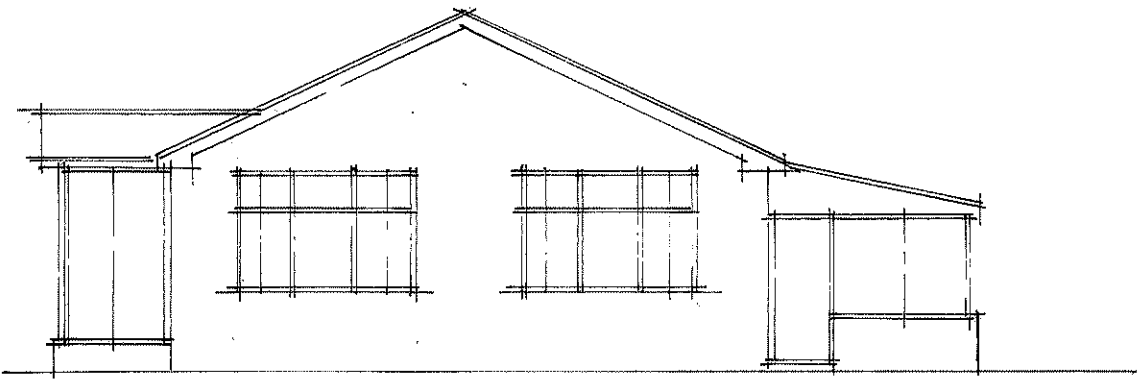

west

Foundation concrete trench fill, 600mm wide to min depth of 1 metre or to suit local ground conditions. (in clay soils min depth 1.2 metres x 600mm wide) or to below invert level of any adjacent drain run.

Floor 50mm screed on 100mm concrete slab on Celotex GA4070 insulation batts turned up at perimeter, on 1,200G damp proof membrane continuous with new and existing damp proof course, on minimum 100mm well consolidated hardcore with 50mm sand blinding. fit 100mm diam pvc ducts under slab terminating in 225x75mm airbricks to vent existing timber subfloors when required.

External walls 112mm facing bricks to match existing as closely as possible, 50mm cavity to Celotex CW4040 on 100mm lightweight concrete block (Celcon Solar, Thermalite Turbo, or similar rated) inner skin with render and set finish. (overall cavity 90mm) Insulated catnic lintols over new openings. Close cavities at eaves with non-combustible material. Tooth into existing walls and maintain all cavities. Wall ties to be at 750mm ctrs horizontally and 450mm ctrs vertically and staggered. 'Catnic' or similar vertical cavity thermal closers at openings. External perimeter of door and window openings to be sealed with a suitable airtight sealant.

Partitions 100mm concrete blockwork on suitable foundation. Render and set both sides.

Steelwork: And Timbers, see structural calcs or notes for sizes. Minimum bearing 100mm on concrete padstones, prestressed concrete lintols or metal bearing plates. Encase in minimum two layers 12.5mm plasterboard for half hour fire resistance when fitted at floor levels. Lengths of steels to be site measured to include bearings. All timbers to be C24 grade minimum. Fabrication details to be provided to Building Control if required.

Opening window areas to be minimum 1/20th of enclosed floor areas. All new windows to be fitted with minimum 8000sq.mm. trickle vents per room. Maximum area of double glazed window not to exceed 20% of floor areas side facing windows above ground level to be obscure and fixed below 1.7m.

New windows: new double glazed windows to have minimum U value of 1.6w/m²k. Doors to have a min U value of 1.80w/msq.k. Toughened glass in glazed doors and windows in critical locations, i.e.: alongside doors. Seal around window-wall joint with mastic sealant. Double rafters as roof light trimmers if applicable.

Main extension roof, concrete tiles on battens on breathable felt on 150 x 50mm joists at 400mm centres. Strap down with 1.00m x 32mm galv. ms straps at max 1.20m ctrs. Around perimeter.

Roof insulation: roof to be insulated with two layers of 150mm fibreglass insulation quilt. One layer laid between ceiling joist and one layer laid over in opposite direction. Maintain roof ventilation with 25mm continuous air to eaves and vent tiles to apex as shown.

Drainage all drainage to BS EN752 plus approved doc H 100mm diam. PVC drain ware minimum fall 1-40 in 150mm concrete surround to new or existing inspection chamber on existing run. Bridge with concrete lintols over where passing beneath new walls and flexible packing surround. Exact position, invert and direction of all existing drains to be determined and agreed on site PRIOR to commencement of works.

Flat roof: Three layer built up felt to BS747 cp144 pt3 on Celotex XR4120 decking on firrings and 125x50mm joists at 400mm centres. 12.5mm foil back plasterboard ceiling. Seal warm roof from existing vented roof space at join if applicable. Flat covering should achieve AA, AB or AC clarification for fire protection.

Plumbing all to BS EN 2056 plus approved doc H 38mm diam. waste from shower. 32mm diam. Waste from wash hand basins, all with rodding access on changes of direction and with deep seal traps. Run to new stubstack.

Rain water goods: run new 100mm diam pvc rain water guttering and 70mm diam downpipes to 1.0cu.m. soakaways formed min 5m from building via big and 100mm diam drainware.

New inspection chamber sizes to suit invert of drains minimum sizes 600 x 450mm internal with 103mm semi engineering brickwork sides 215mm where invert exceeds 1000mm, built up from 150mm concrete slab base and fit medium duty cover and frame.

All new electrical works to be designed, installed, inspected and tested in accordance with BS7671 (IEE 18th Ed) the works are to be undertaken by an installer registered under a suitable self certification scheme or by a suitably qualified person with a certificate of compliance produced to building control upon completion of the works.

Lighting Fit high efficacy light fittings minimum one per four new fittings. Any recessed ceiling lights to be 30minute fire resisting.

Ceilings: 12.5mm foil back plasterboard on 150 x 50mm joists at 400mm centres with 100mm glass fibre quilt between joists and Celotex GA4090 batts over the joists. Bolt and dog tooth washers at joints. Fit baffle boards at eaves to maintain clear air flow.

Drainage all drainage to BS EN752 plus approved doc H 100mm diam. PVC drain ware minimum fall 1-40 in 150mm concrete surround to new or existing inspection chamber on existing run. Bridge with concrete lintols over where passing beneath new walls and flexible packing surround. Exact position, invert and direction of all existing drains to be determined and agreed on site PRIOR to commencement of works.

Fit mechanical extract fans to any new wc and bathroom areas rated at min 15lit/sec

A	Date	Revision
© copyright		
THORNS YOUNG ARCHITECTURAL		
THORNS-YOUNG LTD CHARTERED BUILDING CONSULTANTS Website: www.thornsyoun.co.uk		
Fareham 21 Middle Road Park Gate SO31 7GH Tel: (01329) 888 322	Portsmouth 232 London Road North End PO2 9JQ Tel: (02392) 672 883	
Client MR. L. COUZENS		
Job Title 11 LANGE BROOKE CLOSE LANCASTER LANCASHIRE		
Drawing Title EXISTING ELEVATIONS. CONSTRUCTION NOTES.		
Scale 1:100		
Date OCT 20	Drawn by CMC	
Drg. No. 4164: 20: 2		Rev.