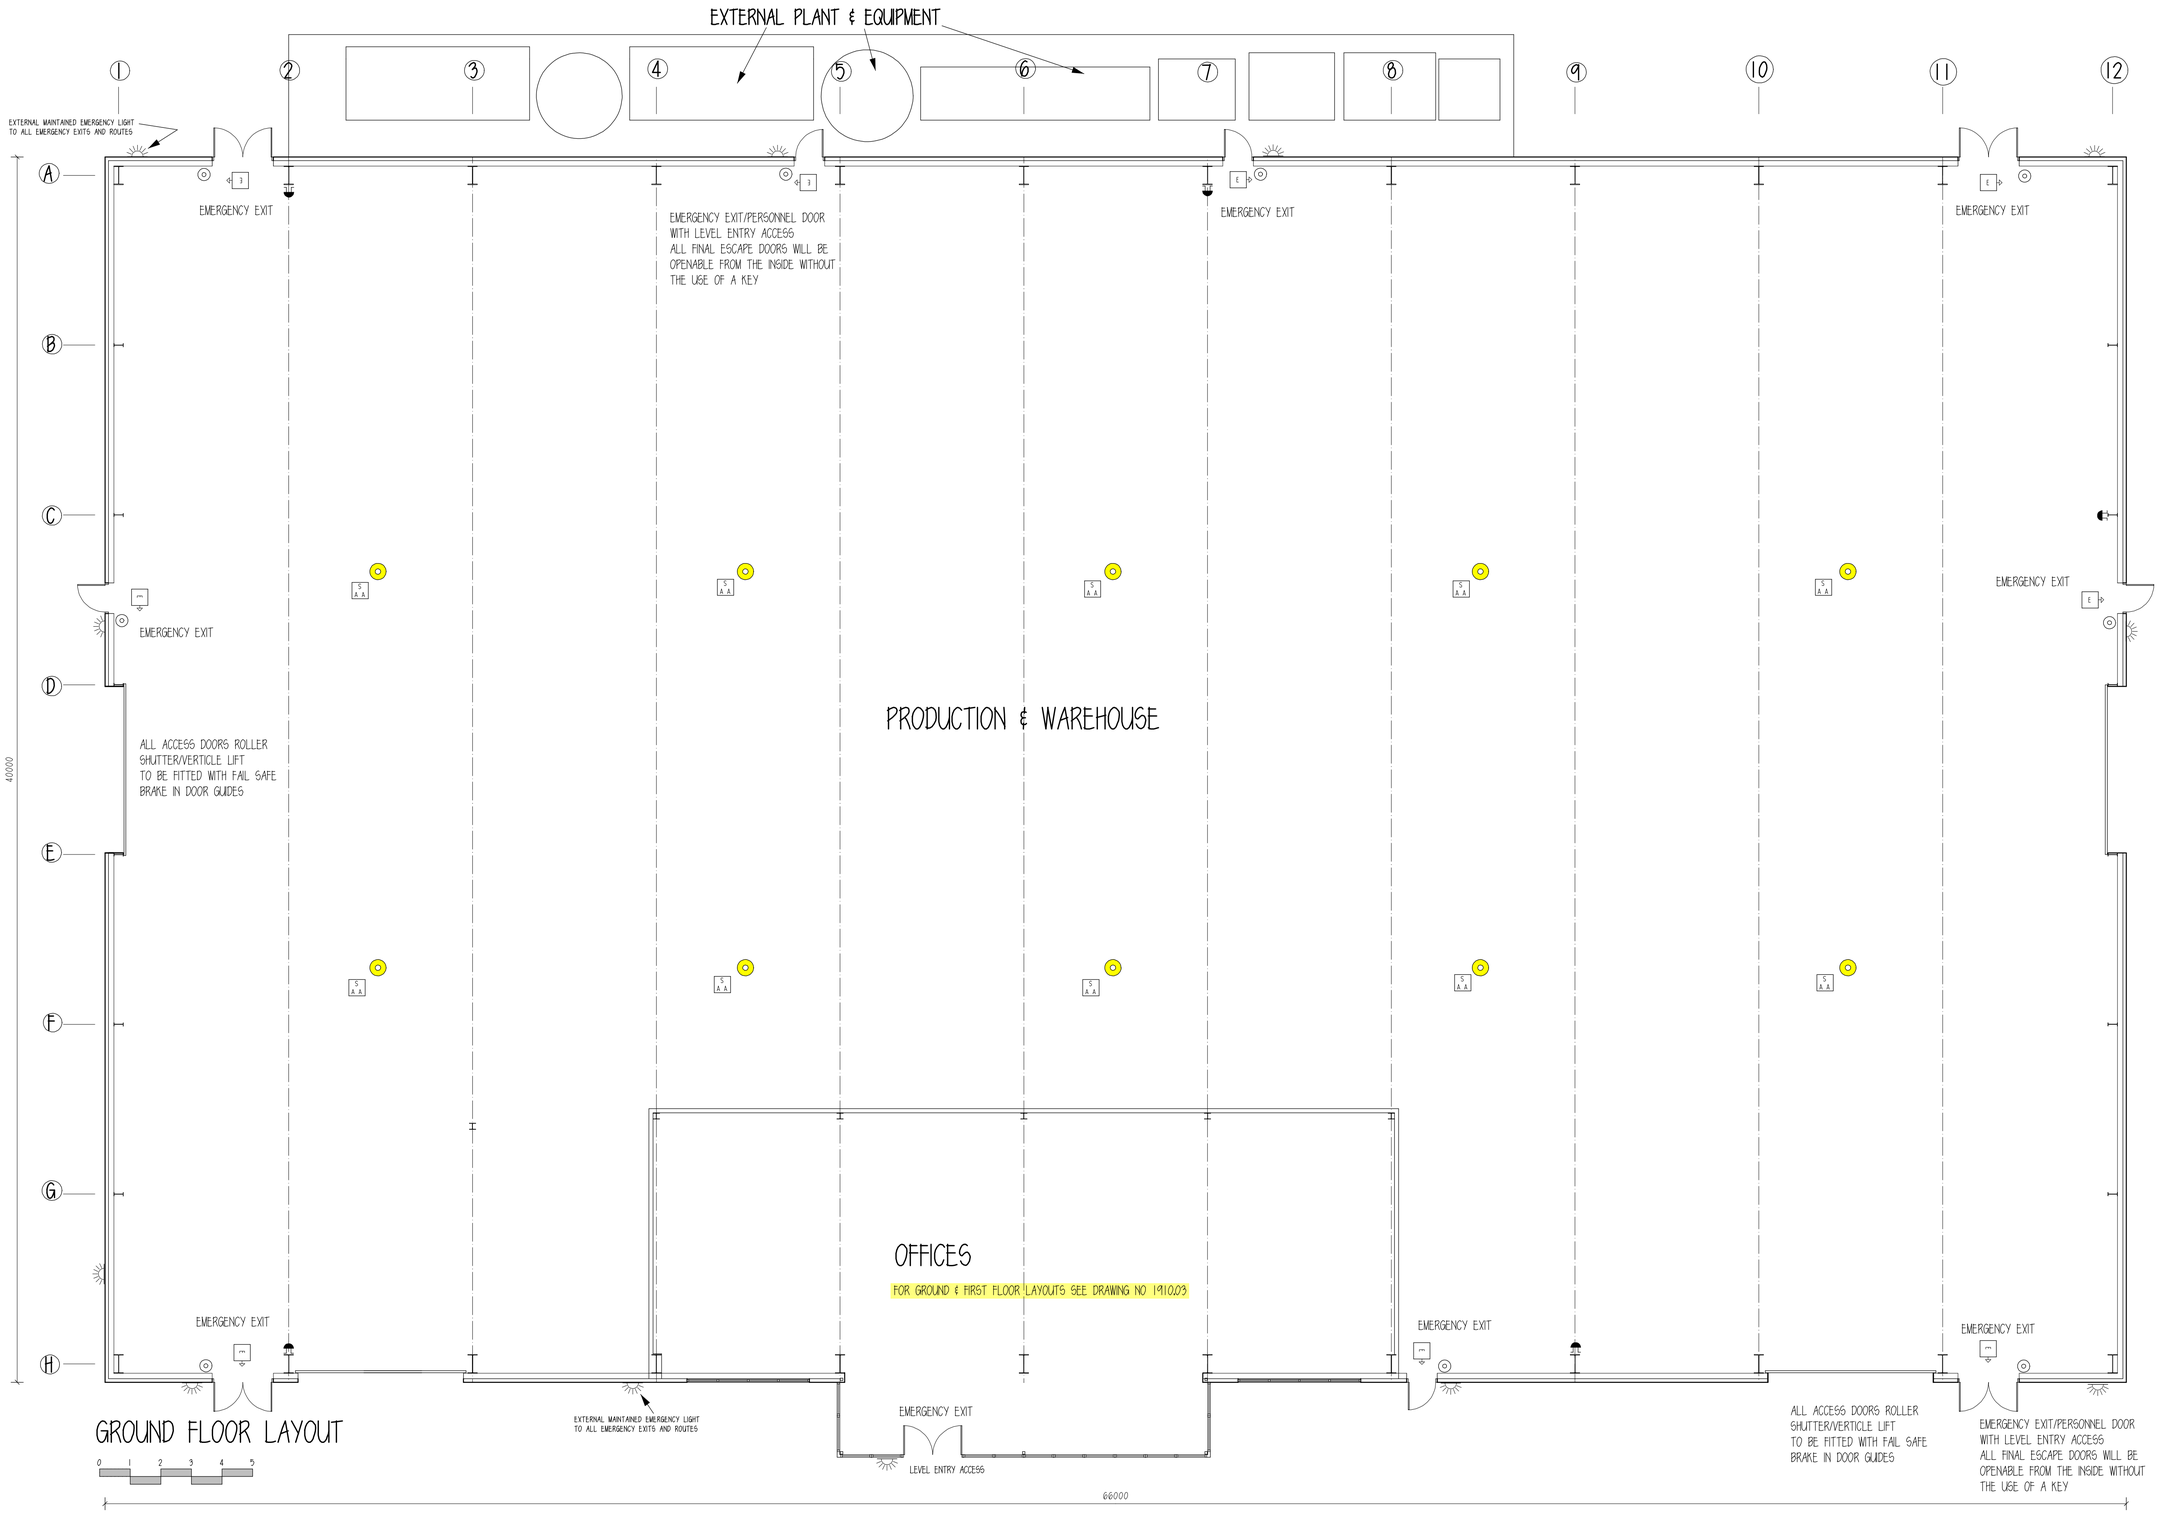


GROUND FLOOR LAYOUT

0 1 2 3 4 5

FIRE NOTES

AN AUTOMATIC FIRE DETECTION SYSTEM OF TYPE L2 AND COMPLYING WITH THE RELEVANT CLAUSES OF BS 5839-1: 2017 WILL BE INSTALLED

EMERGENCY ESCAPE LIGHTING SHALL BE INSTALLED AND SHALL BE THE 'MAINTAINED' TYPE COMPLYING WITH BS 5266-1:2011

THE EMERGENCY EXIT ROUTES SHALL BE SIGN POSTED SO AS TO MAKE CLEAR ALL ALTERNATIVE EXIT AVAILABLE AS BS EN ISO 7010: 2012 + BS 5499-4: 2013

ALL FIRE FIGHTING EQUIPMENT WILL COMPLY WITH BS 5306

ALL NOTICES AND SIGNAGE WILL COMPLY WITH BS 5499-4: 2013

EMERGENCY LIGHTING AND FIRE ALARM EQUIPMENT AS SHOWN IS PURELY INDICATIVE. IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL ALL EQUIPMENT AND FITTINGS TO FULLY COMPLY WITH TYPE L2 INSTALLATION.

ON COMPLETION OF THE WORKS, INSTALLATION AND TEST CERTIFICATES MUST BE PROVIDED BY THE ELECTRICAL CONTRACTOR.

LEGEND

- ALARM BELL
- FIRE ALARM CALL POINT
- E — EXIT DIRECTION SIGN - ILLUMINATED RUNNING MAN SYMBOL
- S A A — AREA COVERED BY SMOKE DETECTORS
- H A A — AREA COVERED BY HEAT DETECTORS
- INDEPENDANT EMERGENCY LIGHTING POINT
- EXTERNAL MAINTAINED EMERGENCY LIGHT TO ALL EMERGENCY EXITS AND ROUTES

DOOR FASTENINGS ON ESCAPE ROUTES SHALL NOT BE FITTED WITH LOCKS, LATCHES OR BOLT FASTENINGS OTHER THAN STATED IN REGULATION B1 5.11. ANY ELECTRICALLY POWERED LOCKS SHALL RETURN TO THE UNLOCKED POSITION ON OPERATION OF THE FIRE ALARM SYSTEM OR ON LOSS OF POWER OR SYSTEM ERROR OR ON ACTIVATION OF A MANUAL DOOR RELEASE UNIT (TYPE A) TO BS EN 54-11:2001 POSITIONED AT THE DOOR ON THE SIDE APPROACHED BY PEOPLE MAKING THEIR ESCAPE. WHERE THE DOOR PROVIDES ESCAPE IN EITHER DIRECTION, A UNIT SHOULD BE INSTALLED ON BOTH SIDES OF THE DOOR.

WALL/CEILING LININGS ARE TO COMPLY WITH B2 SECTION 6 TABLE 10 CLASS '0' FOR ESCAPE ROUTES

ALL SUPPORTING STRUCTURE SHALL BE FIRE PROTECTED TO 60 MINUTES

ALL NOTED BOUNDARIES TO BE FIRE PROTECTED TO COMPLY WITH B4 -SECTION 12.4.

A FIRE HYDRANT WILL BE INSTALLED NEAR TO THE SITE WITH GOOD ACCESS FOR THE FIRE SERVICE IF THERE IS NOT ONE WITHIN 100 METRES OF THE BUILDING

0 1 2 3 4 5

SCALE BAR 1:100

PROPOSED NEW BUILDING FOR

AHMARRA

PLOT 2, HARTS FARM WAY,

HAVANT, PO9 1FA

PROPOSED GROUND FLOOR

DATE JUNE 2019

SCALE 1:100

PAPER SIZE A1

DRN BY SP

DRG NO.

1910.01A

LEOMINSTER CONSTRUCTION
Building it right for you
LEOMINSTER INDUSTRIAL ESTATE,
SOUTHERN AVENUE,
LEOMINSTER,
HEREFORDSHIRE HR6 0QF
TEL: (01568) 612943 - 612909
FAX: (01568) 612910