



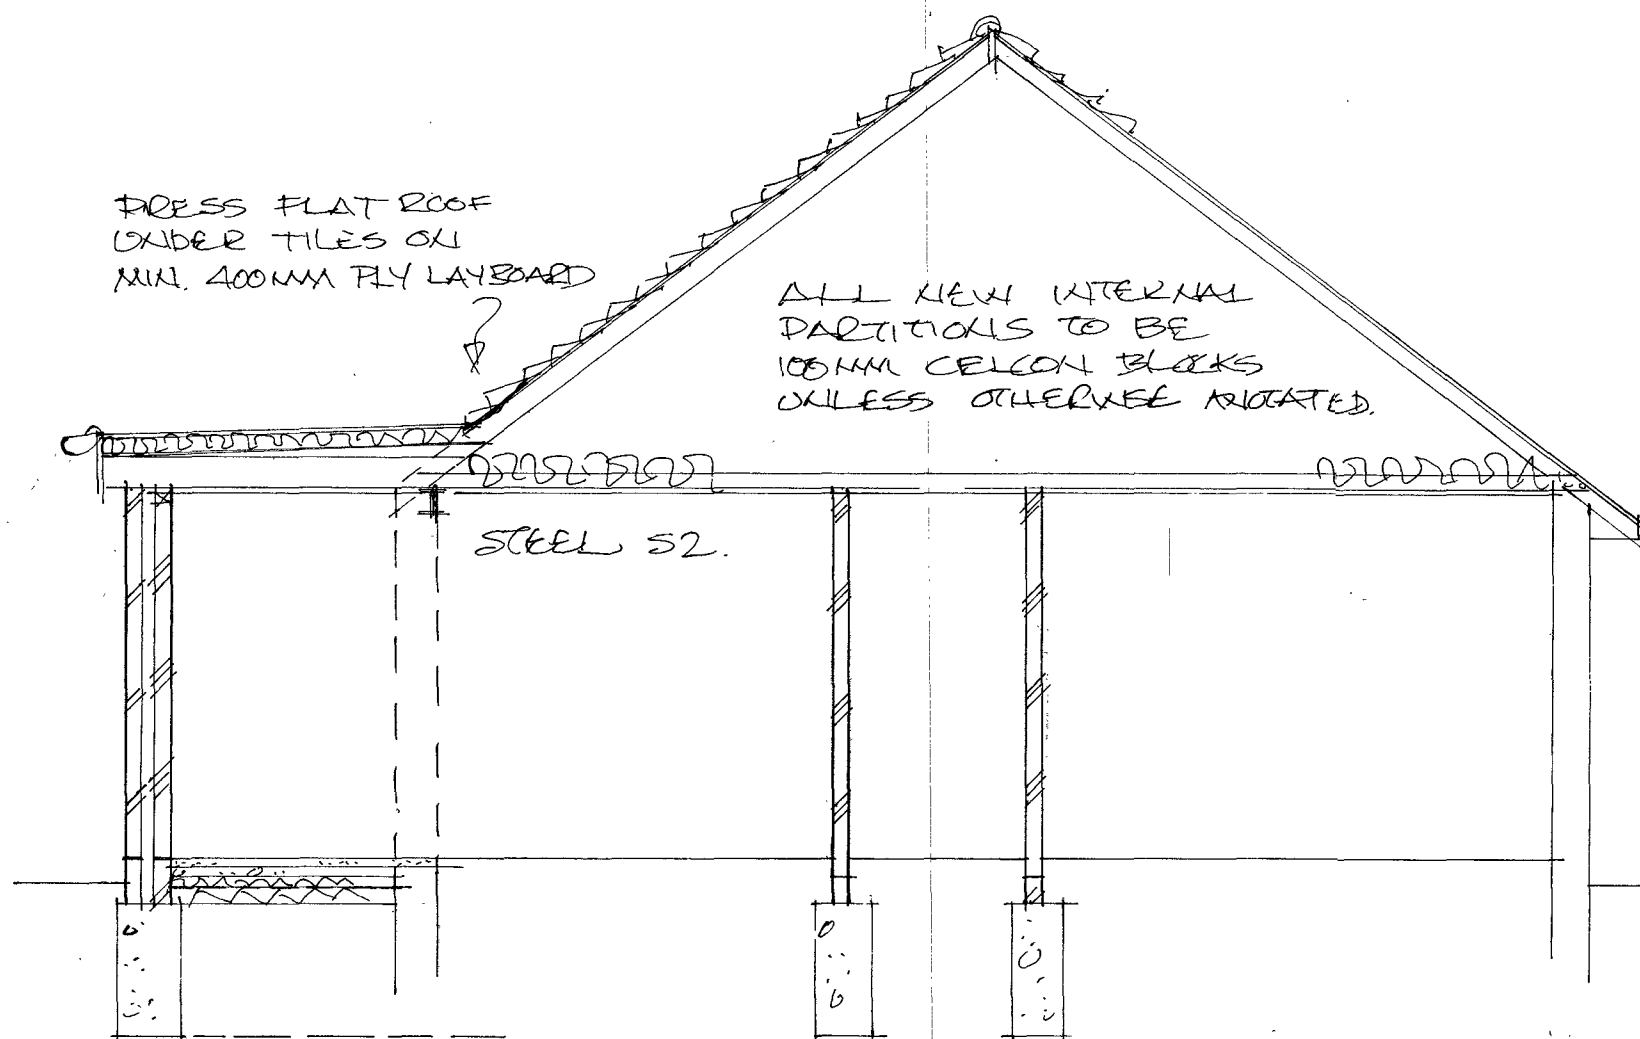

section a-a

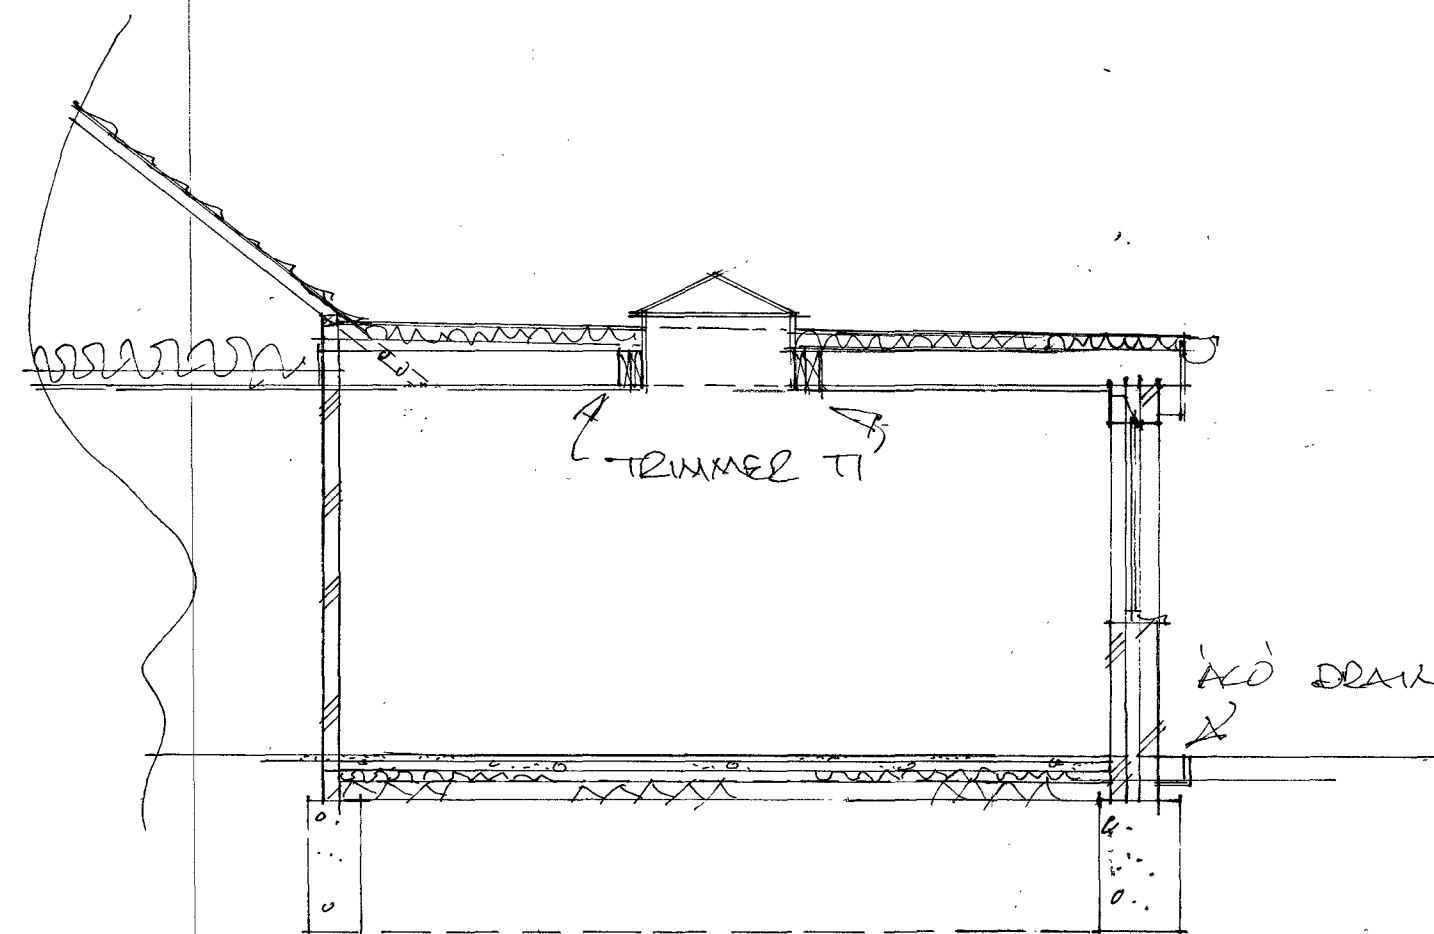

section b-b

Foundation concrete trench fill, 450mm wide to min depth of 1 metre or to suit local ground conditions. (in clay soils min depth 1.2 metres) or to below invert level of any adjacent drain run.

Floor 50mm screed on 100mm concrete slab on Celotex GA4070 insulation batts on 1,200G damp proof membrane continuous with new and existing damp proof course, on minimum 100mm well consolidated hardcore with 50mm sand blinding. fit 100mm diam pvc ducts under slab terminating in 225x75mm airbricks to vent existing timber subfloors when required.

External walls 112mm facing bricks to match existing as closely as possible, 50mm cavity to Celotex CW4040 on 100mm lightweight concrete block (Celcon Solar, Thermalite Turbo, or similar rated) inner skin with render and set finish. (overall cavity 90mm) Insulated catnic lintols over new openings. Close cavities at eaves with non-combustible material. Tooth into existing walls and maintain all cavities. Wall ties to be at 750mm ctrs horizontally and 450mm ctrs vertically and staggered. 'Catnic' or similar vertical cavity thermal closers at openings. External perimeter of door and window openings to be sealed with a suitable airtight sealant.

Opening window areas to be minimum 1/20th of enclosed floor areas. All new windows to be fitted with minimum 8000sq.mm. trickle vents per room. Maximum area of double glazed window not to exceed 20% of floor areas side facing windows above ground level to be obscure and fixed below 1.7m.

New windows: new double glazed windows to have minimum U value of 1.6w/m²k. Doors to have a min U value of 1.80w/msq.k. Toughened glass in glazed doors and windows in critical locations. i.e.: alongside doors. Seal around window-wall joint with mastic sealant. Double rafters as roof light trimmers if applicable.

Minimum full opening size of escape window 0.33sq.m. min clear dimension of edge 450mm with cill below 1.10m from floor and above 800mm.

Drainage all drainage to BS EN752 plus approved doc H 100mm diam. PVC drain ware minimum fall 1-40 in 150mm concrete surround to new or existing inspection chamber on existing run. Bridge with concrete lintols over where passing beneath new walls and flexible packing surround. Exact position, invert and direction of all existing drains to be determined and agreed on site PRIOR to commencement of works.

The integrity of the existing sewer passing beneath the extension to be checked either by exposing the sewer or a CCTV camera survey prior to commencement of work. In some circumstances it may be necessary to apply to the managing water company for a "build over agreement" prior to the works being carried out. Advice can be sought from Thorns Young or your local Building Inspector.

Flat roof. 13mm spar chippings on 3 layer high performance torch on breathable felt to BS747 cp144 part 3 1977 on Celotex XR4120 insulated roof decking on firrings on 200x50mm roof joists at 400mm centres. 12.5mm foil back plaster board ceiling. Strap down new roof with 1000 x 32mm galvanised mild steel straps at 1200mm centres. Ensure that wall insulation is taken up to meet underside of Celotex to ensure warm roof construction. Flat covering should achieve AA, AB or AC clarification for fire protection.

All new electrical works to be designed, installed, inspected and tested in accordance with BS7671 (IEE.18thEd) the works are to be undertaken by an installer registered under a suitable self certification scheme or by a suitably qualified person with a certificate of compliance produced to building control upon completion of the works.

Lighting. Fit high efficacy light fittings minimum one per four new fittings. Any recessed ceiling lights to be 30minute fire resisting.

Fit mechanical extract fan from kitchen rated at min 60lit/sec. If cooker hood installed, to be rated at 45lit/sec. Utility room if applicable to be rated at 30lit/sec.

Steelwork: And Timbers. see structural calcs or notes for sizes. Minimum bearing 100mm on concrete padstones, prestressed concrete lintols or metal bearing plates. Encase in minimum two layers 12.5mm plasterboard for half hour fire resistance when fitted at floor levels. Lengths of steels to be site measured to include bearings. All timbers to be C24 grade minimum. Fabrication details to be provided to Building Control if required.

EXISTING LINTOLS AND FOUNDATIONS TO LOADBEARING WALLS TO BE EXPOSED FOR LOCAL AUTHORITY INSPECTION AND APPROVAL AS REQUIRED. NORMALLY AT THE START OF WORKS WHEN DRAINAGE RUNS ARE CHECKED.

Inner partition: 100mm Celcon blockwork on suitable foundation. Dot and dab 9mm plasterboard and set both sides.

New and existing drains where passing beneath building encased in 150mm minimum of concrete.

Plumbing all to BS EN 2056 plus approved doc H 38mm diam. wastes from sink, bath and shower. 32mm diam. Waste from wash hand basins, all with rodding access on changes of direction and with deep seal traps. Run to existing/new 100mm diam pvc svp terminating min 900mm above nearest window head and with rodding access at the base.

Duct mechanical extract from internal wc/bathroom rated to give min 3ach with up to 15minute overrun. Wired to light switch. Min 12mm air gap under door.

Rain water goods: run new 100mm diam pvc rain water guttering and 70mm diam downpipes to 1.0cu.m. soakaways formed min 5m from building via big and 100mm diam drainware.

Heating. Gas fired combination boiler with balanced flue terminating min 300mm from windows. Boiler to have min. SEDBUK rating of 86%. Installer to be registered on the GAS SAFE REGISTER. Run 22mm diam condensate pipe to foul drain via 75mm trap.

All new radiators to be fitted with TRVs

Fit mechanical extract fans to any new wc and bathroom areas rated at min 15lit/sec

ALL DIMENSIONS TO BE CHECKED ON SITE. ANY DISCREPANCIES ARE TO BE MADE KNOWN TO THE SURVEYOR AS SOON AS POSSIBLE.

A	March 20	drawn by CMC
Date	Revision	
© copyright		
THORNS YOUNG ARCHITECTURAL		
THORNS-YOUNG LTD CHARTERED BUILDING CONSULTANTS Website: www.thornsyoun.co.uk		
Fareham 21 Middle Road Park Gate SO31 7GH Tel: (01329) 888 322	Portsmouth 232 London Road North End PO2 9JQ Tel: (02392) 672 883	
Client		
MR. M. GOSSAGE		
Job Title		
25 STANTON AVENUE HAYLING ISLAND.		
Drawing Title		
PROPOSED REAR AND SIDE EXTENSIONS.		
Scale 1:50		
Date MARCH 20	Drawn by CMC	
Drg. No.		Rev.
4041: 20: 1		A