


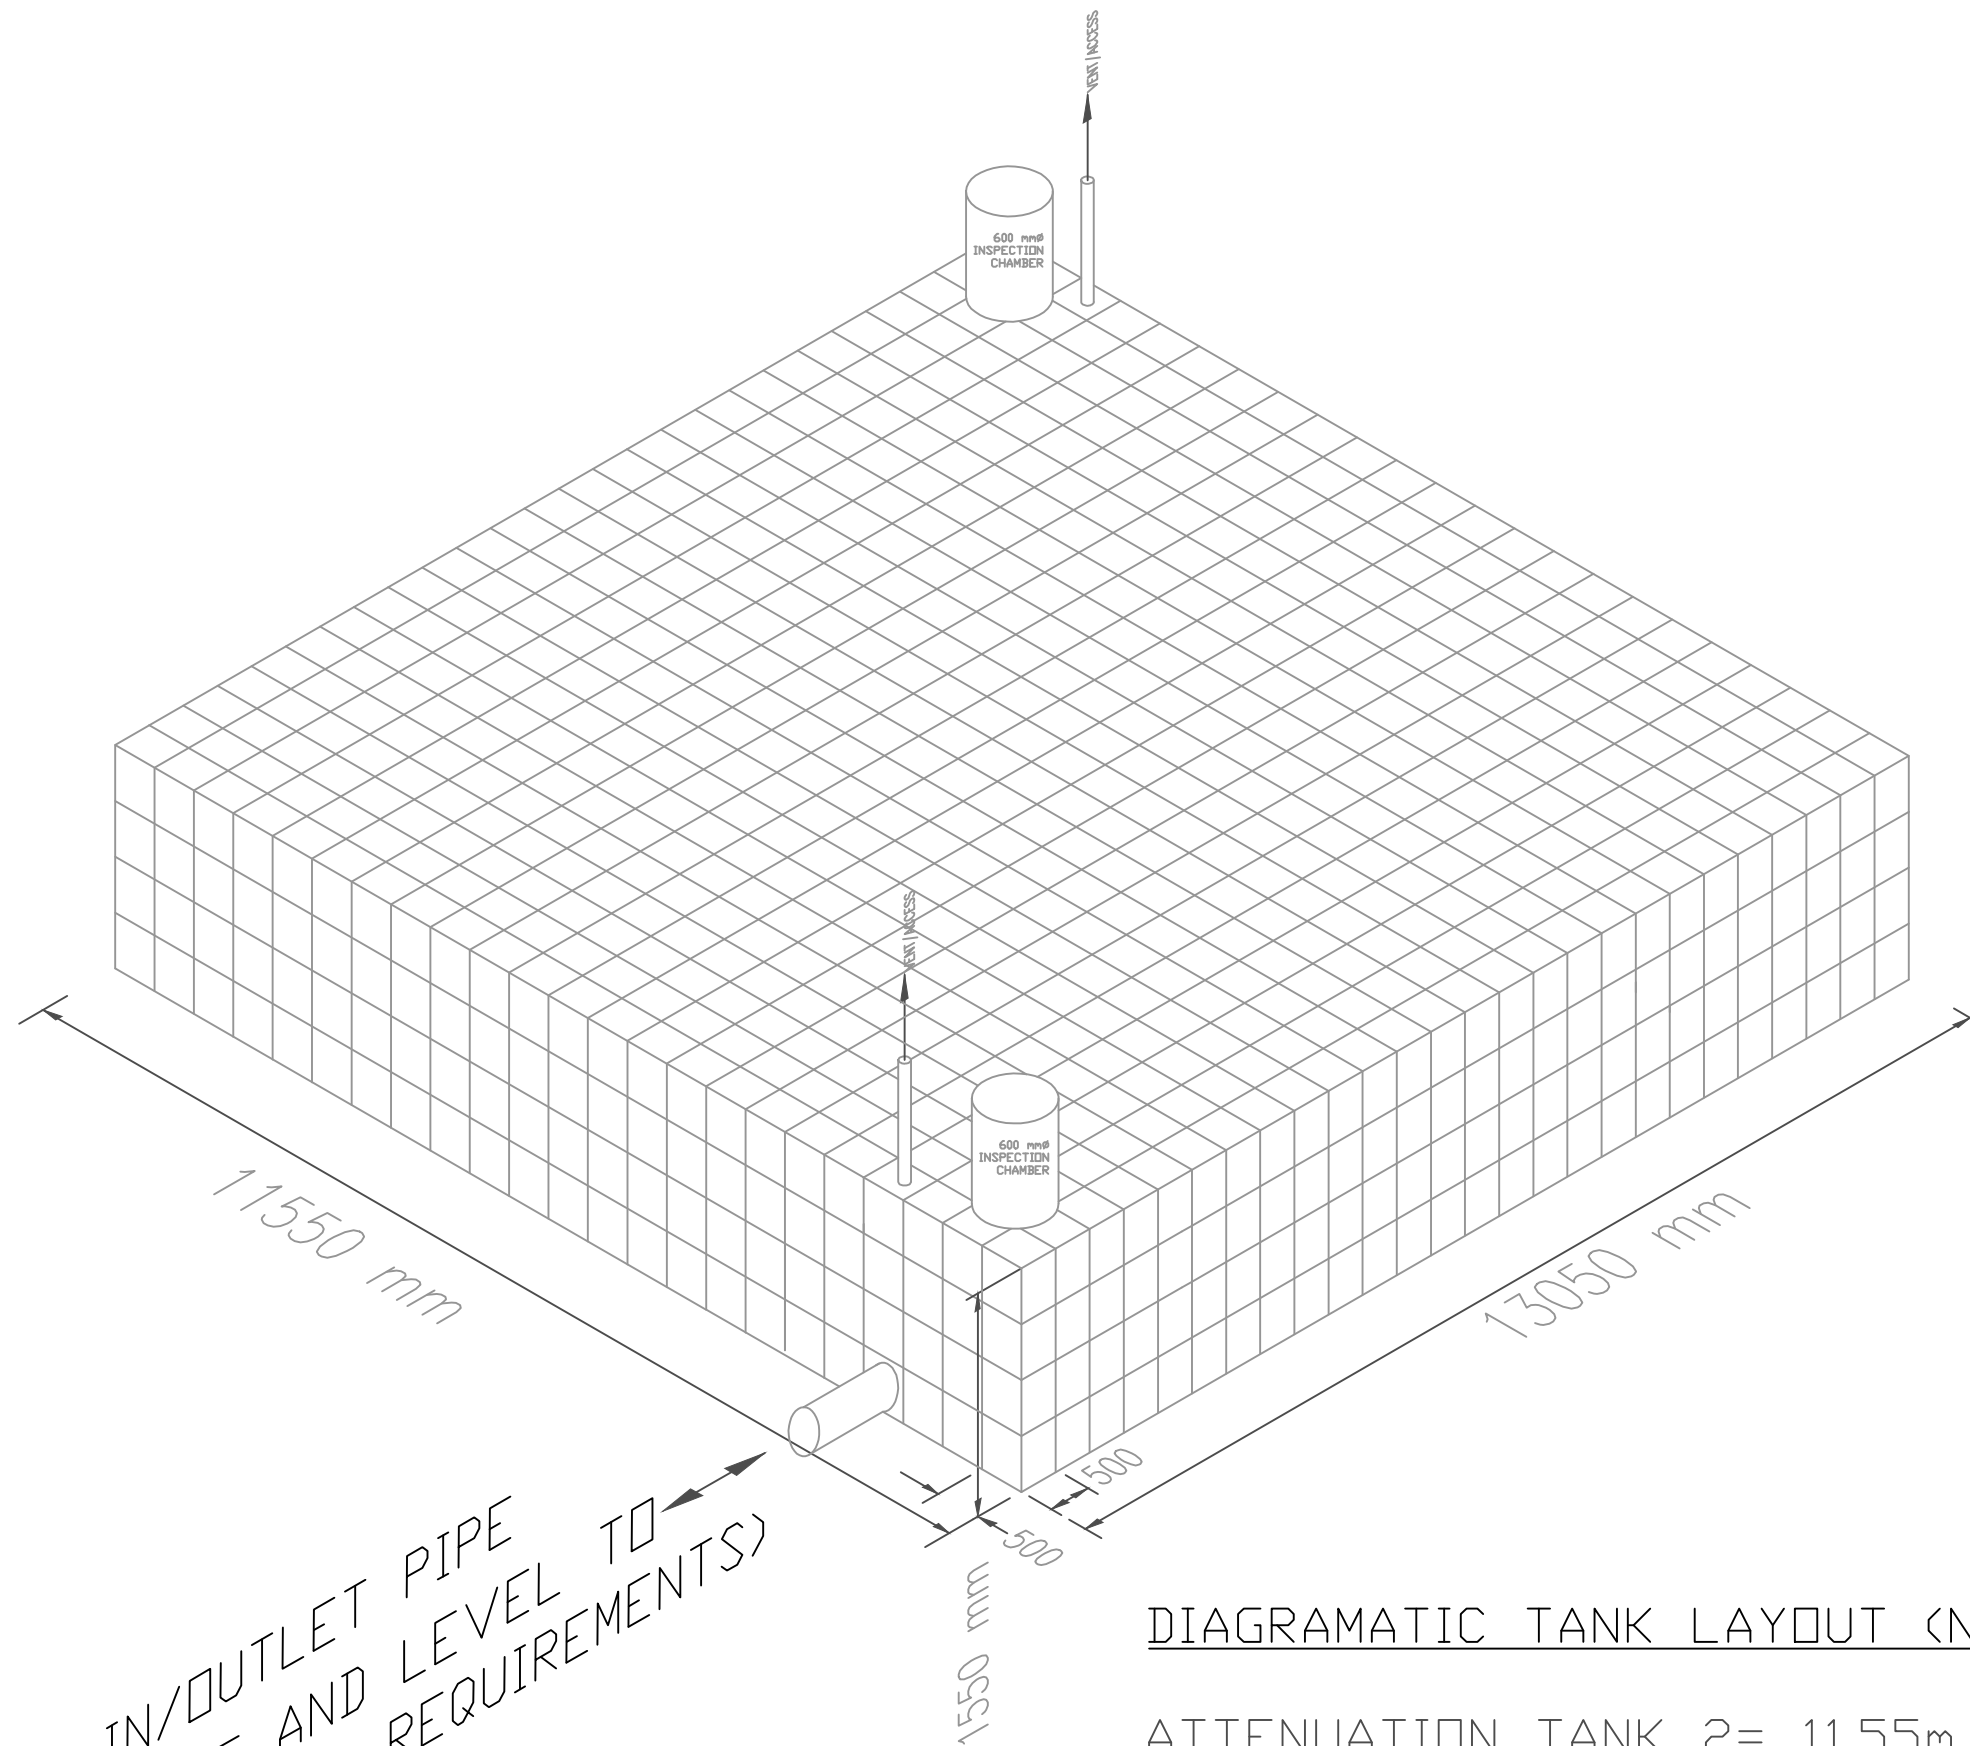

DIAGRAMATIC TANK LAYOUT (N.T.S.)

ATTENUATION TANK 2= 11.55m X 13.050m X 1.550m DEEP = 233.63m³ **GROSS/ 224.28m³ NETT**
(LEVELS TO ENGINEER REQUIREMENTS)

Notes :-

1. ALL STORAGE TANK DRAINAGE WORKS SHALL BE CARRIED OUT IN ACCORDANCE WITH THE SPECIFICATIONS, METHOD STATEMENTS AND RECOMMENDATIONS OF ENVIRONMENTAL SUSTAINABLE SOLUTIONS (ESS) LIMITED, ROCHDALE.
2. THE LOCATION, SIZE AND DEPTH OF ALL EXISTING DRAINS / SEWERS AND SERVICES SHALL BE ESTABLISHED BY THE CONTRACTOR PRIOR TO THE COMMENCEMENT OF WORKS ON SITE. ANY DISCREPANCIES FROM THE INFORMATION INDICATED ON THESE DRAWINGS SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
3. THE CONTRACTOR SHALL ALLOW FOR THE PROTECTION, TEMPORARY AND PERMANENT SUPPORT AND DIVERSION WORKS AS NECESSARY, TO ALL EXISTING SERVICES TO THE SATISFACTION OF THE PUBLIC UTILITIES.
4. THE CONTRACTOR SHALL ALLOW FOR DEALING WITH SURFACE WATER RUN-OFF INTO EXCAVATIONS AND FROM GROUNDWATER BY MEANS OF SUMPS, PUMPING AND DE-WATERING AS APPROPRIATE, IN ORDER TO KEEP THE EXCAVATION AS REASONABLY DRY AS POSSIBLE DURING THE CONSTRUCTION OF THE WORKS.
5. ALL LEVELS AND DIMENSIONS SHALL BE VERIFIED ON SITE PRIOR TO THE COMMENCEMENT OF ANY WORKS. ANY DISCREPANCIES SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE ENGINEER.
6. THE CONTRACTOR SHALL TAKE ALL NECESSARY SAFETY PRECAUTIONS IN LINE WITH CURRENT LEGISLATION WHEN WORKING IN / NEAR CONFINED SPACES, DEEP EXCAVATIONS AND MACHINERY.
7. THE CONTRACTOR SHALL TAKE ALL NECESSARY SAFETY TO PROTECT PEDESTRIANS AND VEHICLES FROM THE WORKING AREAS.
8. TO PROTECT THE ESS VERSAVOID MODULAR ATTENUATION & FILTRATION / STORAGE TANK FROM CONSTRUCTION SITE DEBRIS, THE CONTRACTOR SHALL ENSURE THAT STOPPERS ARE SECURELY PLACED IN ALL CONNECTIONS IMMEDIATELY UPSTREAM OF THE TANK UNITS, ONLY TO BE REMOVED ONCE THE FINAL CLEANING OF THE ROADS / DRAINAGE HAS BEEN COMPLETED.
9. UPON COMPLETION OF THE WORKS THE CONTRACTOR SHALL CLEAN ALL DRAINAGE BY JETTING, REMOVING ALL DEBRIS FROM SITE, NO DEBRIS SHALL BE PERMITTED TO ENTER THE TANK STORAGE SYSTEM.
10. NUMBER OF VENT UNITS DEPENDS ON THE SIZE OF THE TANK (REFER VENT DRAWING)
11. REFER SEQUENCE OF WORK DOCUMENT FOR DETAILED INSTALLATION METHODOLOGY (CONTACT ENVIRONMENTAL SUSTAINABLE SOLUTIONS (ESS) LIMITED)

R1	26/07/18	TANK DIMENSIONS HAVE BEEN CHANGED TO SUIT ENGINEERS REQUIREMENT
R2	12/10/18	PIPE/ACCESS CHAMBER LOCATION CHANGED.

Notes :- All the Dimensions are in Millimeters



ENVIRONMENTAL SUSTAINABLE SOLUTIONS (ESS) LIMITED
SOLUTIONS HOUSE, DANE ST.
ROCHDALE
OL11 4EZ
TEL: 01706 374416
FAX 01706 376785
EMAIL: TECHNICAL@Y-ESS.COM

PROJECT
BARTONS ROAD HAVANT
ATTENUATION TANK 2- LAYOUT

TITLE
ATTENUATION STORAGE TANK DETAILS USING VERSAVOID MODULAR UNITS

Scale	Drawn	Checked
NTS	VH	PD
Date	Drawing No.	Revision
20/07/2018	AQST - 4.1	R2