
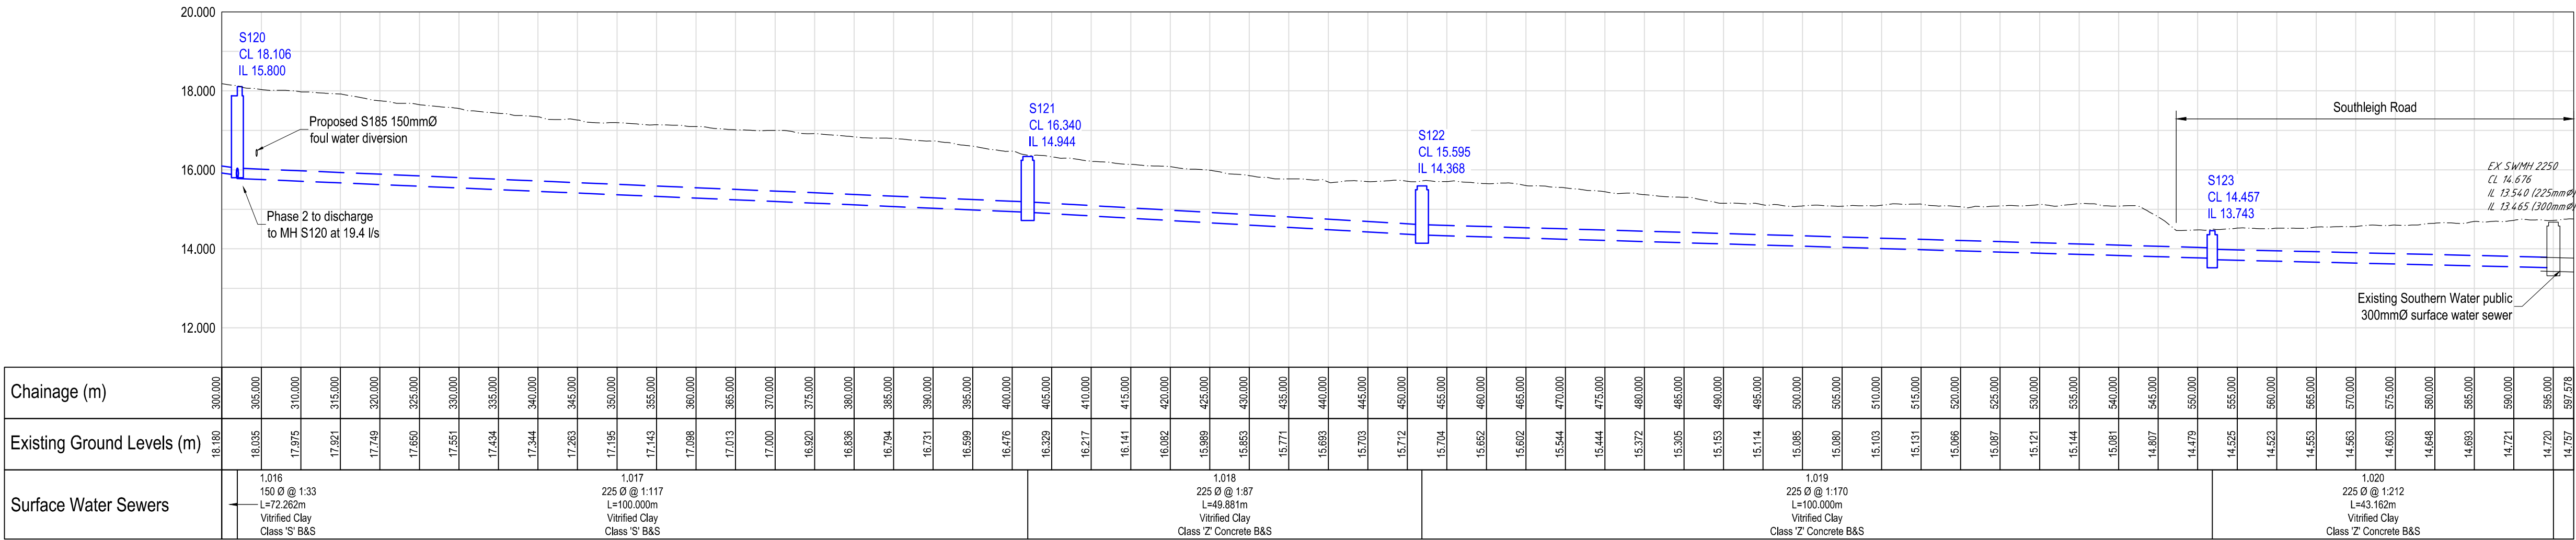


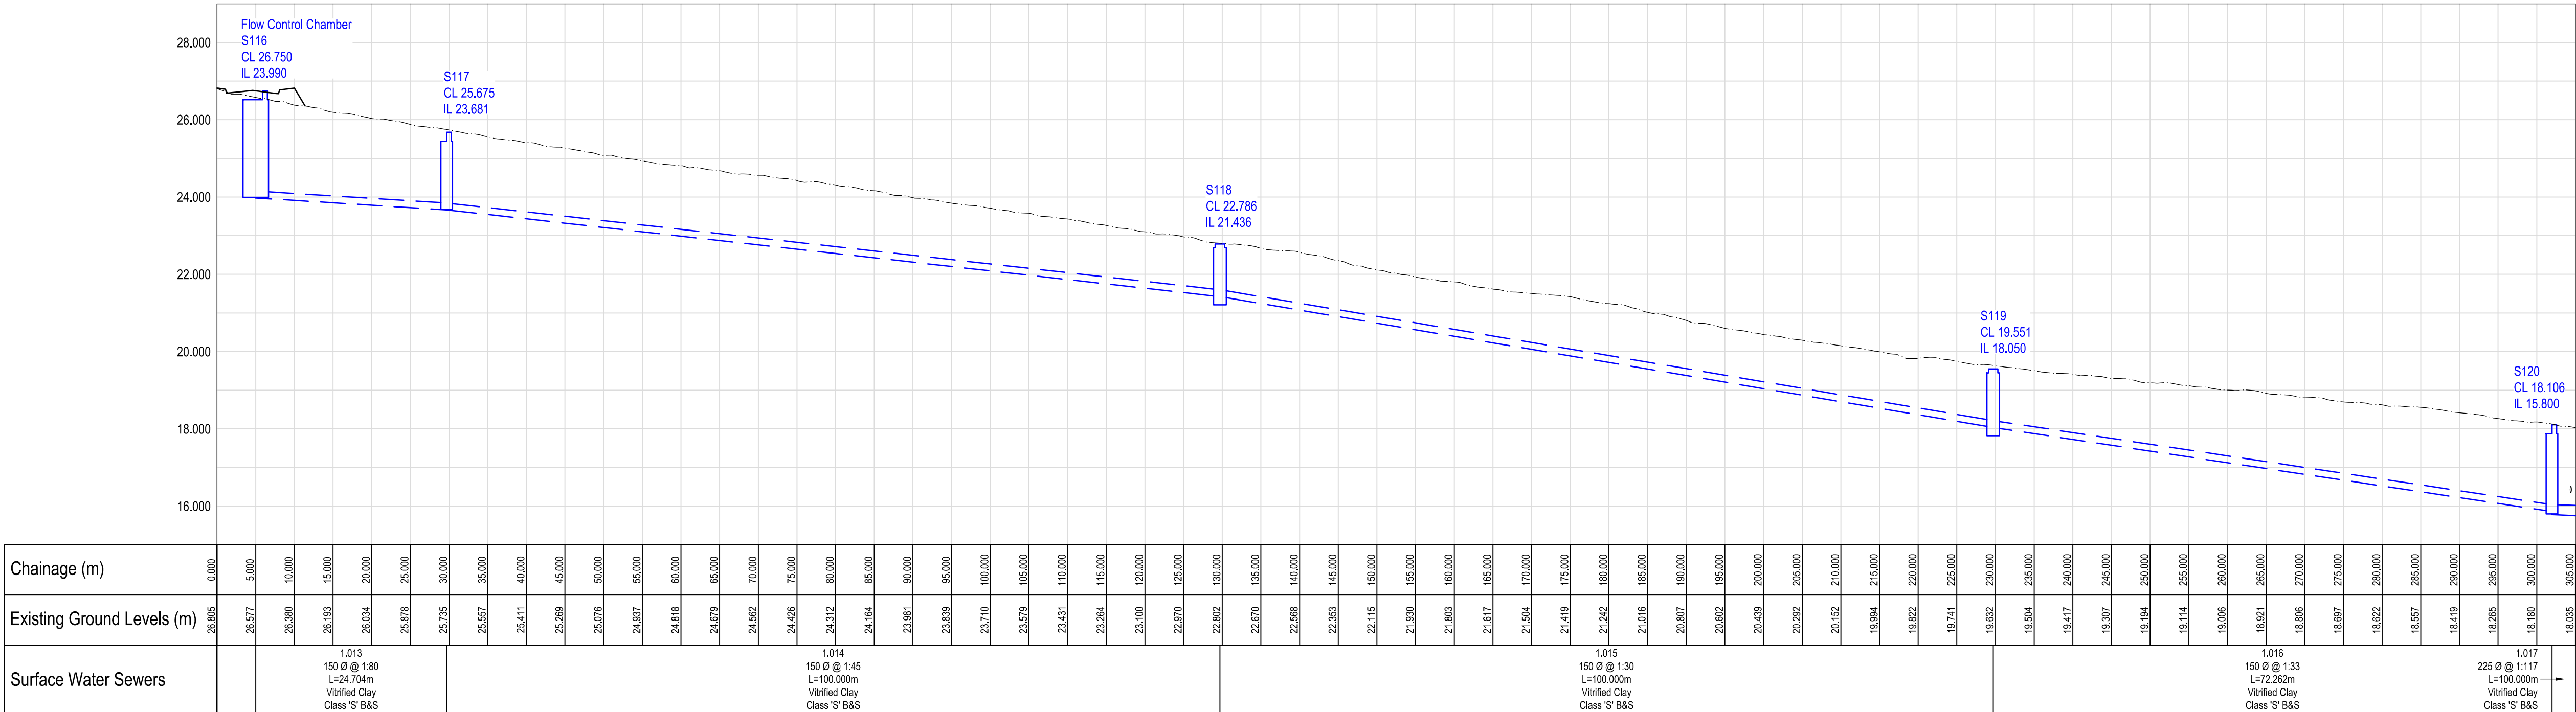

Existing Utilities

The contractor shall refer to the existing and proposed services information, provided by Bellway Homes (Wessex).

It is the Contractor's responsibility to liaise with all relevant services companies to ensure that all existing services are accurately located and adequately protected during construction.

It is the Contractor's responsibility to liaise with the Developer and all relevant services companies to ensure that all new and diverted services are accurately located and adequately protected during construction.

All works to existing services to be undertaken as required by the Developer. Refer to Developer design.

All adoptable drainage and highway works to be installed in accordance with;

- S104 & S185 Sewers - Sewers for Adoption 6th edition, including all applicable local Southern Water addendums
- S278 and S38 Highways - Hampshire County Council Specification and Standard Details.

- Notes:-
- Where this drawing has been issued in electronic .dwg format it has been done so in good faith. jnp group do not take any responsibility for any inaccuracies in the electronic data, which should be checked against the paper (or .pdf) drawing issue. Any apparent discrepancies should be immediately reported to jnp group. The electronic .dwg file should not be assumed to be to scale and should not be used for 'overlying', setting out or checking of any third party information. All dimensions should be taken from the paper (or .pdf) version of the drawing. Electronic drawings may contain third party information, jnp group take no responsibility for this information, which should be checked against the originators paper drawing(s).
 - All working dimensions to be checked on site.
 - Do not scale.
 - Any discrepancies between drawings of different scales, and between drawings and specification where appropriate to be notified to The Engineer for decision.
 - Copyright reserved. This drawing may only be used for The Client and location specified in the title block. It may not be copied or disclosed to any third party without the prior written consent of jnp group.
 - This drawing should only be used for construction if the drawing status is "Construction". jnp group take no responsibility for construction works undertaken to drawings which are not marked with this status.

Health and Safety Note:
The details on this drawing have been prepared on the assumption that a competent contractor will be carrying out the works. If the contractor(s) considers that there is insufficient Health and Safety information on this drawing, this should immediately be brought to the attention of the designer.

Legend:

- Proposed Finished Road Level
- Existing Ground Level
- Proposed S185 Foul Water Sewer Diversion
- Proposed S104 Surface Water Sewer

B	07.06.19	Sewer outfall route cover levels amended to match latest topo survey.	KM	KT
A	11.03.19	Pipe branch 1 references updated.	KM	KT
Rev.	Date	Amendment	By	Chk.
Status				
Construction				



john newton & partners
jnp group
Consulting Engineers
www.jnpgroup.co.uk
Chesham • Brighouse • Hartlepool • Leamington Spa • Sheffield
Tel: 01926 889955 E-mail: leamingtonspa@jnpgroup.co.uk

Client	Bellway Homes		
Job	Bartons Road Havant, Hampshire		
Title	S104 Surface Water Outfall Route Longitudinal Section		
Scale	As shown	@ A1	Date January 2019
Drawn by	KM	Checked by	KT
		Approved by	KT
Drawing No.	C85850-D125		
Rev.	B		