


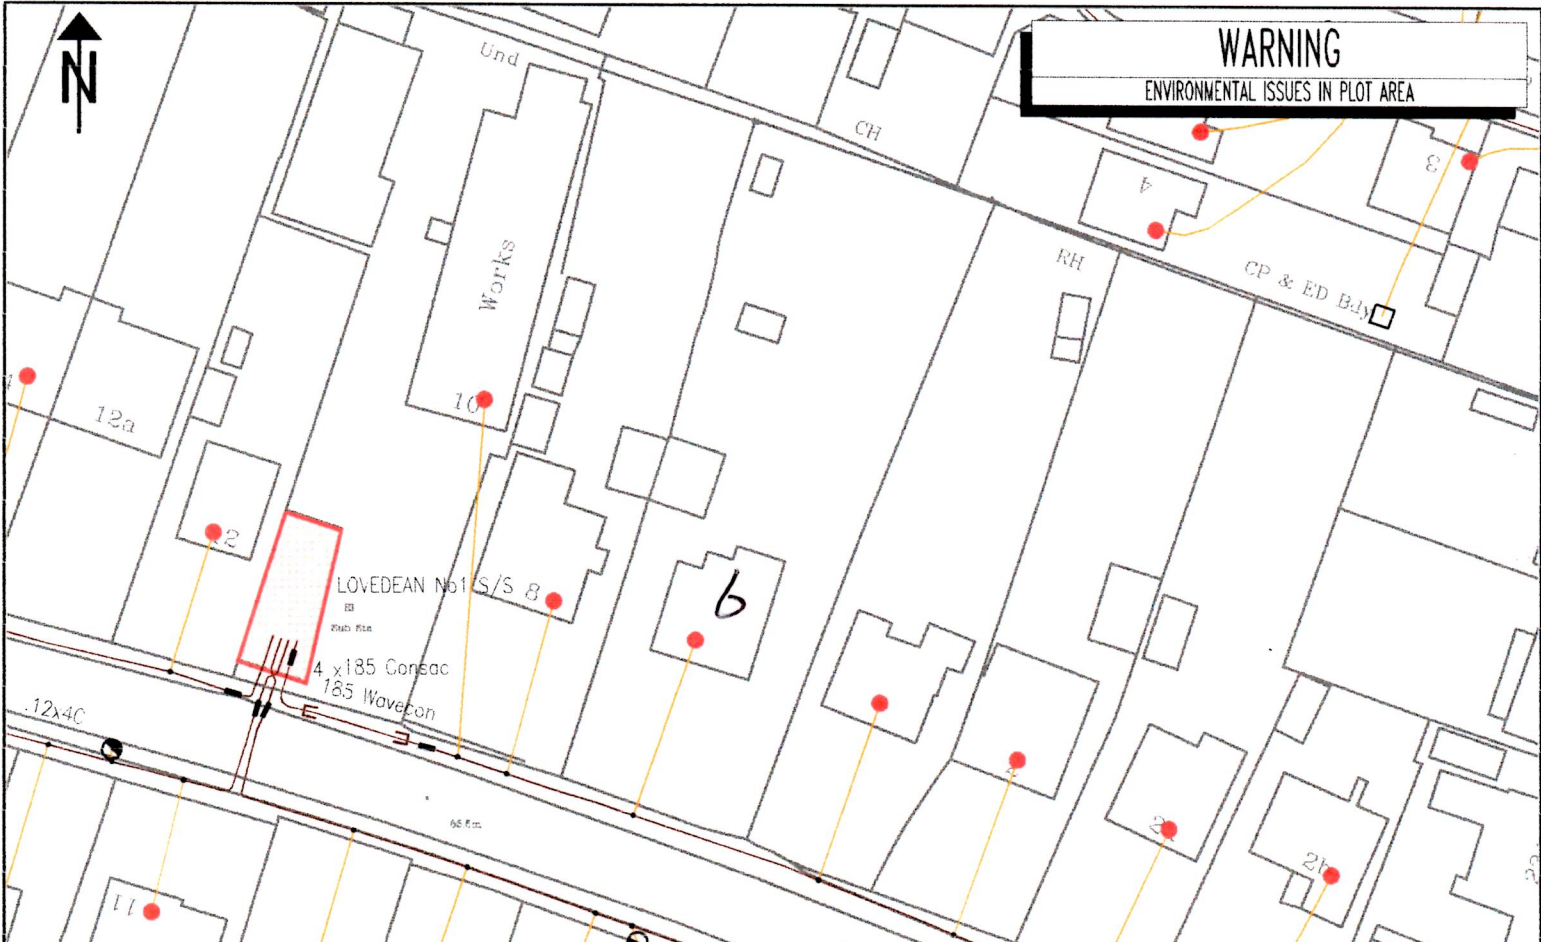

WARNING
ENVIRONMENTAL ISSUES IN PLOT AREA

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAD			WARNING			BASED UPON THE INFORMATION SUPPLIED AND WITH THE SANCTION OF THE CONTROLLER OF THE STATUTORY OFFICE, UNDER COMPULSORY EXEMPTIONS			 Scottish & Southern Electricity Networks			L.V. MAINS AND SERVICES RECORD		
services l.v. h.v. e.h.v.									Grid Ref: SU69401195					
FOOTPATH 0.40m 0.45m 0.60m 0.75m									Scale: 1:338					
ROAD CROSSING 0.60m 0.63m 0.75m 0.90m									Date: 07/09/2017					
l.v./services l.v. e.h.v.			There may have been subsequent alterations to the surface levels. Refer to the original plan for details of any subsequent alterations and depth of cables. (If 12) 47 Borehole (see the 'Und' and 'CH' labels) - including details from the 'Und' and 'CH' labels - should be consulted before commencing excavation work. (Available from the S&S)			PORTSMOUTH 023 - 6262 - 4300								
- up to 1000V - over 1000V to 11,000V - 22,000V to 132,000V			NOTES: WARNING: IS THIS DOCUMENT OF CONFIDENTIAL NATURE FOR HEALTH AND SAFETY PURPOSES ONLY AND SHOULD BE KEPT SECURE. (Available from the S&S)			UNCONTROLLED COPY Subject to Revision Master held at								