


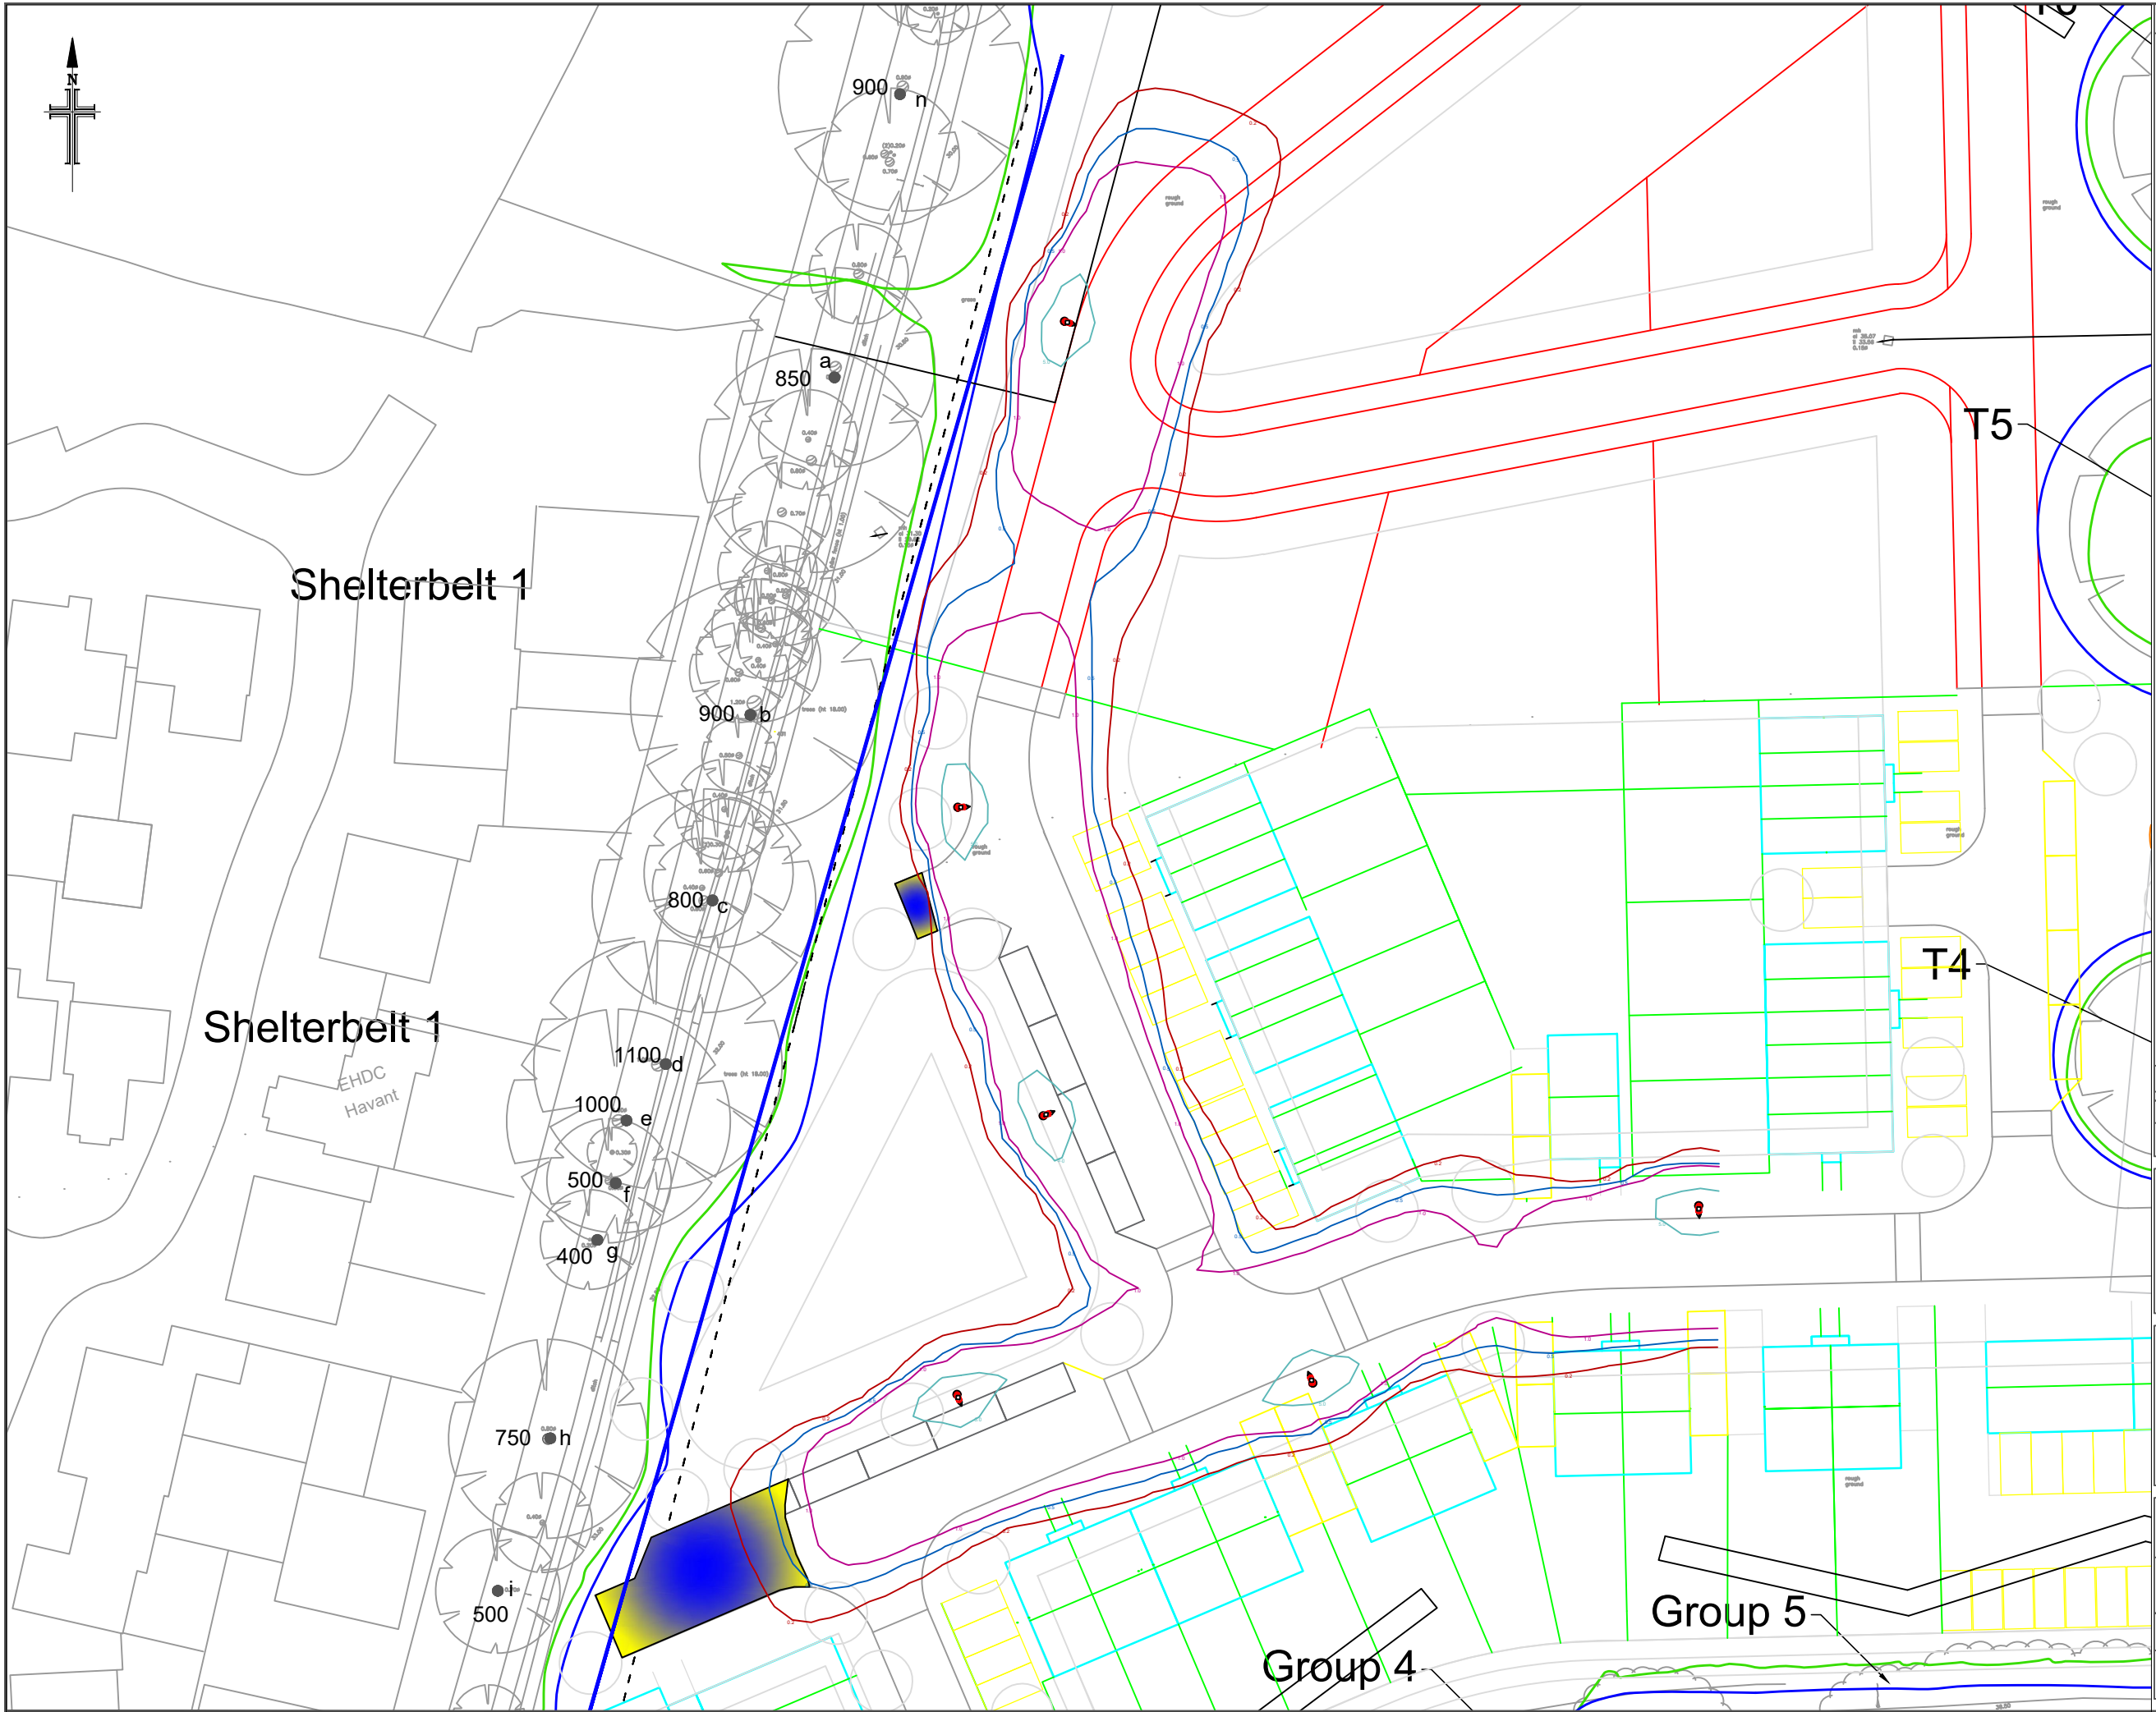

Notes:

- Line detailing vertical grid - refer to WLC208 Camp Fields Lighting Calculation for levels.
- Area does not conform to the proposed P5 lighting class. The area is deemed as minimal risk based on potential footfall / traffic. Illuminating these areas would cause light trespass on proposed dark corridor.
- Proposed 5m tubular steel column with post top mounted Urbis Axia 2.1 8 LED 690mA 1.37klm output. Optic 5167 back louvres 3000K Warm White lantern mounted at 0° tilt.

Contour Lines

- 0.2 lux
- 0.5 lux
- 1 lux
- 5 lux
- n/a 10 lux

REV:	DESCRIPTION:	BY:	DATE:
STATUS: NOT FOR CONSTRUCTION			
Williams Lighting Consultants Ltd. info@wclighting.co.uk www.wclighting.co.uk			
CLIENT: CHIDDEN FARMS CHIDDEN FARM HOUSE HAMBLEDON, WATERLOOVILLE PO7 4TD			
SITE: CAMP FIELDS HAVANT			
TITLE: LIGHTING DETAIL IMPACT ON DARK CORRIDOR			
SCALE AT A3: 1:500	DATE: 09/04/19	DRAWN: PW	CHECKED: LD
PROJECT NO: WLC208	DRAWING NO: WLC208-1300-001	REVISION: -	