



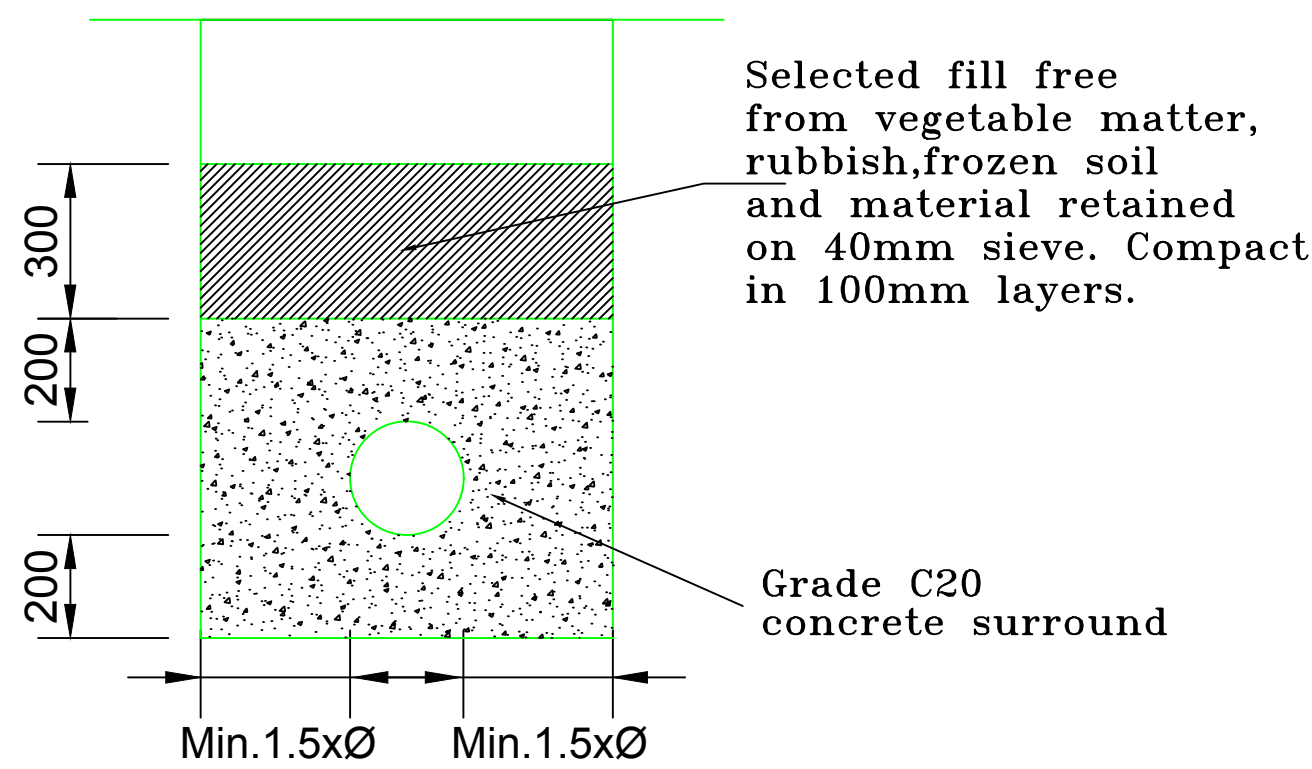


BEDDING FOR FLEXIBLE PIPES LESS THAN 900mm COVER UNDER ROADS

Scale 1:20

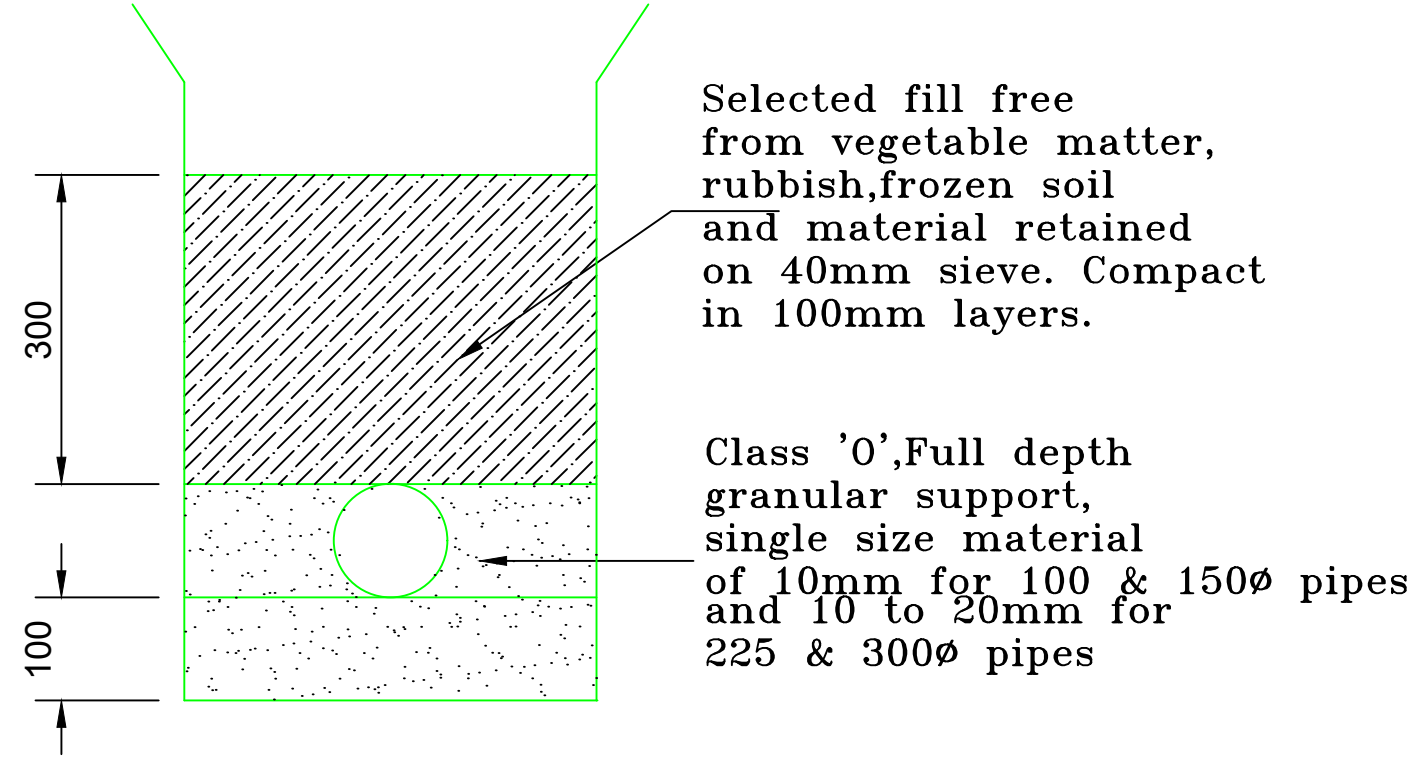


BEDDING FOR FLEXIBLE PIPES UNDER ROADS 900 to 1200mm DEEP

Scale 1:10

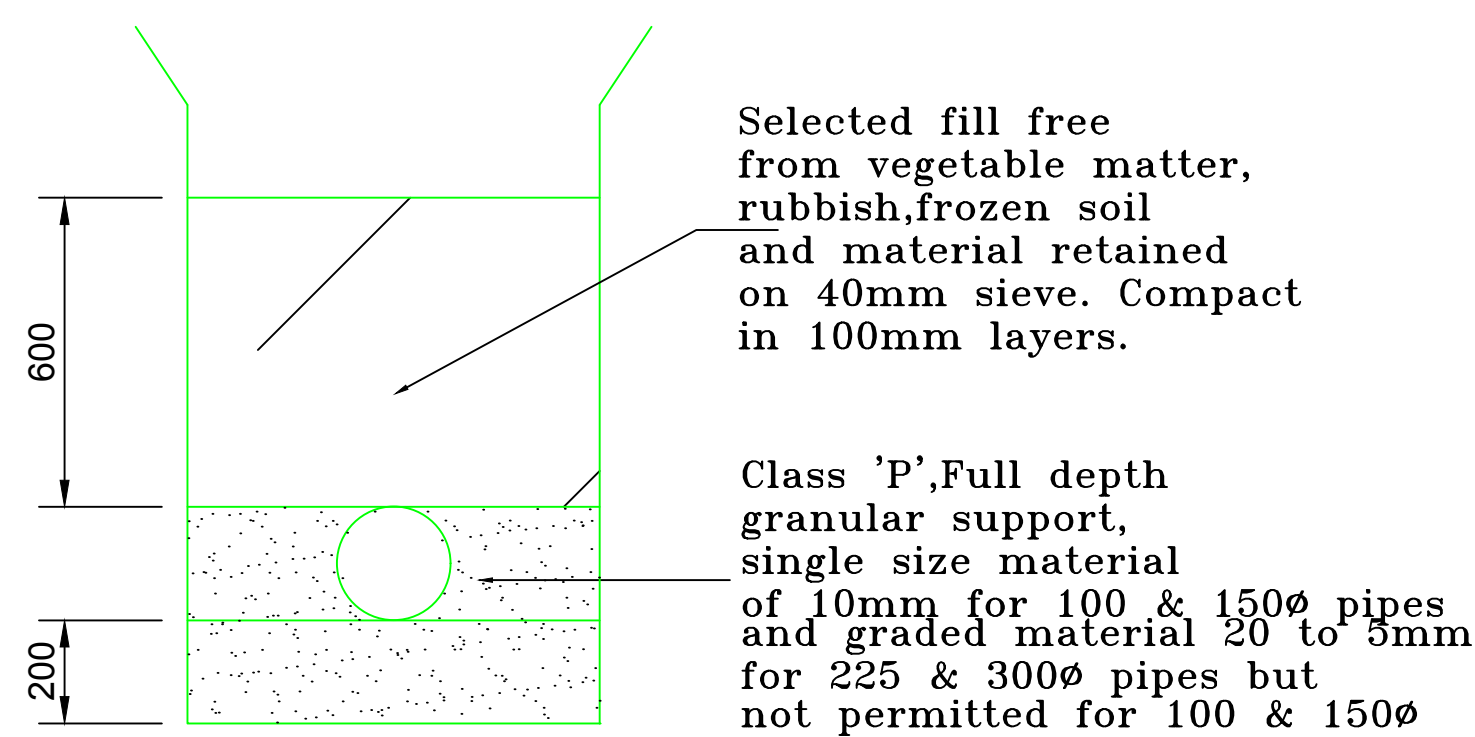


BEDDING FOR OTHER FLEXIBLE PIPES

Scale 1:10

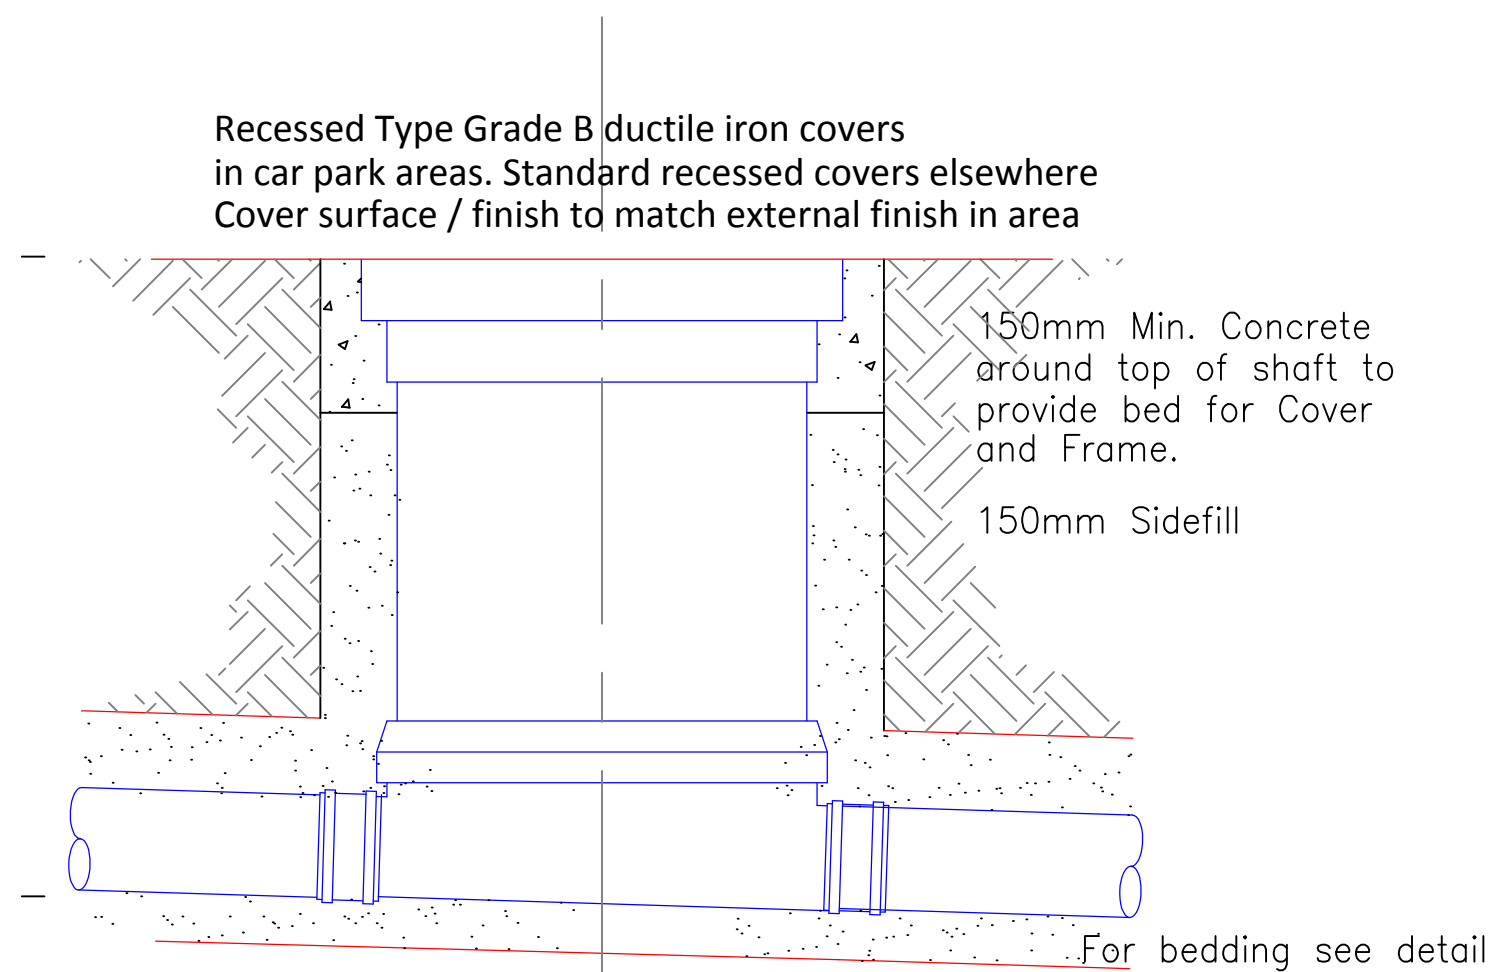

450mmØ INSPECTION CHAMBER TYPICAL INSTALLATION

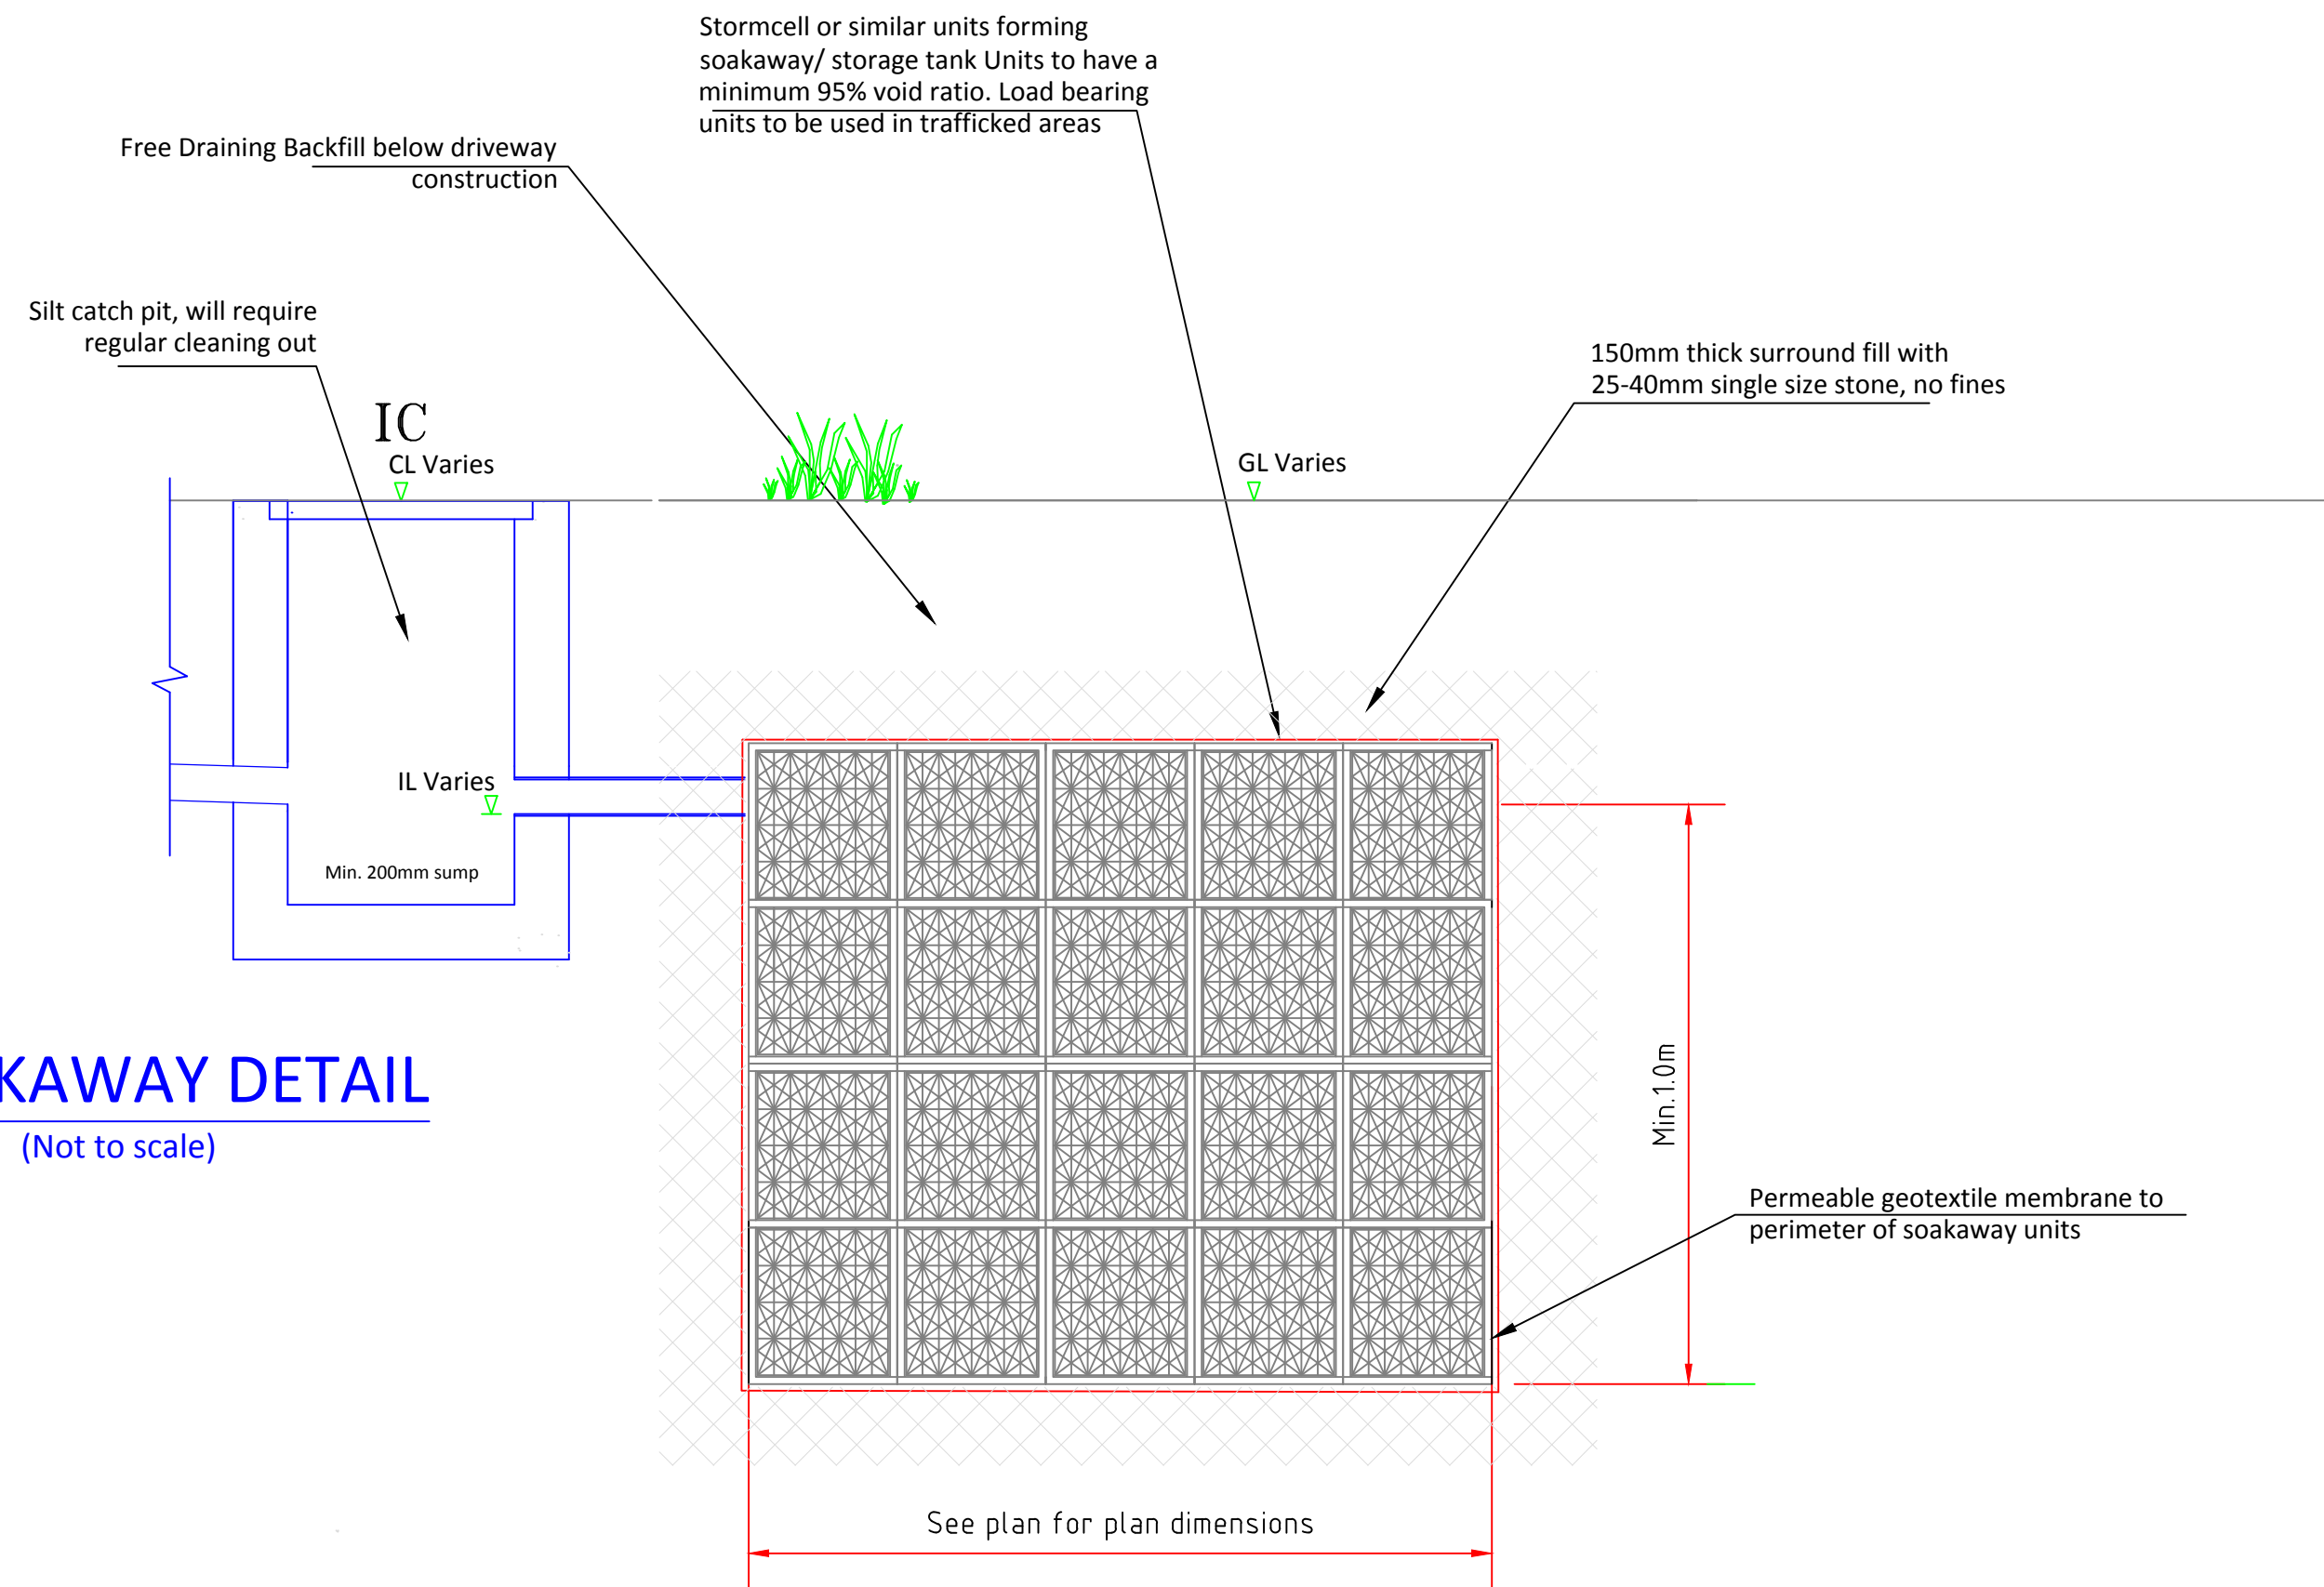

SOAKAWAY DETAIL

(Not to scale)

- This drawing is to be read in conjunction with all relevant Engineers and Architects drawings, and the Specification.
- All dimensions are in millimetres unless noted otherwise. All levels are in Metres Above an arbitrary datum and not to Ordnance Datum.
- In accordance with CDM 2015 the Contractor is to:
 - Notify HSE of works.
 - Comply with the requirements of Health and Safety Plan (if applicable)
 - Provide risk assessments and method statements for all potential hazards relevant to this project.
- The main contractor shall be responsible for the setting out and accuracy of all dimensions. He shall satisfy himself that the information given is correct and any discrepancies should be noted to the Engineer immediately.
- DO NOT SCALE. If discrepancy or query arises on dimensions consult Engineer.
- The Contractor is responsible for specifying product and codes and ordering of drainage materials.
- All drainage to be installed to BS5955 Pt6 and in strict accordance with the manufacturers instructions.
- All PVCu drainage products to conform to BS EN1401 & Kite mark certified in accordance with specification.
- All drainage pipes on this drwg to be 100mmØ unless shown otherwise. Min. falls 1/80 for foul and 1/100 for storm drainage.
- Cover grades are in accordance with BS497 Pt 1
Cover Grades :- D400 – carriageways.
B125 – carriageways for slow traffic.
A15 – inaccessible to vehicles
- Sewer runs and manholes to be adopted are to be in accordance with Sewers for Adoption, 5th Edition.
- Any drainage laid less than 600mm below FGL to be covered with minimum 150mm Gen 3 grade concrete to half diameter.
- No foul drainage sewer connection works to be undertaken until permission to discharge has been granted by Southern Water. Permissions to be obtained by Contractor.
- Soakaways to be a minimum of 5.0m from existing and new buildings.
- Provide 100x100 PCC lintel max span 650mm where svp exit the building.
- ACO channels installed and bedded to manufacturers requirements.

Title:

PROPOSED FOUL AND SURFACE DRAINAGE DETAILS + SOAKAWAY

Job No: 19041

Job: NEW DEVELOPMENT, 2-4, ORCHARD RD, HAVANT

Date: MARCH '19

Drawn: AD

Checked: BPW

Scale: N.T.S

Drg No: 19041/501

Status: FOR APPROVAL

Rev - P