




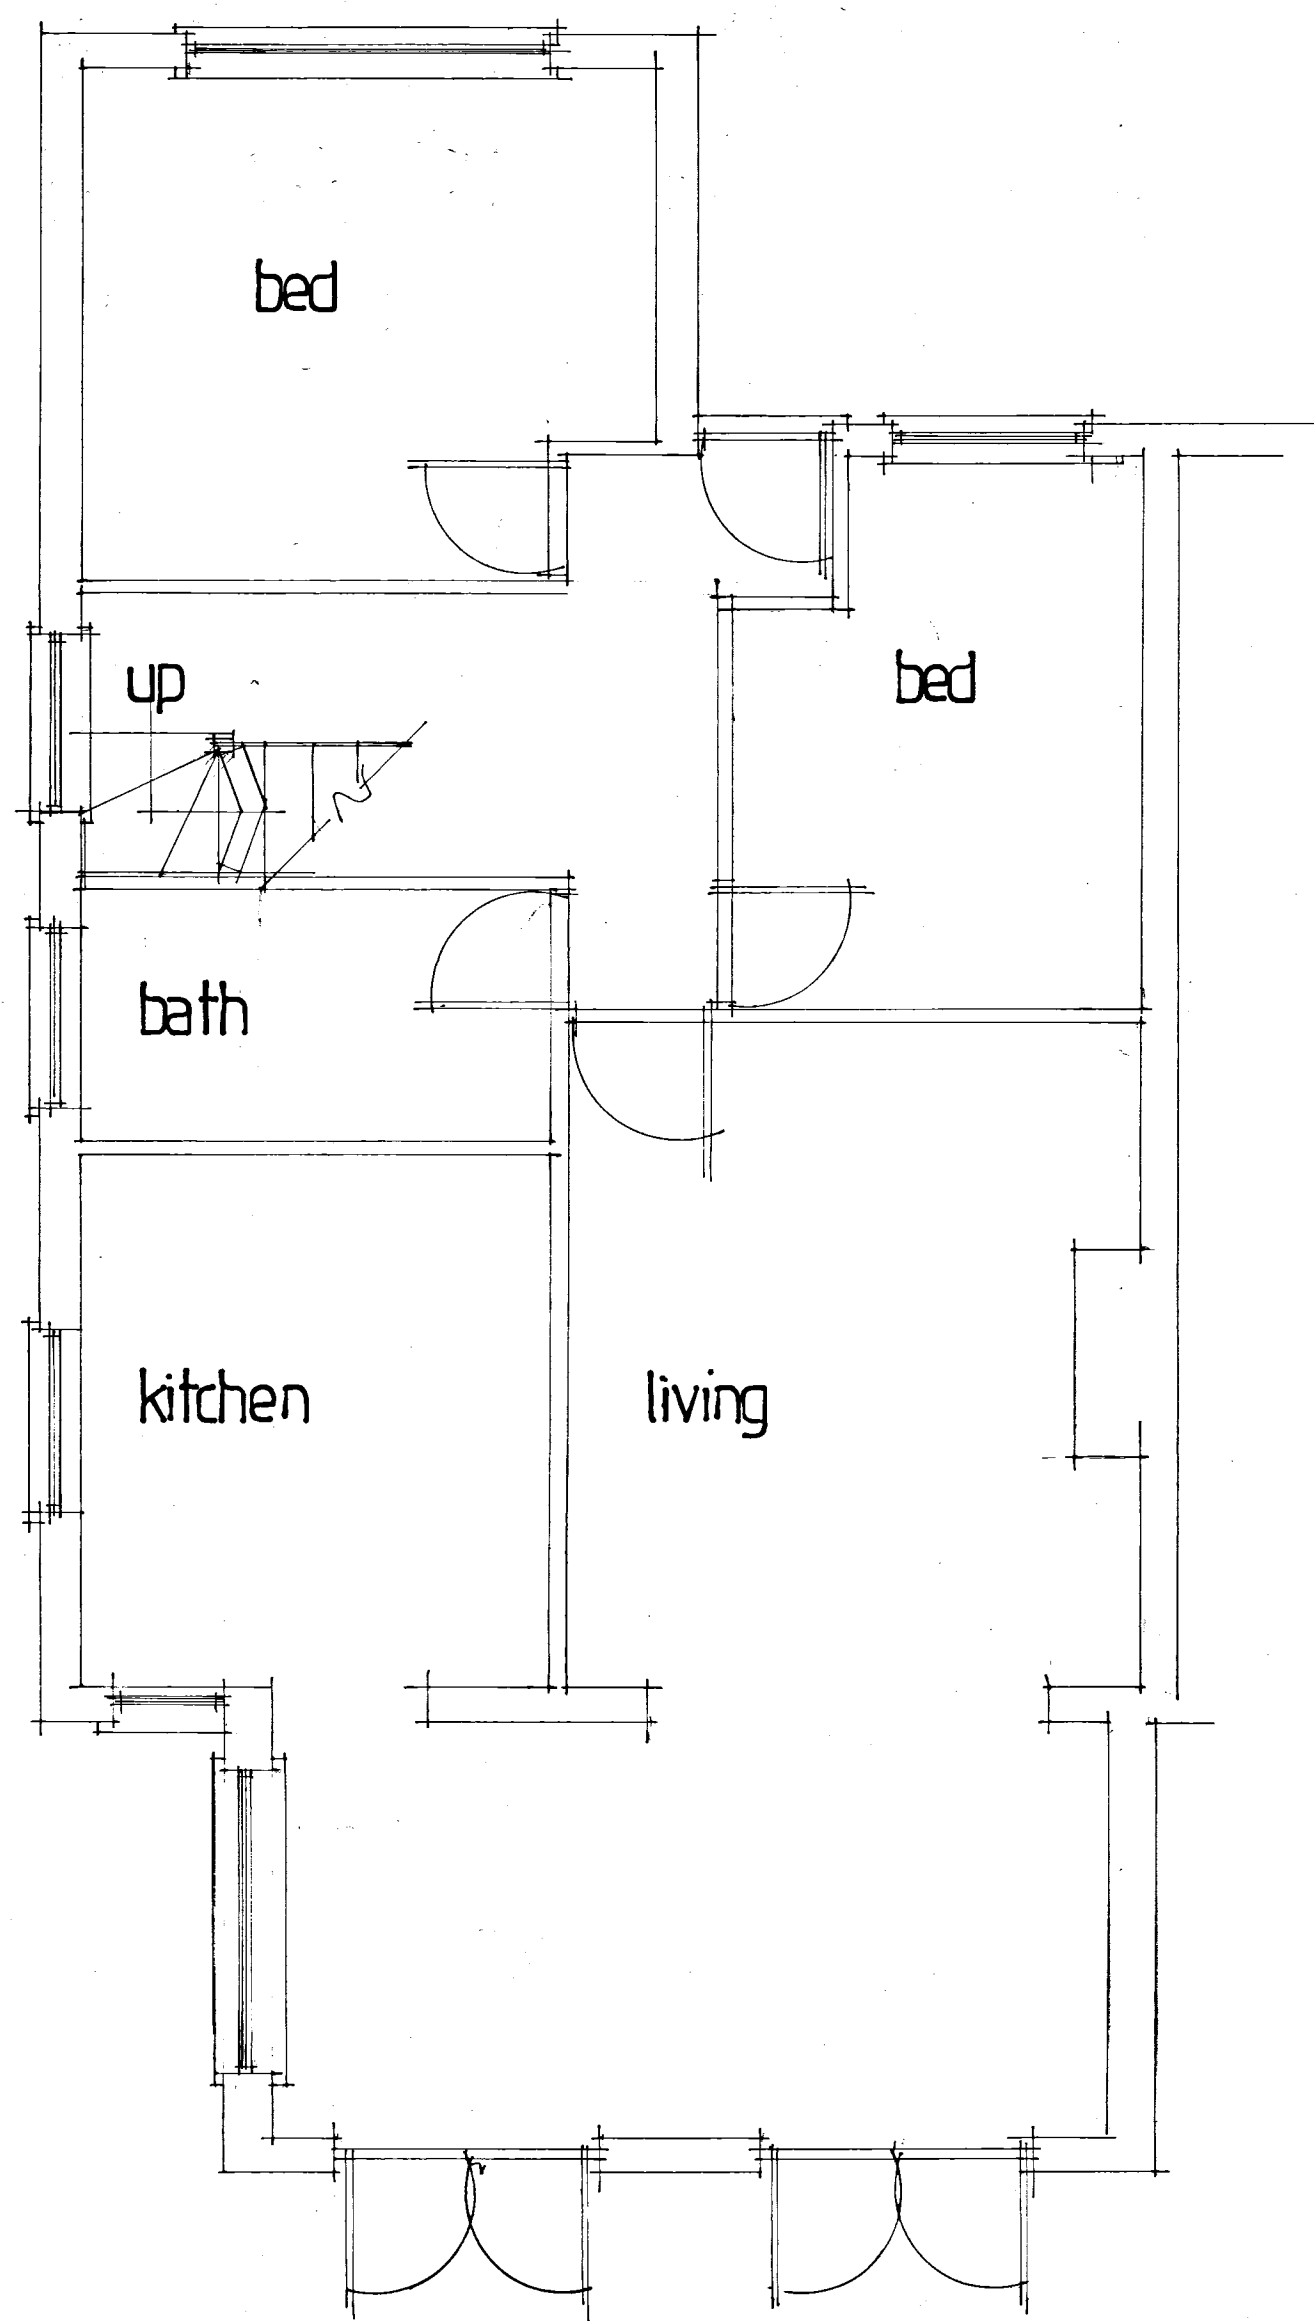


ground floor

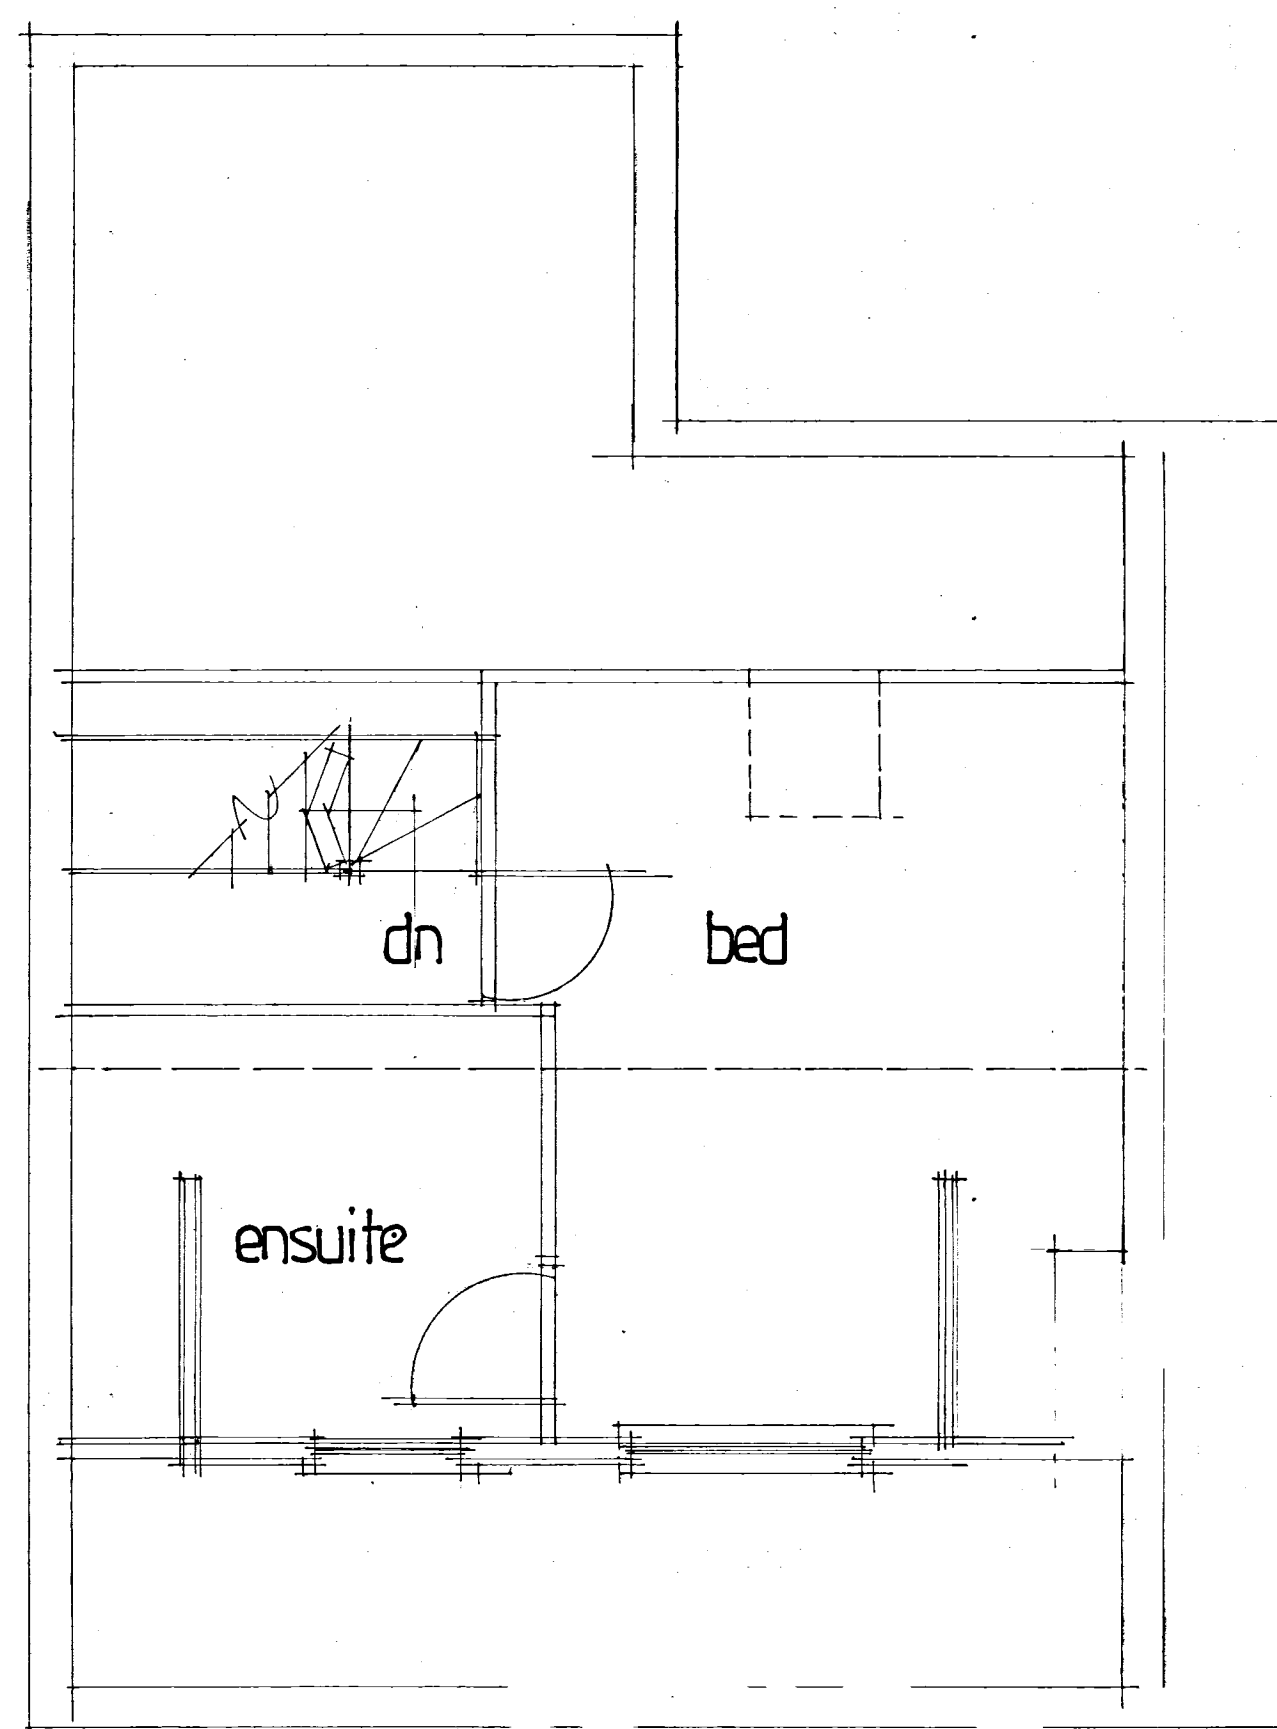


existing first floor

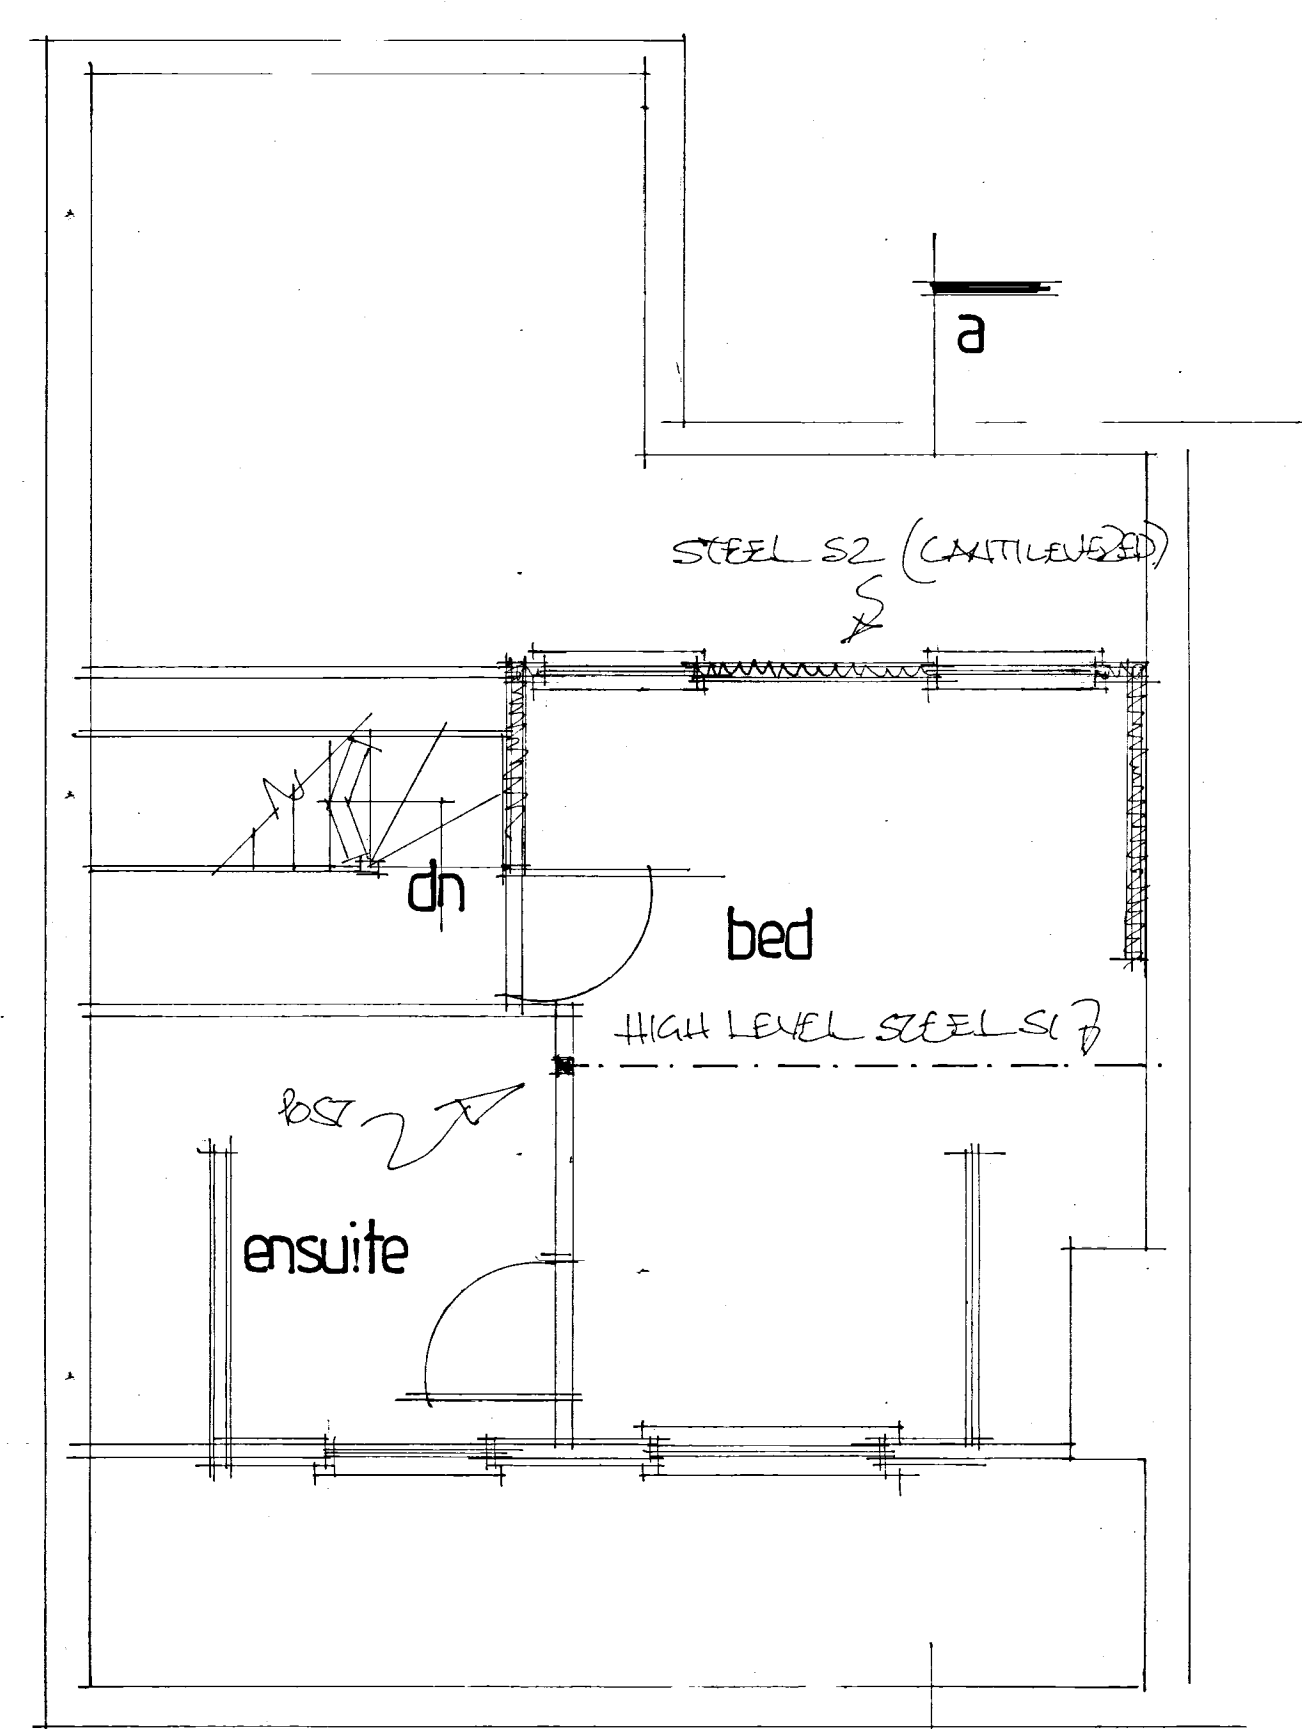


proposed first floor

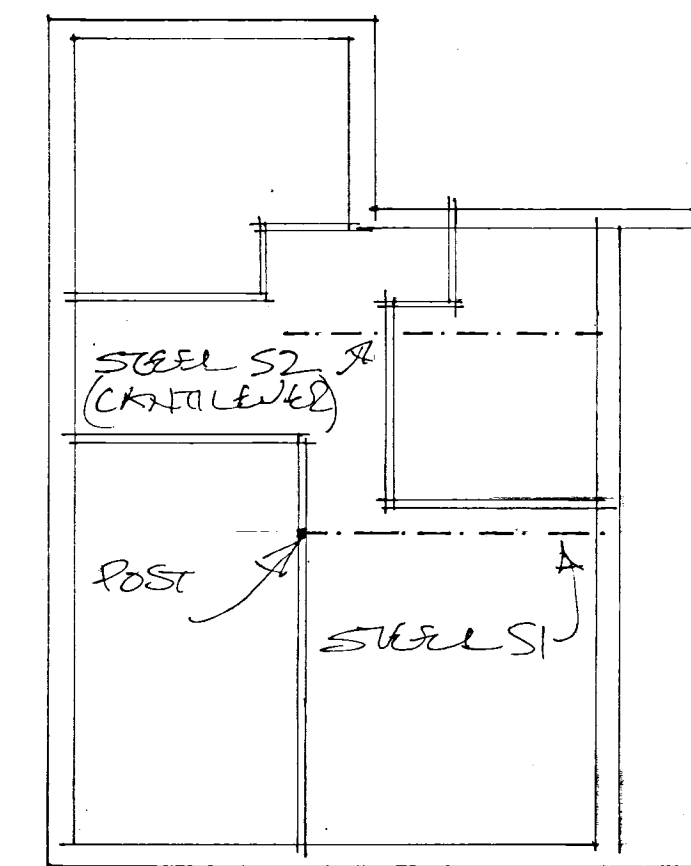


structural layout nts

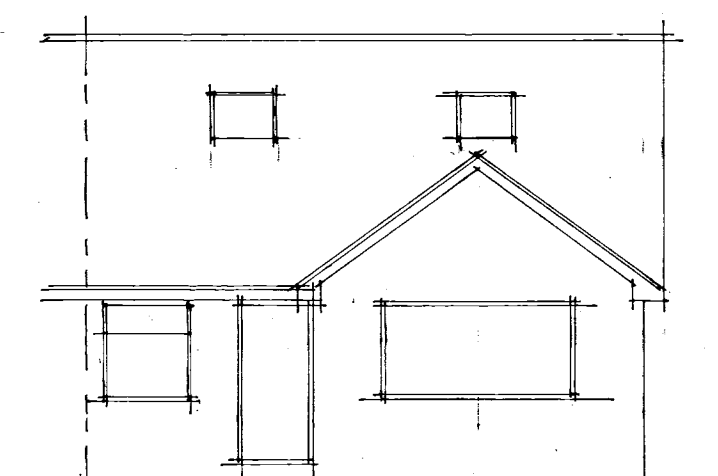


existing front

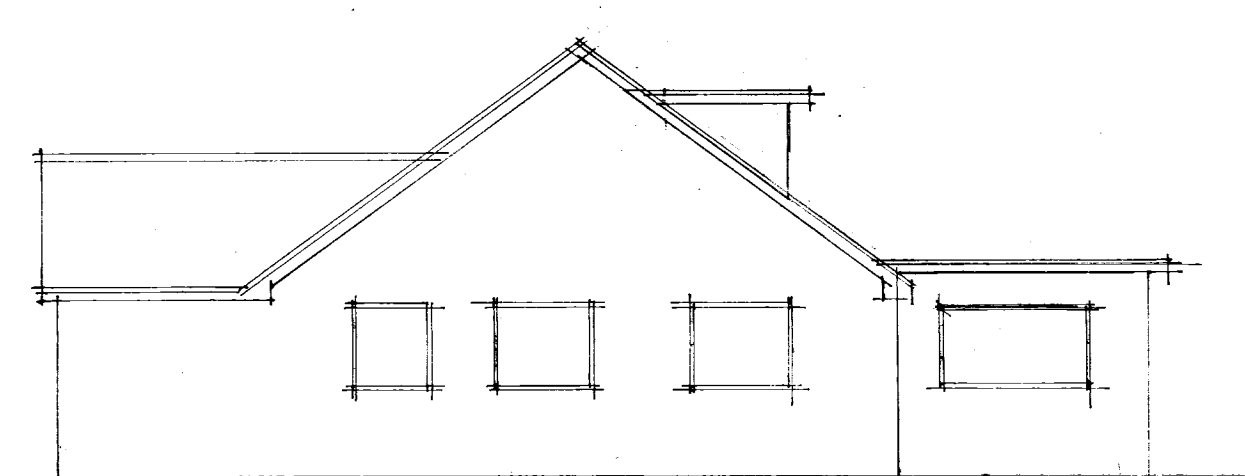


existing side

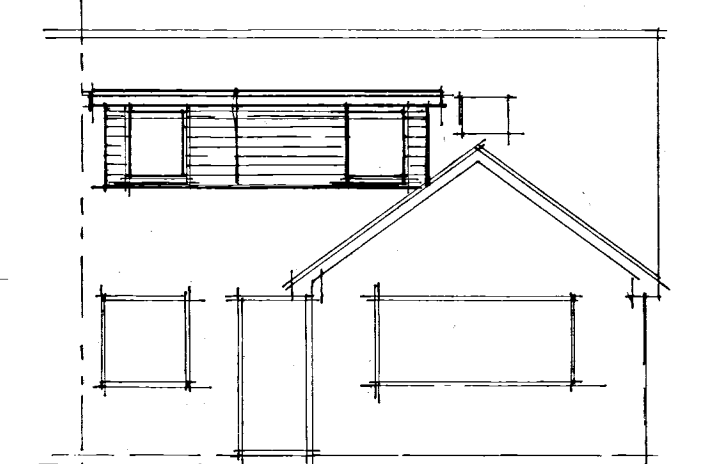

proposed front

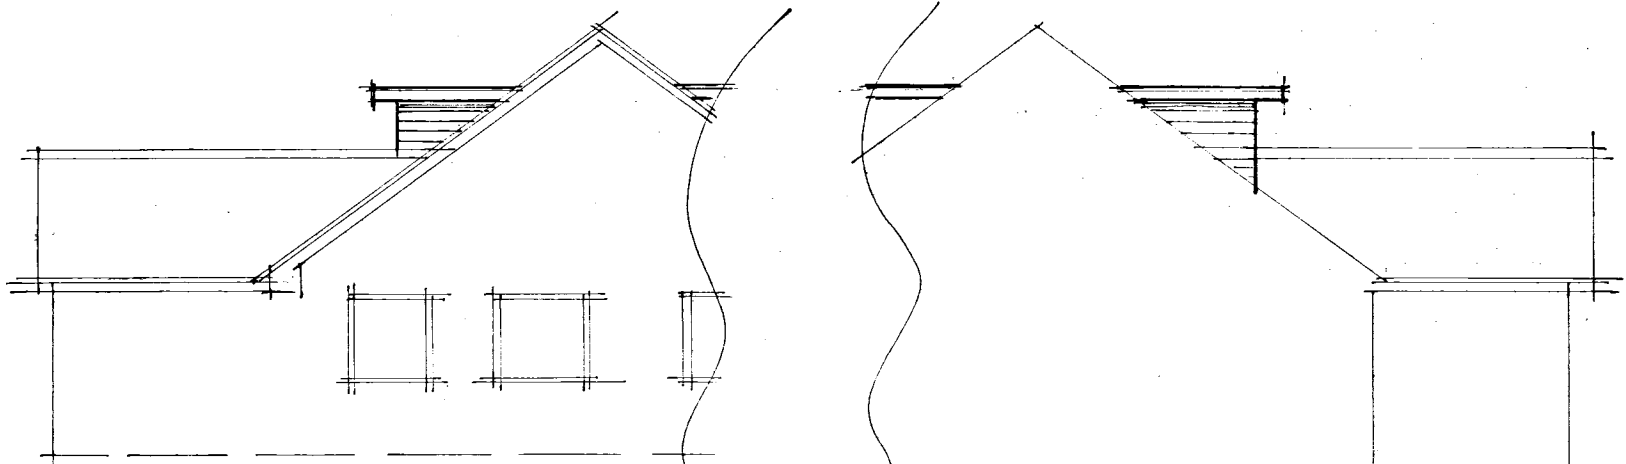

proposed sides

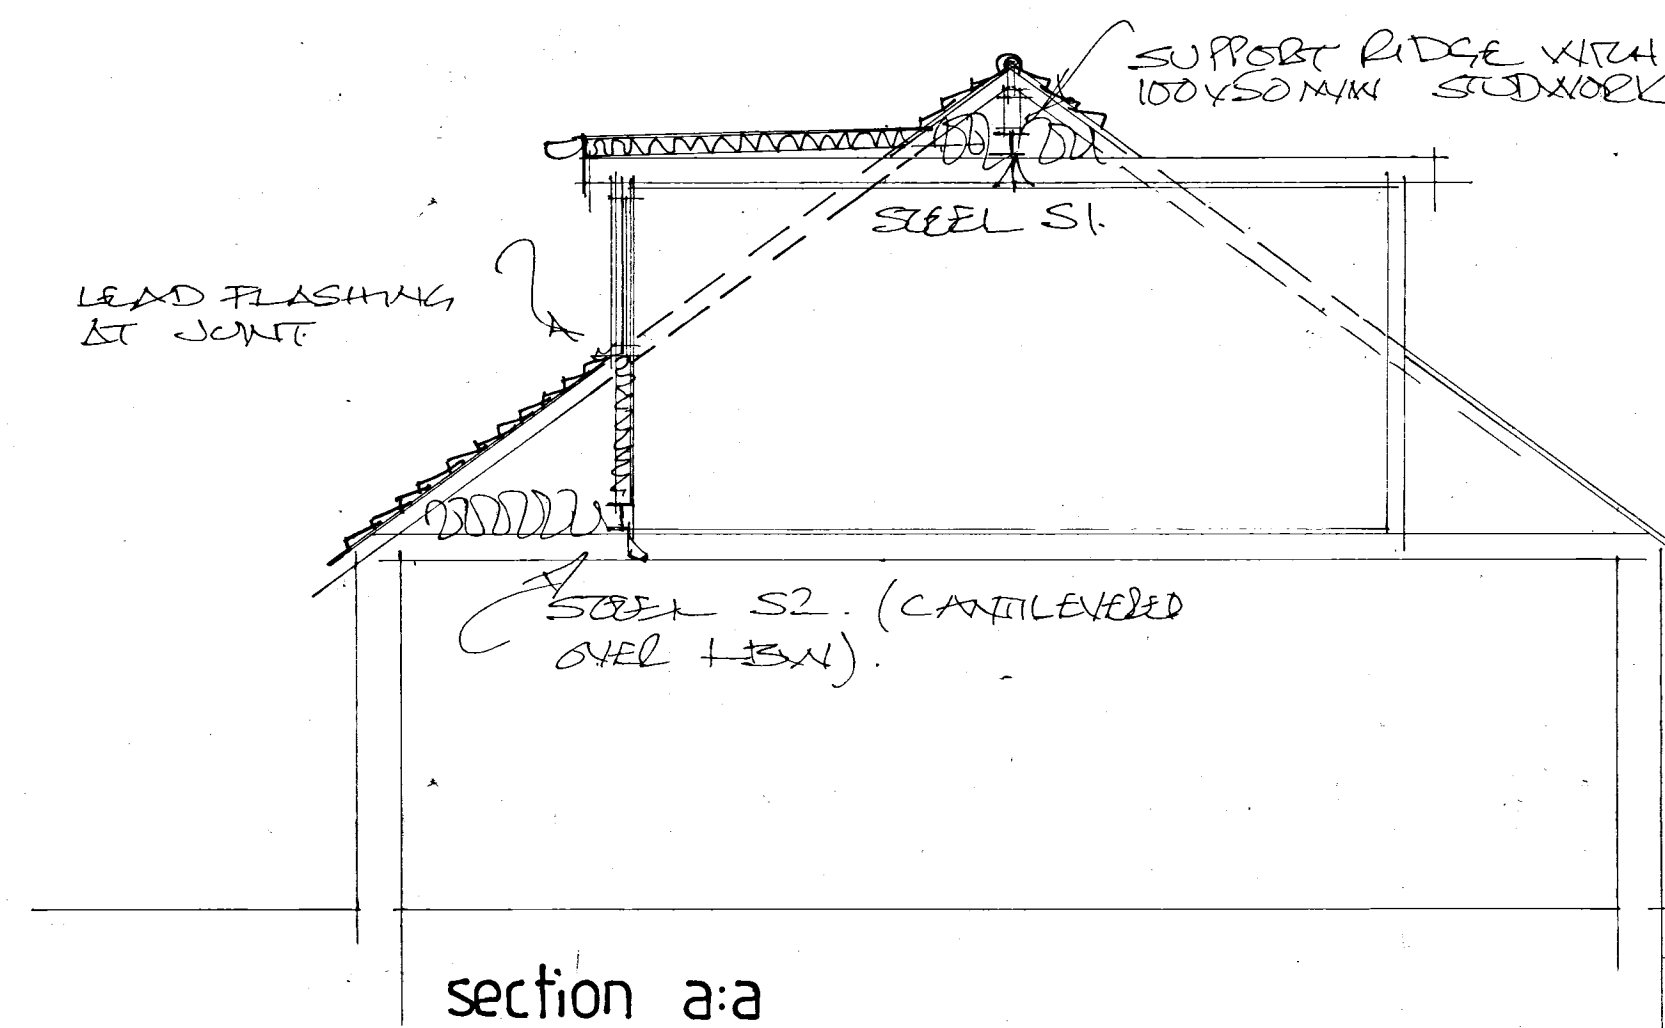

section a-a

Opening window areas to be minimum 1/20th of enclosed floor areas. All new windows to be fitted with minimum 8000sq mm trickle vents per room. Maximum area of double glazed window not to exceed 20% of floor areas

New windows: new double glazed windows to have minimum U value of 1.6w/m²k. Doors to have a min U value of 1.80w/m²k. Toughened glass in glazed doors and windows in critical locations i.e. alongside doors. Seal around window-wall joint with mastic sealant. Double rafters as roof light trimmers if applicable.

Minimum full opening size of escape window 0.33sq.m. min clear dimension of edge 450mm with cill below 1.0m from floor and above 800mm.

Dormer walls: tile/slate hanging on battens and breathable felt on 100mm x 50mm studwork with 12.5mm foil back plasterboard finish over Celotex GA4070 batts between studs flush with outer face of studs (30mm cavity) and Celotex TB4012 across the face of the studs. Tape and mastic joints (12.5mm plasterboard on cheeks where within 1.00m of boundary). Also fit 6mm masterboard web under cheek felt where within 1.00m of boundary. Triple rafters under cheeks. Sheath with 12.5mm marine ply under felt for additional lateral support.

Dormer warm flat roof: Three layer built up felt to BS747 pt144 pl3 on Celotex TD4126 decking on firings and 150 x 50mm joists at 400mm centres. 12.5mm foil back plasterboard ceiling. Seal warm roof from existing vented roof space at join if applicable.

Rain water goods: run new 100mm diam pvc rain water guttering and 70mm diam downpipes to existing system.

Steelwork: see structural calcs for sizes. Minimum bearing 100mm on concrete padstones, prestressed concrete lintols or metal bearing plates. Encase in minimum two layers 12.5mm plasterboard for half hour fire resistance when fitted at floor levels. Lengths of steels to be site measured to include bearings. Fabrication details to be provided if required by Building Control.

This drawing and the information provided is the property of Thorns Young Architectural and shall not be copied whole, in part, or used for any other purpose without written permission from the company.

Principal Contractor is to ensure all materials and workmanship complies with Regulation 7 of the Building Regulations whether or not specifically stated on these drawings. It is the Principal Contractor's duty to ensure all works on site are approved by an appointed Building Control body.

Principal Contractor is to ensure dimensions are taken on site before procurement of any materials/works proceeding. Structural members are not to be ordered scaling from this drawing.

Principal Contractor to ensure full compliance with the amended CDM Regulations (2015) if the project requires.

This drawing, unless noted, does not represent compliance with the Party Wall Act 1996 and if required, all agreements are to be in place before works commence.

It is the Principal Contractor's responsibility to ensure Planning/Building Control approvals are in place prior to works commencing. Should works commence prior to relevant approvals Thorns Young Architectural accepts no responsibility.

Do not scale from this drawing except for the purpose of Local Authority Planning department.

A	Date	Revision

© copyright

THORNS YOUNG
ARCHITECTURAL

THORNS-YOUNG LTD
CHARTERED BUILDING CONSULTANTS
Website: www.thornsyoun.co.uk

Fareham 21 Middle Road
Park Gate
SO31 7GH
Tel: (01329) 888 322

Portsmouth 232 London Road
North End
PO2 9JQ
Tel: (02392) 672 883

Client
MR AND MRS PHILLIPS.

Job Title
87, ST ANDREW CRES.
WICKERLOVE

Drawing Title
PROPOSED FRONT
DORMER

Scale 1:50 + 1:100

Date JULY 2018 Drawn by CMC

Org. No. 2142-18 Rev.