



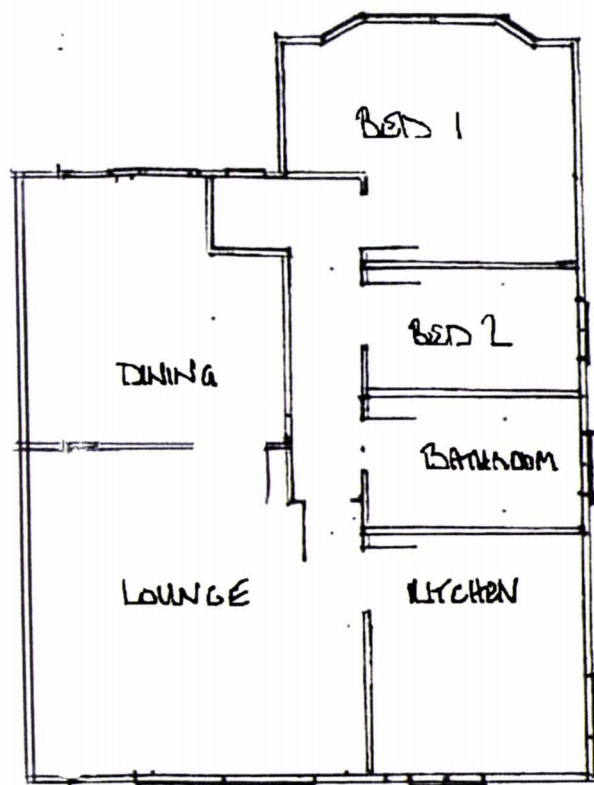


EXISTING GROUND FLOOR


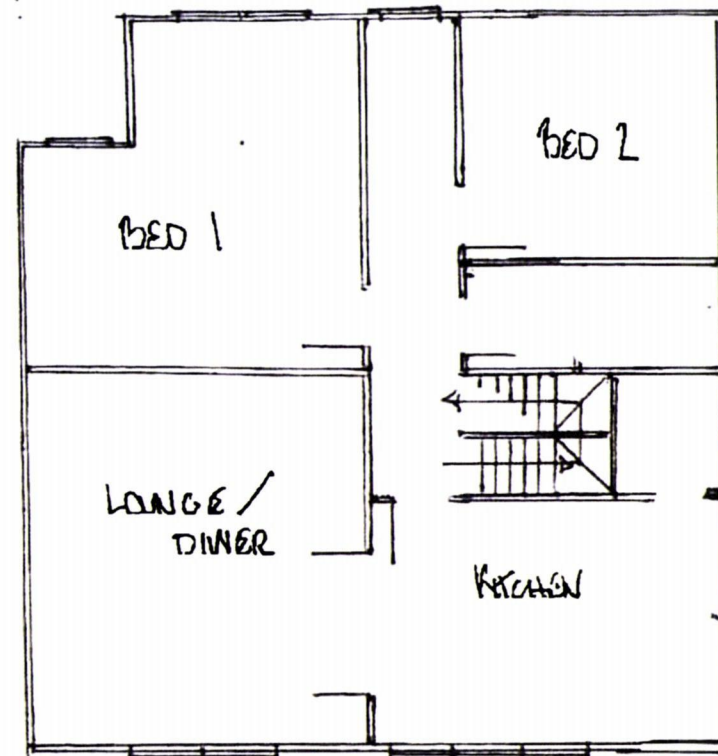


PROPOSED GROUND FLOOR

EXISTING FIRST FLOOR

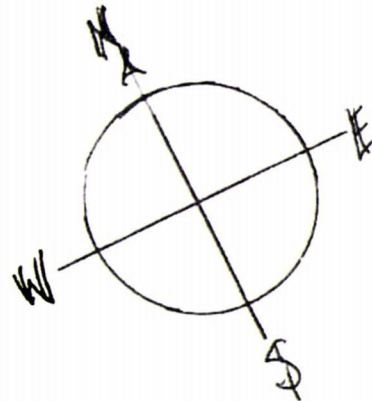

PROPOSED FIRST FLOOR

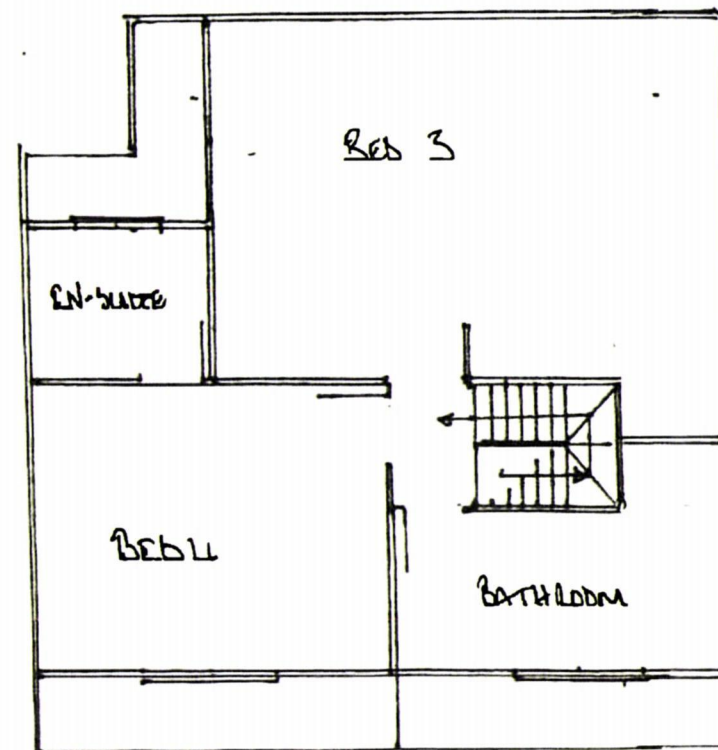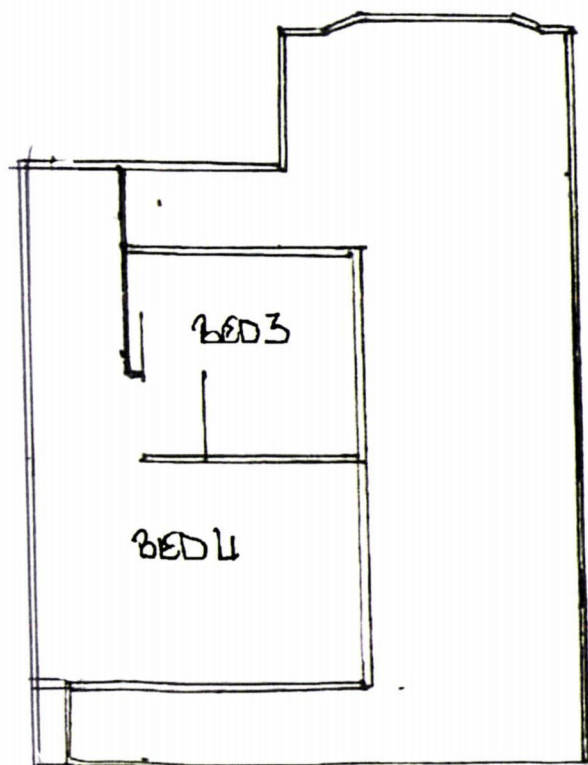

FOUNDATIONS:

TO BE A MINIMUM OF 1MTR DEEP BY 600 WIDE. OR TO SUIT GROUND CONDITIONS

BRICKWORK/BLOCKWORK:

BRICKWORK TO MATCH EXISTING BRICK SKIRT. EXTERNAL BLOCKWORK TO BE 100MM THERMALITE, RENDERED TO MATCH EXISTING. INTERNAL BLOCKWORK TO BE 100MM THERMALITE, WITH DOX/DAB PLASTERBOARD OR PLASTER FINISH.

100MM CAVITY PART FILLED WITH 50MM KINGSPIR OR SIMILAR SOLID INSULATION. WALL TIE AT 450 X 900MM CENTRES. CAVITY WALL TO BE TOOTH BONDED AT EXISTING ABUTMENT TO ENSURE CAVITY IS MAINTAINED AND CONTINUOUS.


STEELS/CARNICES:

ALL REQUIRED STEELS CALCULATED TO ENGINEERS / MANUFACTURERS SPECIFICATIONS.

DRAINAGE:

IN THE MAIN 100MM PVC LAID TO A MINIMUM FALL OF 1:80. SURROUND WITH PEA SHINGLE. ALL GULLIES TO HAVE RODABLE ACCESS.

~~UNDERGROUND~~ SCALE 1:100 @ A3

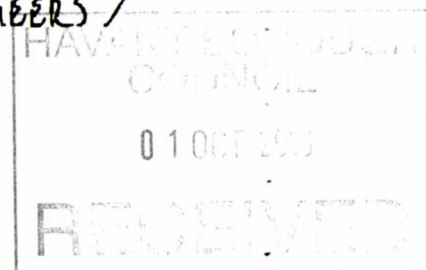

10 SILVERDALE DRIVE, WATERLOOVILLE. PO7 6DN.
PROPOSED SIDE & ROAD FENCING