Site Boundary

- Site Boundary
- Phase 1
- Phase 2

Proposed Surface Water Drainage

- Rising Main
- Outfall
- Pump Station
- Surface Water Manhole
- Inspection Chamber
- Surface Water Drain
- Above Ground Storage
- Proposed Cellular Storage

Existing Foul Drainage

- SW Foul Manhole
- SW Foul Sewer

Proposed Foul Drainage

- Proposed Foul Manhole
- Proposed Foul Drain
- Diverted Watercourse

Notes
- Indicative invert levels are shown in mAOD
- Surface water drains to be laid a minimum of 1 in 100 gradient
- Surface water discharge form the site to be limited to 33 l/s
- Approximate construction depth of the cellular storage tanks is 450 mm
- A minimum 900 mm cover for the cellular storage tanks to be provided
- Foul drains to be laid a minimum of 1 in 80 gradient

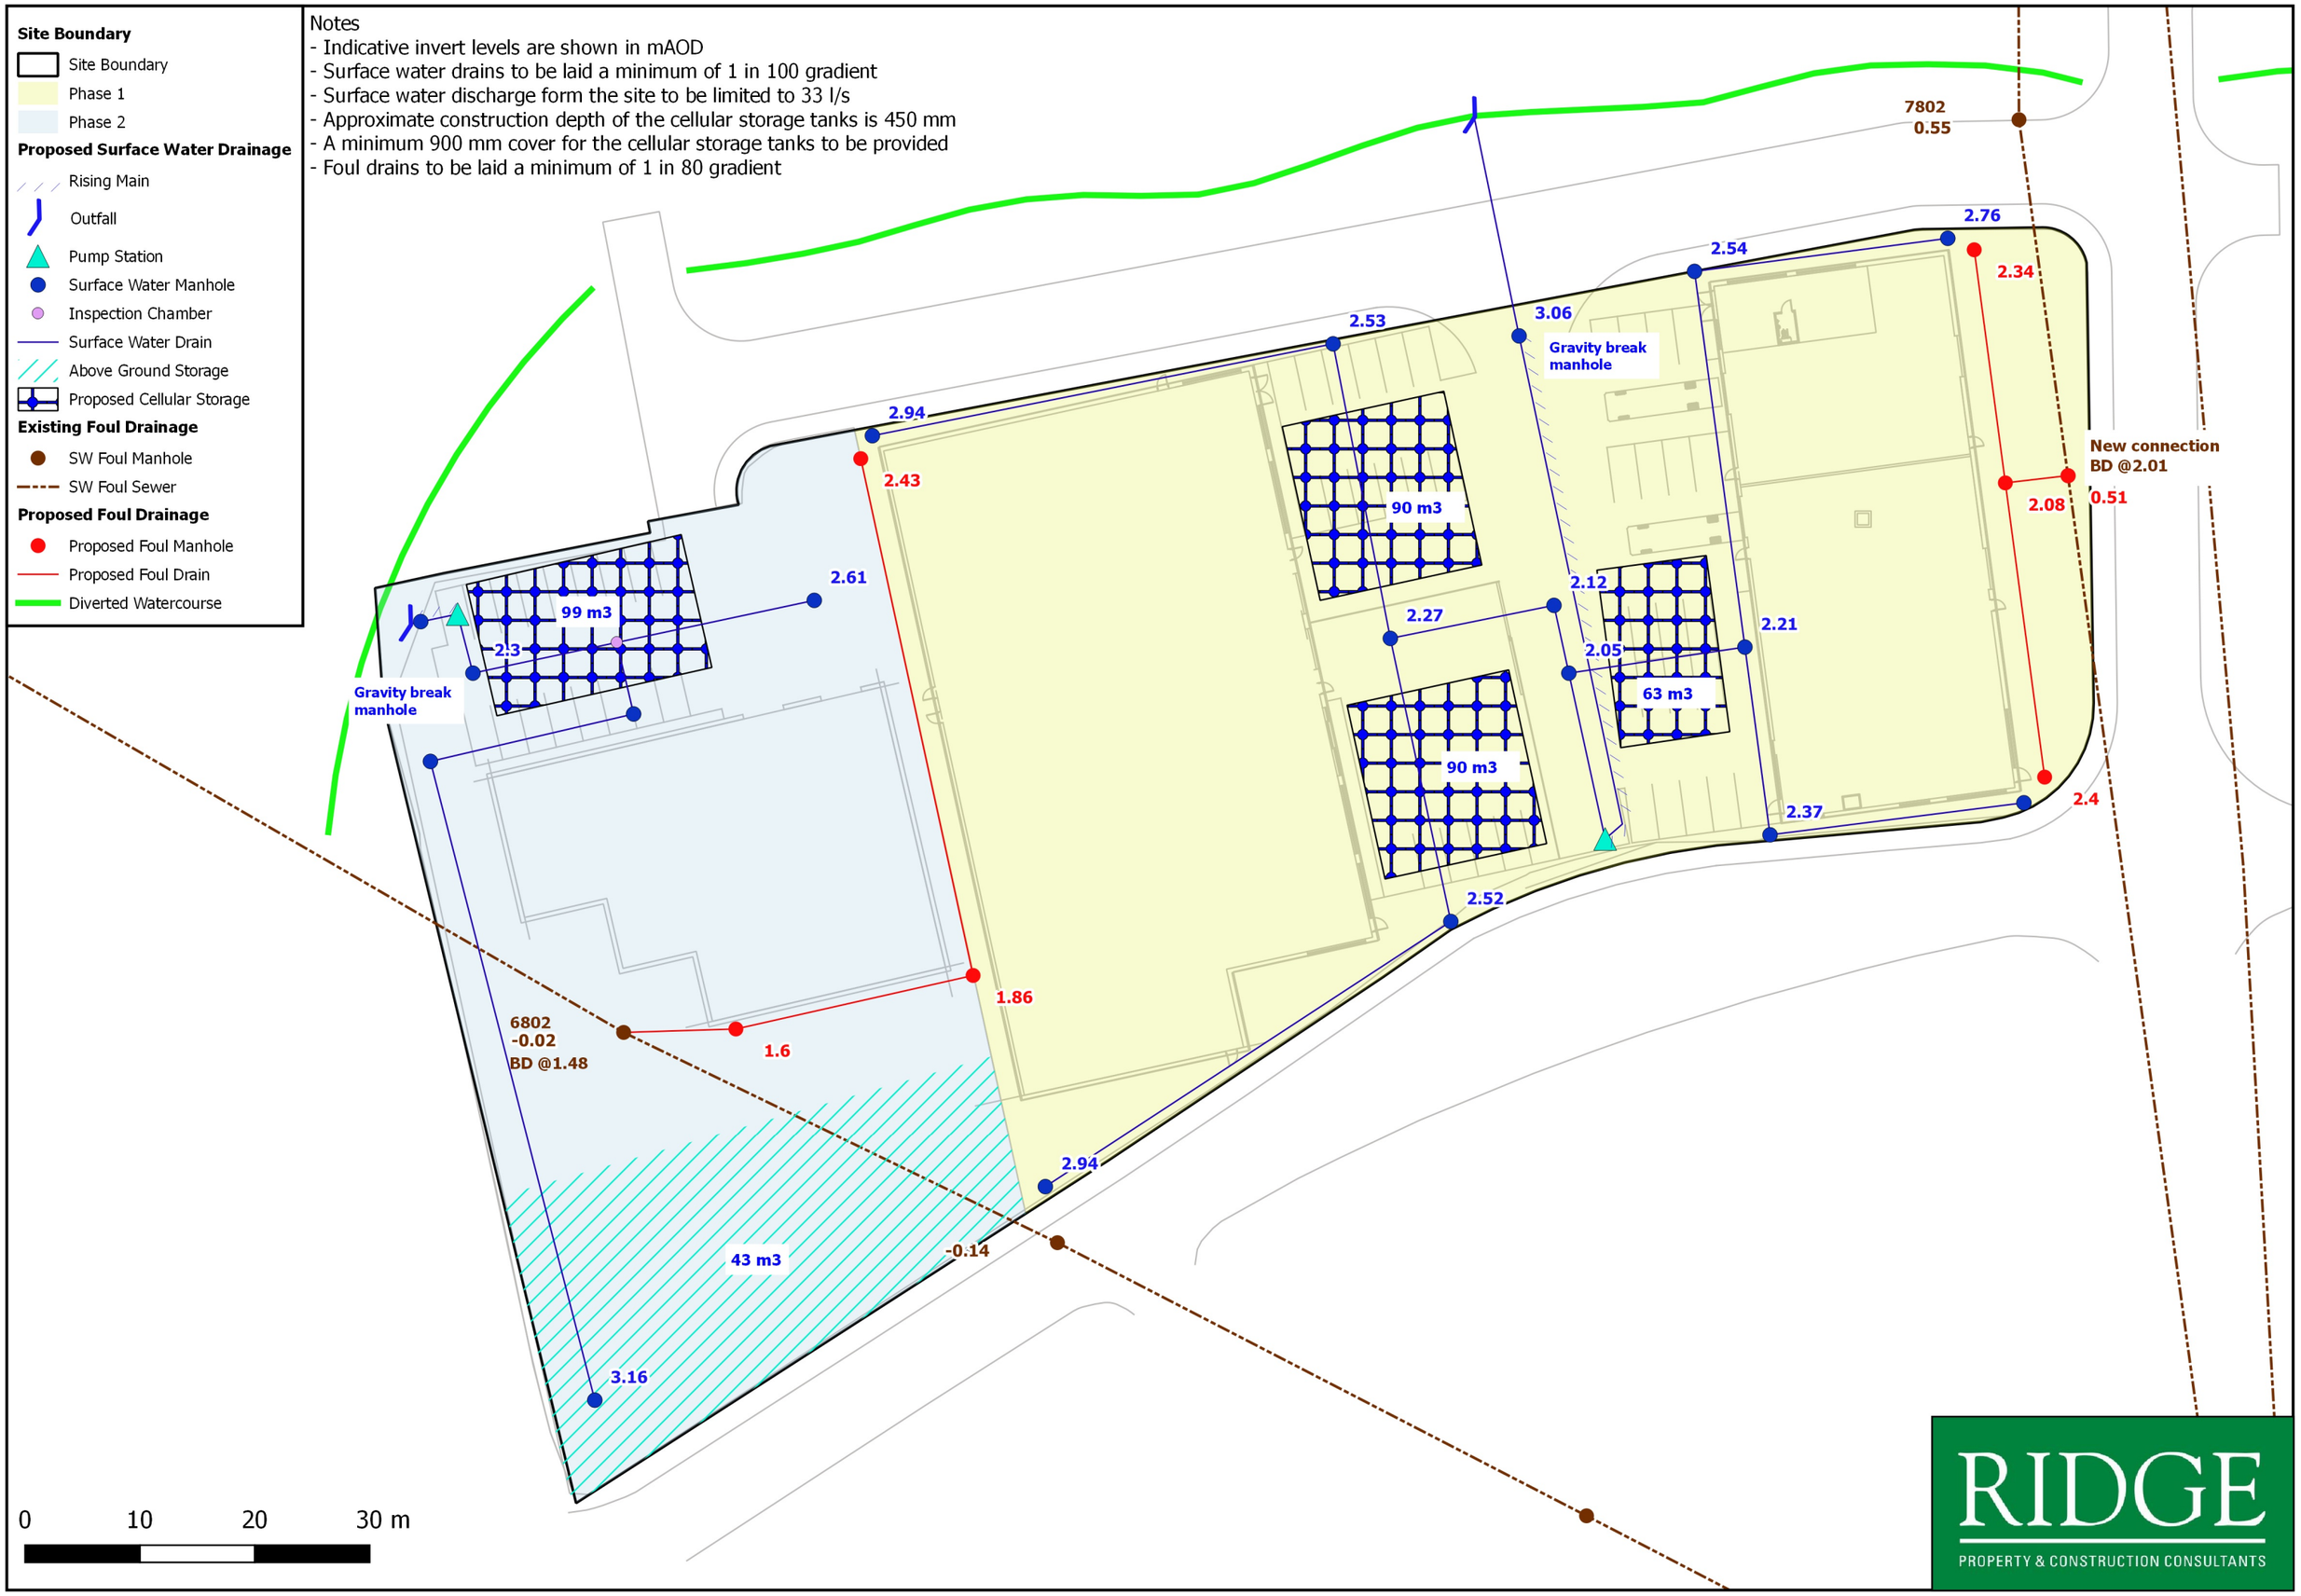

RIDGE
PROPERTY & CONSTRUCTION CONSULTANTS

WWW.RIDGE.CO.UK