




P:\17-110 - Woodcroft Farm, Havant\Tech\Acad\Drawings\2000 Series - Phase 1A\17-110-2013 Private Construction Details.dwg

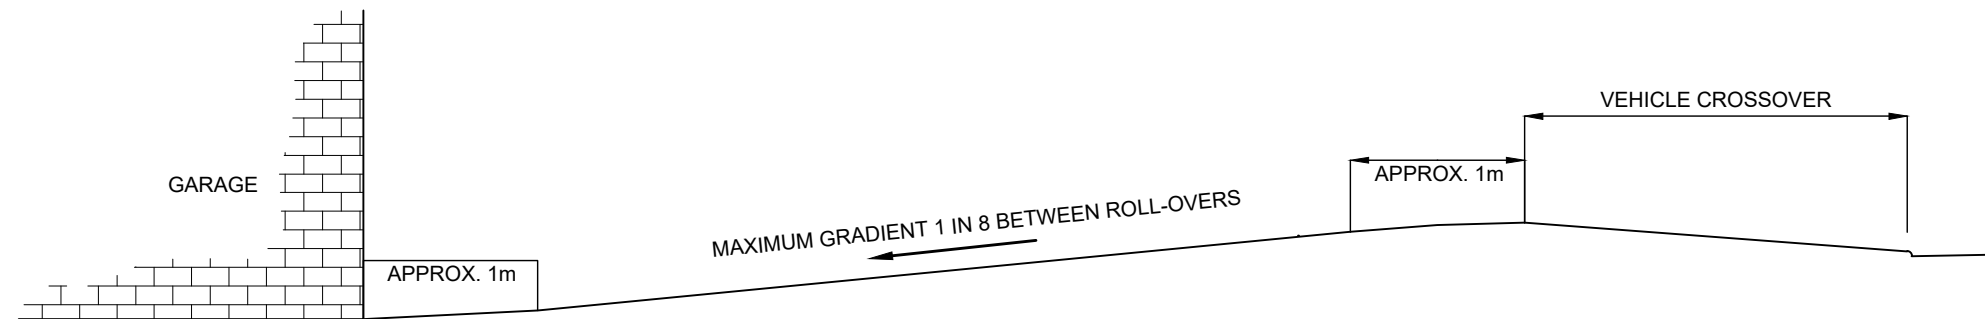


SECTION THROUGH DRIVE

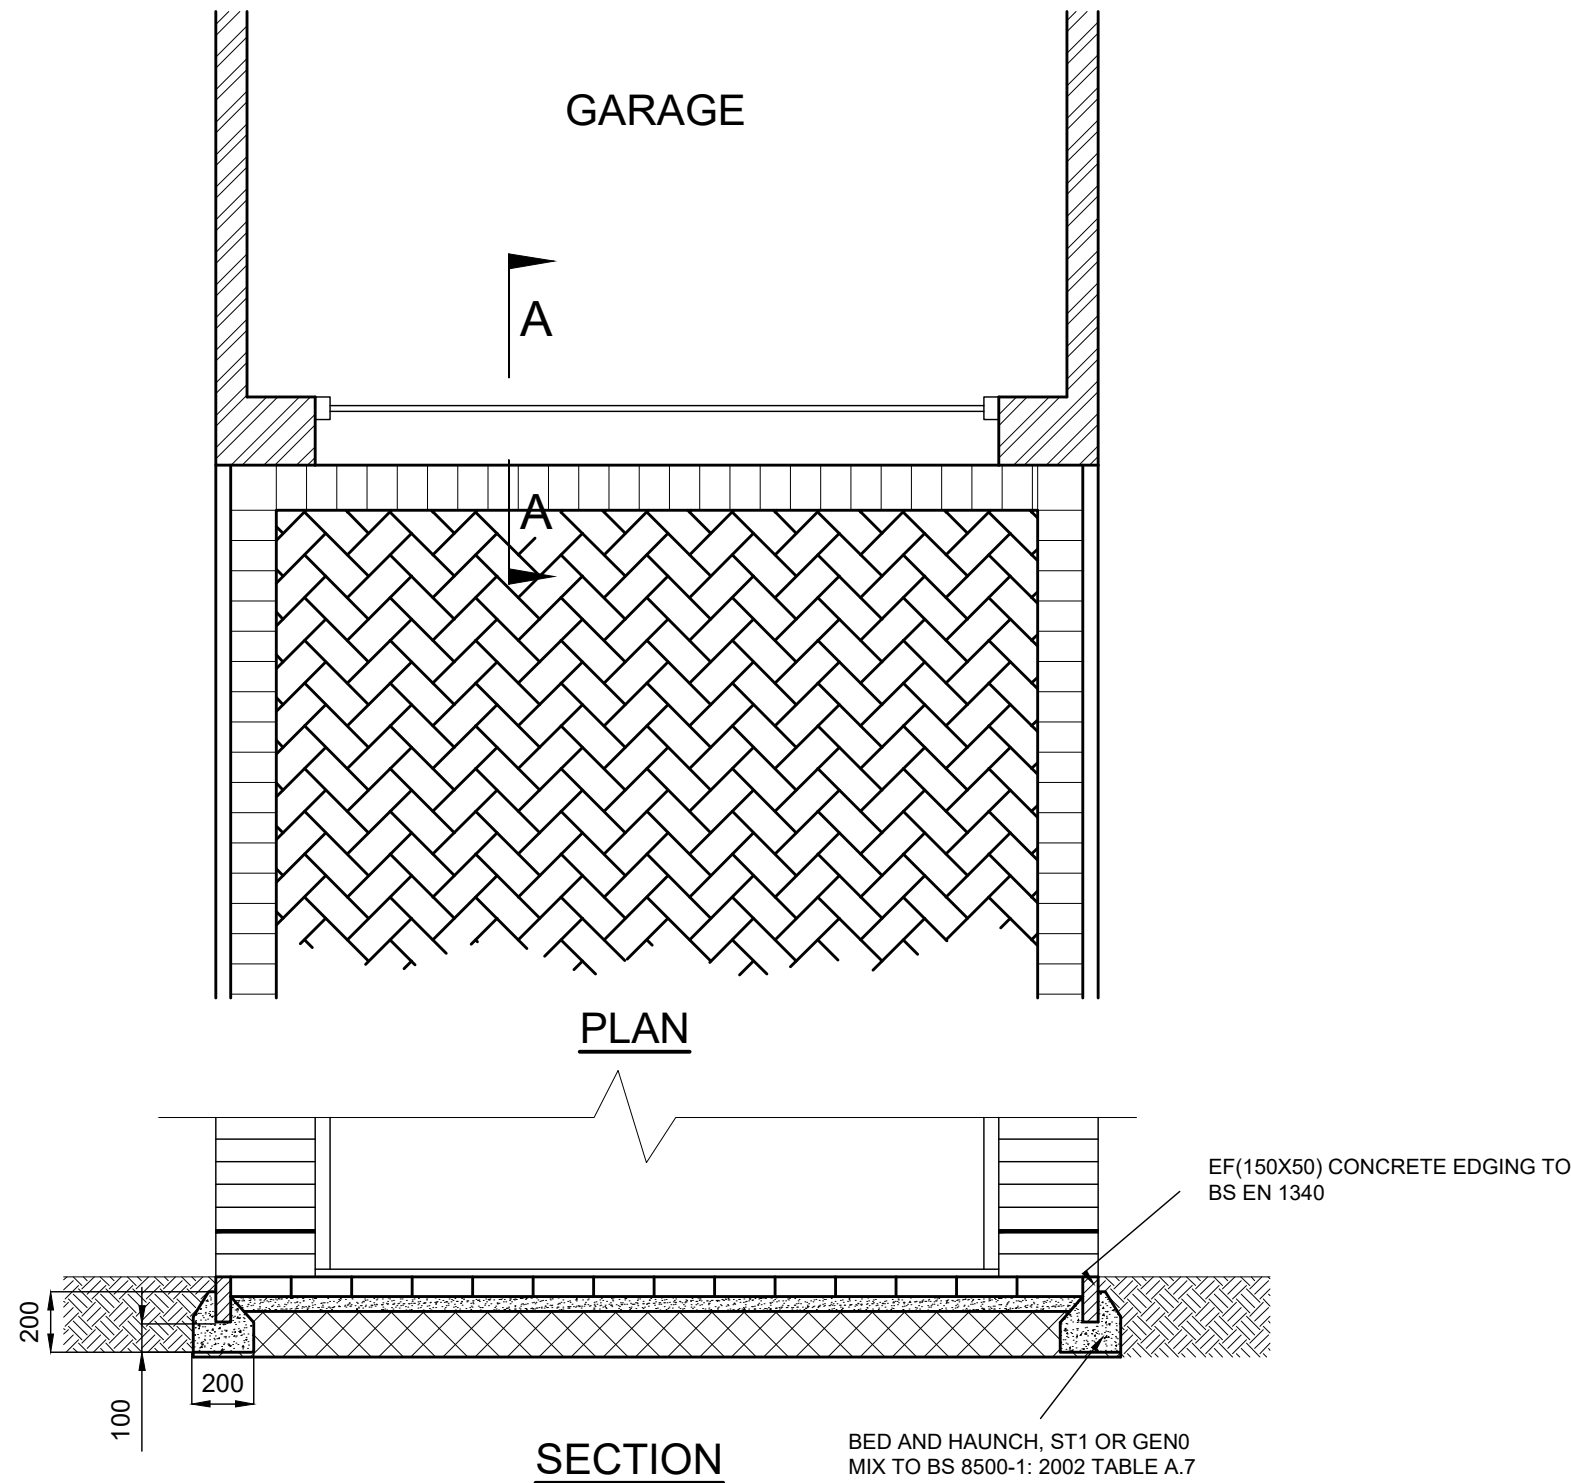


GARAGE LAYOUT WITH BLOCK PAVING

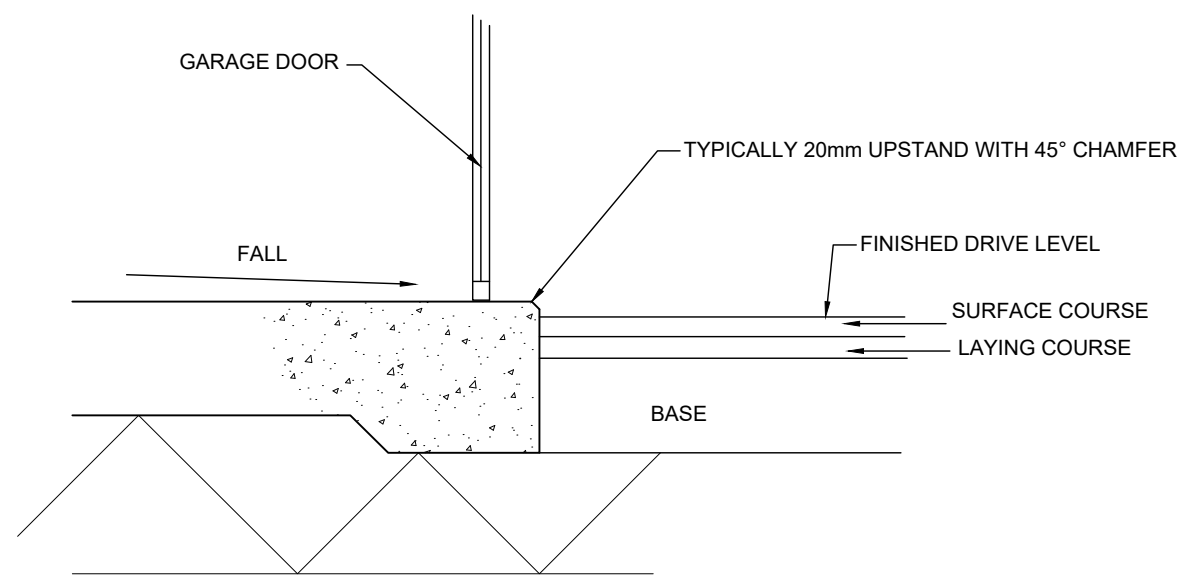


SECTION A-A

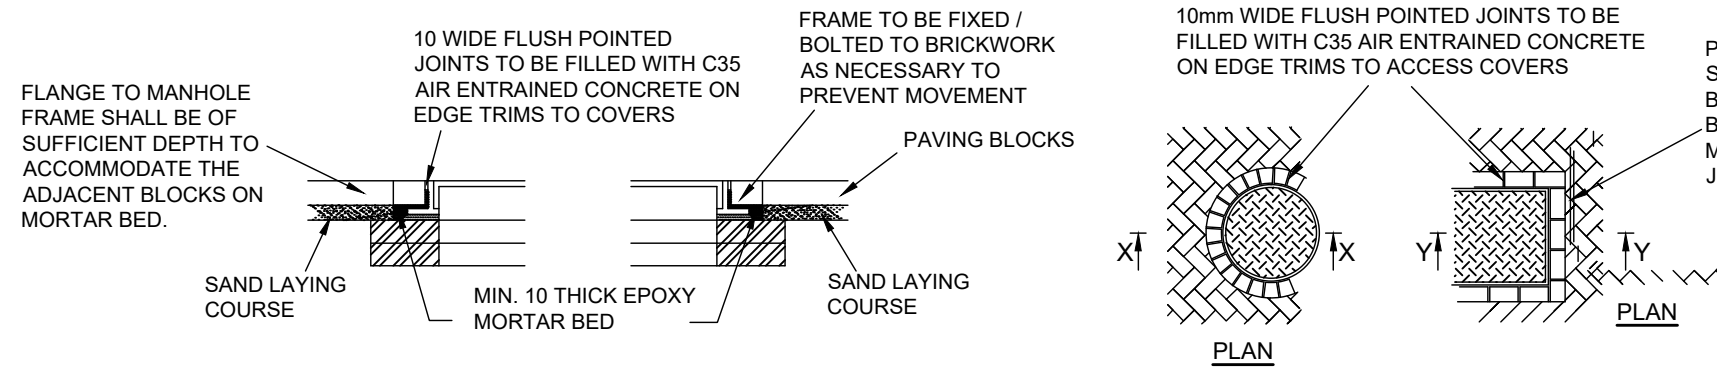

EDGE TRIMS TO ACCESS COVERS

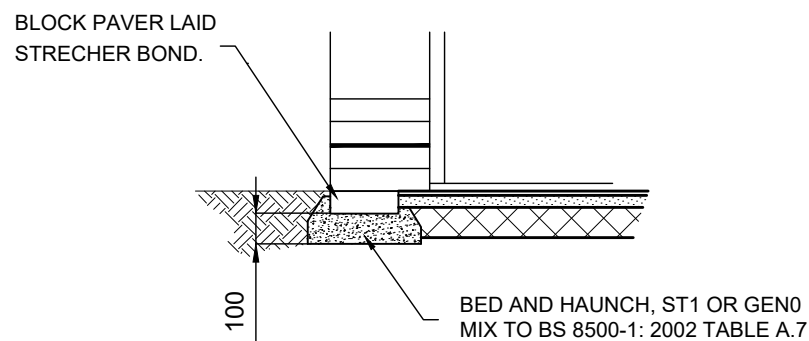

ALTERNATIVE EDGE DETAIL

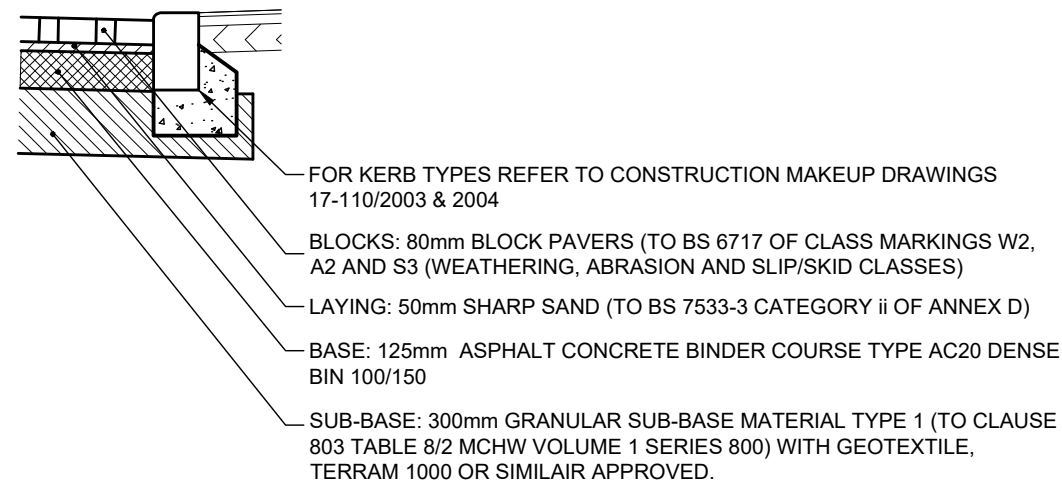

IMPERMEABLE BLOCK PAVED CONSTRUCTION
(BASED ON 2% CBR)

Capping Table 1- NHBC Chapter 10		
Subgrade CBR	Sub-base without Geotextile	Sub-base with Geotextile
CBR 7-20%	100mm	N/A
CBR 5-7%	150mm	N/A
CBR 3-5%	250mm	150mm
CBR 2-3%	325mm	225mm
CBR Less than 2%	N/A	300mm

NOTES

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELATED DRAWINGS ISSUED BY THE ARCHITECT AND ENGINEER AND NHBC STANDARDS.
2. DO NOT SCALE FROM THIS DRAWING. REFER TO FIGURED DIMENSIONS ONLY.
3. WORKS TO BE CARRIED OUT IN ACCORDANCE WITH SPECIFICATION FOR HIGHWAY WORKS (SHW) LATEST EDITION AND CURRENT BRITISH STANDARDS.
4. COMPACTION OF ALL BITUMINOUS MATERIAL SHALL BE TO BS EN 594897.
5. ALL BLACK TOP MATERIAL TO BE LAID BY AN EXPERIENCED SURFACING CONTRACTOR.
6. KERB UP STANDS TO BE IN ACCORDANCE WITH THE CONSTRUCTION MAKEUP DRAWING. REFER TO ODYSSEY DRAWING 17-110/2003 - 2004 FOR DETAILS.
7. SURFACE COURSE SHALL NOT BE TRAFFICKED FOR 24 HOURS.
8. NAME, ADDRESS AND CONTACT OF MATERIAL SUPPLIERS Batching Plant shall be provided to the client for approval.
9. COPIES OF ORDER SHALL BE MADE AVAILABLE TO THE CLIENT.
10. COPIES OF DELIVERY TICKETS AND RECORDS OF WHERE MATERIALS ARE LAID.
11. CERTIFICATION SHALL BE PROVIDED OF DELIVERY TEMPERATURES AND ROLLING TEMPERATURES.
12. DIP MEASUREMENTS FOR THICKNESS OF SURFACING COURSE SHALL BE MADE AVAILABLE TO SITE MANAGER.
13. WITH SUB-BASE MATERIAL PARTICULAR ATTENTION SHALL BE PAID TO PLACING AND COMPACTING TO ACHIEVE MAXIMUM DENSITY.
14. IF APPROVED GRADED HARDWARE IS EMPLOYED IT SHALL BE BLINDED WITH TYPE 1 OR TYPE 2 MATERIAL PRIOR TO LAYING BINDER COURSE IN ORDER TO PROVIDE A WELL COMPACTED, CLOSED EVEN SURFACE TO THE REQUIRED LEVELS AND FALL.
15. GEOTECHNICAL REPORT IS AVAILABLE FOR INSPECTION UPON REQUEST.
16. THE CONTRACTOR SHALL CONFIRM AT HIS OWN EXPENSE THE 'CBR' VALUE AT 30M INTERVALS ALONG THE CARRIAGEWAY ROUTE. THE CONTRACTOR IS TO LIAISE WITH THE ENGINEER IF THERE IS ANY DISCREPANCY.
17. ANY SOFT SPOTS ARE TO BE REMOVED AND REPLACED WITH CLASS 8F1 OR MATERIAL APPROVED BY THE ENGINEER.
18. ALL IMPERMEABLE BLOCK PAVING IS TO BE LAID WITH A BLOCK SEALANT TO STOP WATER INGRESS.

Rev	Amendments	Dm	Chk	App	Date

**ODYSSEY**

Tuscany House
White Hart Lane
Basingstoke
Hampshire RG21 4AF

Telephone: 01256 331144
Fax: 01256 331134
E: info@odysseyconsult.co.uk
W: www.odysseyconsult.co.uk

Job Title
**WOODCROFT FARM, HAVANT
PHASE 1A**

Drawing Title
PRIVATE CONSTRUCTION DETAILS

Client		
		
Scale NTS @A1	Date MARCH 18	Designed
Drawn MA	Checked ND	Approved LH
Job No 17-110	Drawing No 17-110/2013	Rev