



NOTES

1. This drawing is to be read in conjunction with all relevant Engineers and Architects drawings, and the Specification.
2. All dimensions are in millimetres unless noted otherwise. All levels are in Metres Above an arbitrary datum and not to Ordnance Datum.
3. In accordance with CDM Regulations 2001 the Contractor is to:
  - Notify HSE of works.
  - Comply with the requirements of Health and Safety Plan(if applicable)
  - Provide risk assessments and method statements for all potential hazards relevant to this project.
4. The main contractor shall be responsible for the setting out and accuracy of all dimensions. He shall satisfy himself that the dimensions on these drawings are correct and any discrepancies should be noted to the Engineer immediately.
5. DO NOT SCALE. If discrepancy or query arises on dimensions consult Engineer.
6. The Contractor is responsible for specifying product and codes and ordering of drainage materials.
7. All drainage to be installed to BS5955 Pt6 and in strict accordance with the manufacturers instructions.
8. All PVCu drainage products to conform to BS EN1401 & Kite mark certified in accordance with specification.
9. All drainage pipes on this drwg to be 100mm unless shown otherwise. Min. falls 1/80 for foul and 1/100 for storm drainage.
10. Cover grades are in accordance with BS497 Pt 1 Cover Grades :- D400 – carriageways. B125 – inaccessible to vehicles
11. Sewer runs and manholes to be adopted are to be in accordance with Sewers for Adoption, 5th Edition.
12. Any drainage laid less than 600mm below FGL to be covered with minimum 150mm den 3 grade concrete to half diameter.
13. No foul drainage sewer connection works to be undertaken until permission to discharge has been granted by Wessex Water.
14. Sookaways to be a minimum of 5.0m from new buildings.
15. Provide 100x100 PCC intel max span 650mm where svp exit the building.
16. ACO channels installed and bedded to manufacturers requirements.

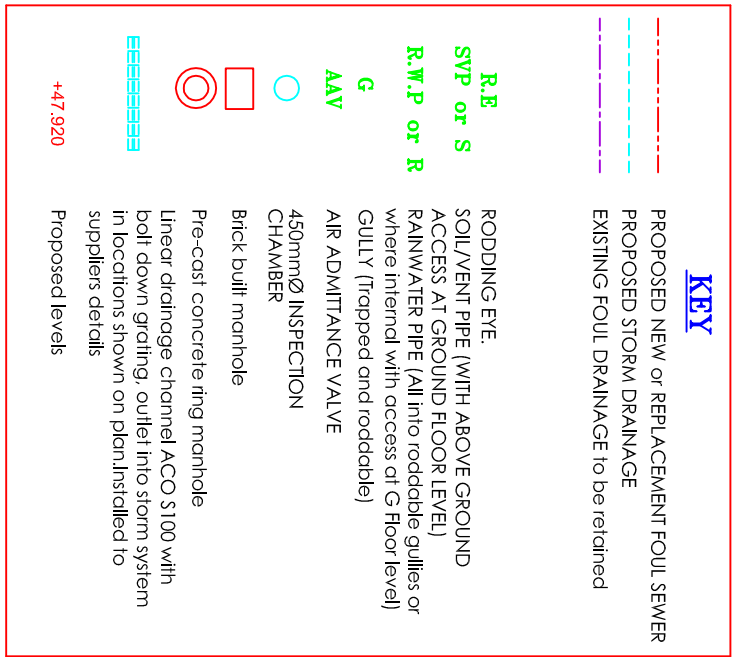

**STORM WATER SUDS / ATTENUATION TANK DESIGN NOTES**  
Refer to Cowan Consultancy storm water drainage design calculations for further details:  
Existing site run off during design storm = 16.97 L/s (366.5 m³)  
Proposed site run off after development during design storm = 32.33 L/s (698.4 m³)  
Therefore run off from site at storm water discharge position will be limited to the existing site design storm run off using a flow control device such as Tubosider.  
An attenuation tank has been sized to temporarily store the surplus runoff and discharge it at a controlled rate into the drainage pipes and within the noted Cowan Consultancy storm water design calculations.

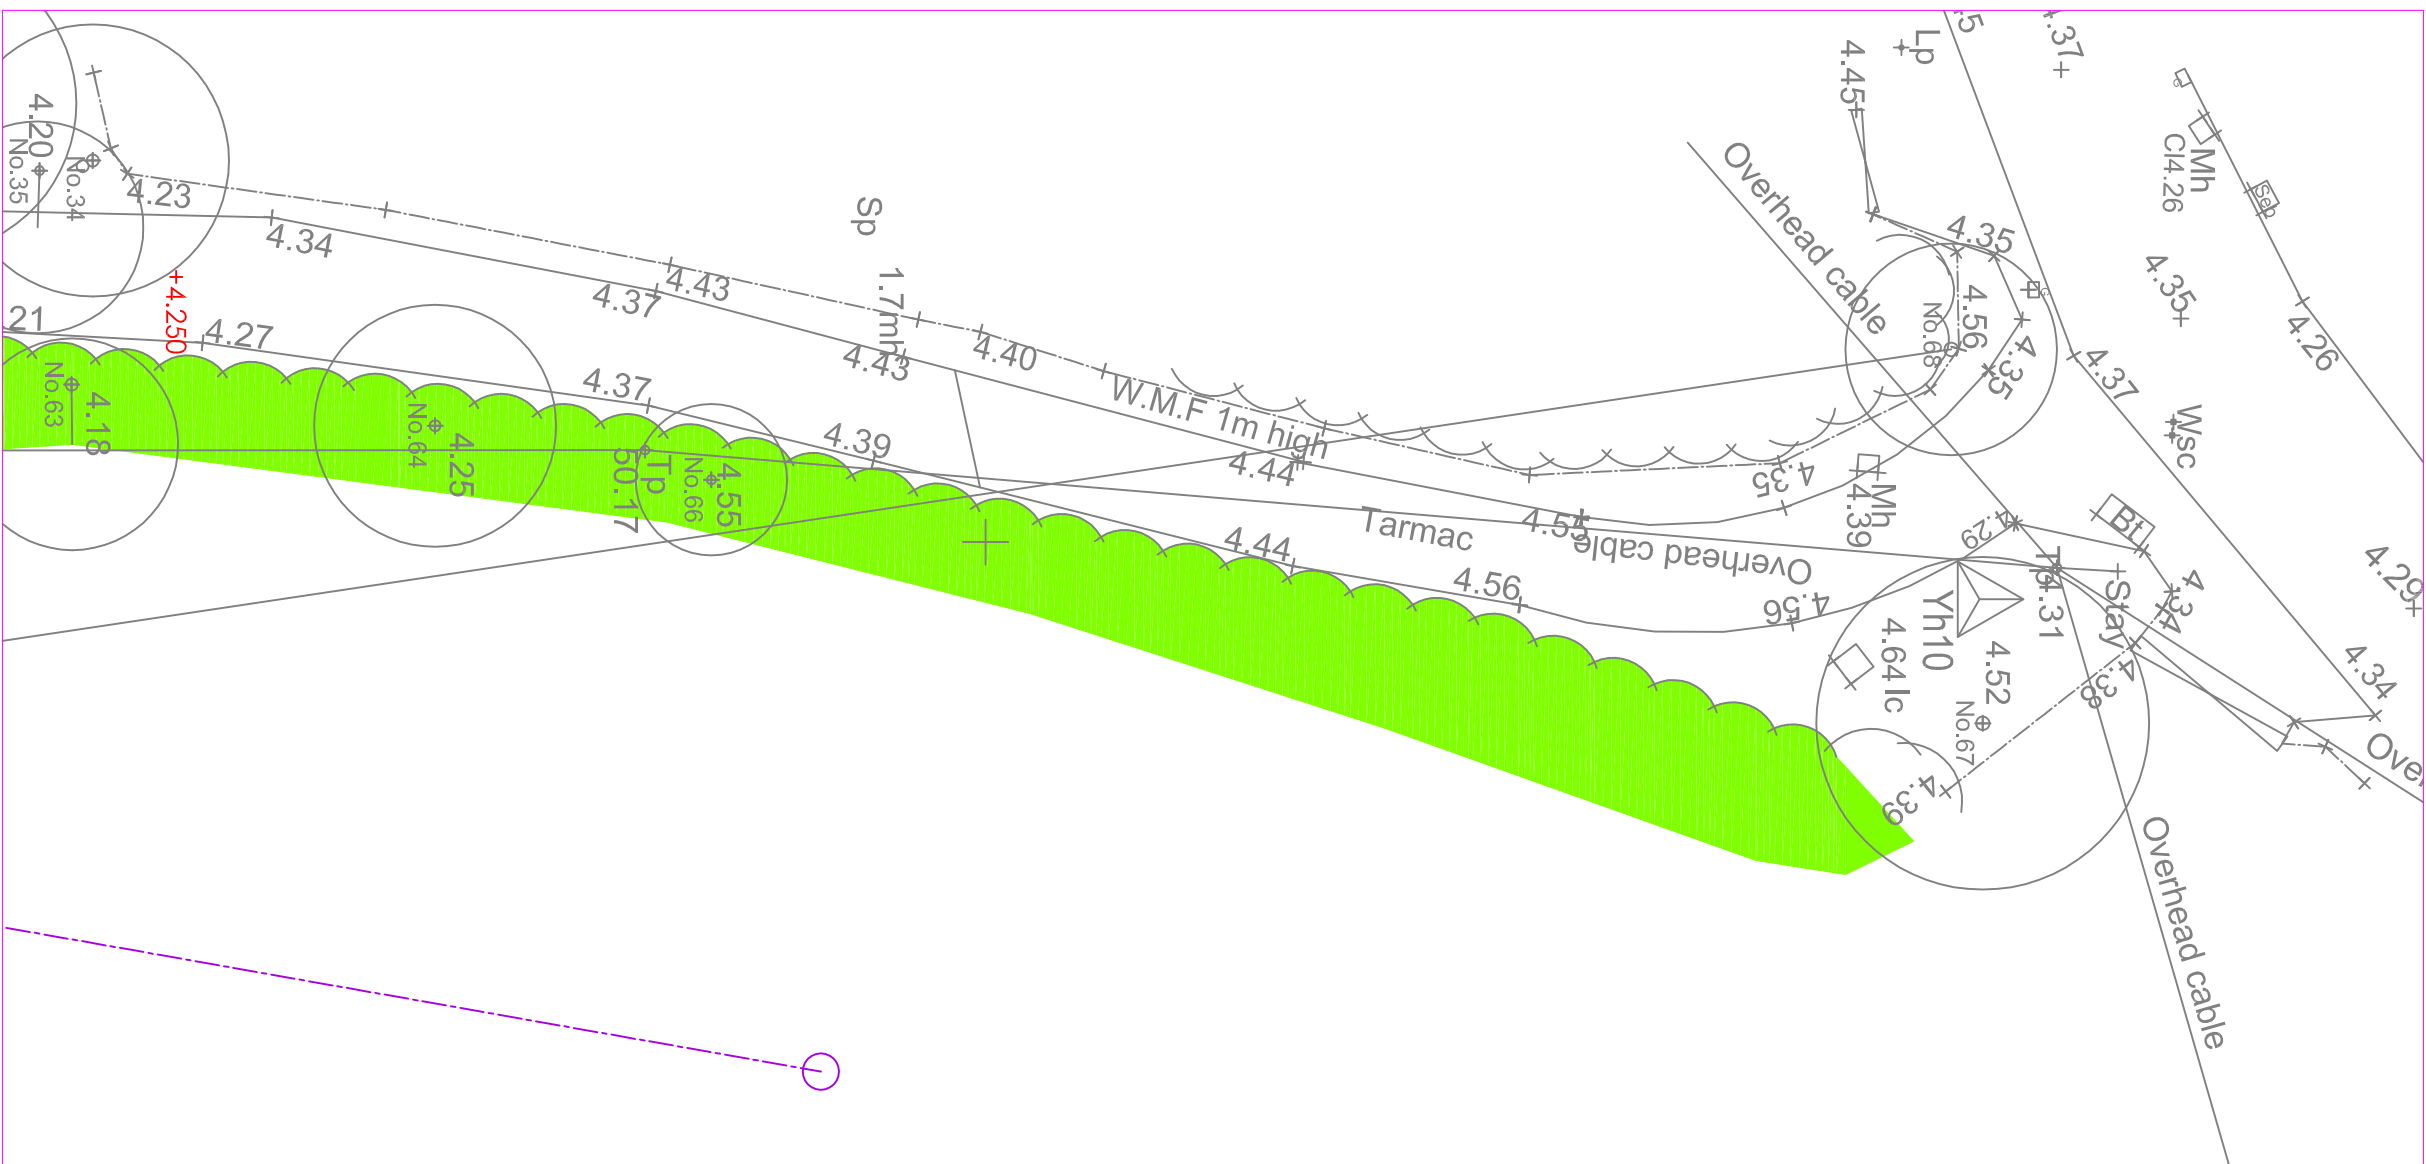

DO NOT SCALE THIS DRAWING

|                                                                                                                                                                                                                                                                                                                                                                                                                          |    |          |     |       |     |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----|----------|-----|-------|-----|
| Date                                                                                                                                                                                                                                                                                                                                                                                                                     | By | Revision | Q&D | CHK'd | Ref |
| <b>PRELIMINARY</b>                                                                                                                                                                                                                                                                                                                                                                                                       |    |          |     |       |     |
| <b>Cowan Consultancy</b><br>STRUCTURAL, CIVIL AND BUILDING CONSULTANTS<br>3 Turnberry House<br>4400 Parkway<br>Whiteley<br>Horsham<br>West Sussex PO15 7TU<br>Client: Alpine Homes Ltd.<br>Project: Yachthaven Site<br>Copsse Lane, Hoyling Island<br>Also at:<br>Landguard Manor Road<br>Spinklin<br>Ipswich<br>IP20 7JH<br>Tel: 01489 577498<br>Fax: 01489 579873<br>consultants@cowan.co.uk<br>www.cowanconsult.co.uk |    |          |     |       |     |
| <b>Drainage General Arrangement</b><br>Drawing 1 of 2<br>Date: July 17<br>Scale: 1/250<br>Dwg. No.: 593579-100P2                                                                                                                                                                                                                                                                                                         |    |          |     |       |     |