


Ref: SGN/TPES/10827



Andrew Biltcliffe
Havant Borough Council
Public Service Plaza
Civic Centre Road
Havant
Hants
PO9 2AX

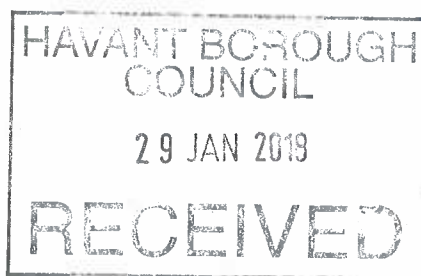

Bourne Valley Road
Branksome
Poole
Dorset
BH12 1YT
james.heywood@sgn.co.uk
25/01/2018

Re: Havant Borough Council - Development Projects(APP/16/00774) - Nr Selangor Avenue, Emsworth

Works Classification: Development Projects

Dear Andrew Biltcliffe,

Thank you for your enquiry received 25/01/2018, indicating that an application for planning permission has been made for the above development.

There is a high pressure pipeline in the vicinity of these proposed works. We have sent a copy of your correspondence to our local engineer who will be in contact separately. In the meantime, SGN formally object to this planning application until such time as a detailed consultation has taken place.

This pipeline is registered with the Health and Safety Executive as a Major Accident Hazard Pipeline.

SGN High Pressure Gas Pipelines in the vicinity of your works		
Pipeline Number	Pressure Regime	Building Proximity Distance (Zone 1)
P014	HP	15.0
This table does not include SGN's low medium and intermediate pressure assets, which may be in the vicinity.		

The building proximity distance (Zone 1) for the pipeline is shown in the table above for all our high pressure gas pipelines in the vicinity of your works. This should not however be confused with the HSE consultation zones 2 & 3 which will be considerably greater, further guidance of the requirements can be found in HSE Document: PADHI: HSE's Land Use Planning Methodology. Zone 1 is a safety factor with reference to habitable buildings as recommended by IGE TD/1. It is calculated from the diameter, material, wall thickness and pressure of the particular pipeline. Under Pipeline Safety Regulations 1996 this distance is declared to the HSE. Any intrusion within this safety zone will not be taken lightly and any intention to proceed should be accompanied by a risk assessment or provision of other supporting evidence, especially in the event of any legal proceedings at a later date.

Pipelines laid in private land are protected by a 'Deed of Grant', which prohibits certain activities within the easement strip, no addition to or removal of the surface levels, no structures over or within the specified distance of the pipeline.

Smell Gas?

Call 0800 111 999

SGN is a brand name of Southern Gas Networks plc
Registered in England & Wales No. 05167021
Registered Office: St Lawrence House | Station Approach | Horley | Surrey RH6 9HJ

Further details are available if you require them.

The pipeline is of prime importance to the gas supplies of this area. It is essential that you comply with the restrictions detailed below and in the document SGN/WI/SW2 in order to protect our plant and equipment and for the safety of your own operatives. A SGN representative must be contacted before any works commence.

- 1) No mechanical excavation is allowed within 3 metres either side of pipeline.
- 2) No plant or storage of equipment shall be made within any easement strip.
- 3) If any metallic pipes or cables are being laid in proximity to gas pipelines then interference testing will be required, the cost of which to be borne by the promoter of the works. A minimum clearance of 600mm is required.
- 4) All precautions stated in publication SGN/WI/SW2 (Safe Working in the Vicinity of High Pressure Gas Pipelines) shall be fully complied with in all respects. Acceptance of SW2 shall be acknowledged by the responsible site person signing and returning the form Appendix A (back page) to the SGN representative contacted in (7).
- 5) No thrust boring shall take place within three meters of the pipeline.
- 6) All planting within the easement strip should comply with 'Notes for Guidance on Tree Proximity'.
- 7) Before commencing work on site you must contact our Pipeline Maintenance Section on the number above at least three days before work commences. A Southern Gas Networks representative will then contact you to arrange to visit site. Details of working near to high-pressure gas pipelines can then be discussed.
- 8) Pipeline sections that are planned and agreed by SGN to be permanently covered (i.e. by road surface) will require a coating survey. SGN will repair any indicated coating defects free of charge. The survey costs will be borne by the promoter of the works. Prior to any surface cover cathodic protection coupons and reference cells will require installation at no cost to SGN.
- 9) This pipeline is cathodically protected and as such has test cables located in test posts, were these to be lost through this work we would look to you for remedial action at no cost to SGN.
- 10) Intrusive construction methods will require an agreed method statement prior to work starting.
- 11) Any extended period of SGN site supervision may incur charges to you. These will be charged based on visiting times, materials and occurrences. You will be informed when these come into effect and be invoiced direct.
- 12) Any piling or boreholes within 15 metres of the pipeline may require vibration monitoring. No piling or boreholing must take place within 3 metres of the pipeline.

Please ensure these conditions, together with any relevant drawings are forwarded for use by the construction personnel of your works.

Please let me know if SGN can supply you with technical or other information that may be of assistance to you in determination of the application.

Yours Sincerely,

James Heywood
Team Manager

Smell Gas?
Call 0800 111 999

SGN is a brand name of Southern Gas Networks plc
Registered in England & Wales No. 05167021
Registered Office: St Lawrence House | Station Approach | Horley | Surrey RH6 9HJ

High Pressure Gas Pipes within this vicinity

Overview

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Date Requested: 25/01/2018
Job Reference: 12079877
Site Location: 473498 106228
Requested by:
Mr Andrew Biltcliffe
Your Scheme/Reference:
APP/16/00774

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



History Data

LAs

GTs

SSSIs

Diameter Change



Material Change

Warning: PDF is designed for colour print only, with no page scaling. This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately – KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas – 100044373 and Scotland Gas – 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LineasearchbeforeUdig