



Atkins
The Hub
500 Park Avenue
Aztec West
Bristol
BS32 4RZ

Developer Services
Southern Water
Sparrowgrove House
Sparrowgrove
Otterbourne
Hampshire
SO21 2SW

Tel: **0330 303 0119**
Email: **developerservices@southernwater.co.uk**

Your Ref:
Capacity Check

Our Ref:
CC/002806

Date:
06 October 2015

F.A.O: Mr. Phil Williams,

**Site: Purbrook Park School, Stakes Road, Purbrook, Waterlooville, Hampshire,
PO7 5BF.**

Dear Sirs,

I am now in receipt of the results of the capacity check you requested for the above development site.

FOUL WATER

Following initial investigations, there is currently adequate capacity in the local sewerage network to accommodate a foul flow of 1.2 l/s at/downstream of manhole reference SU68072701. Please note that no surface water flows (existing or proposed) can be accommodated within the existing foul sewerage system.


SURFACE WATER

Following initial investigations, there is currently adequate capacity in the local sewerage network to accommodate a surface water flow of 5 l/s at/downstream of manhole reference SU68072750.

Before any connection/s are made, an application form needs to be completed and approved by Southern Water Services.

Please let me know if we can be of any further assistance in this matter.

Yours faithfully,




J. Sylvester
Developer services

Please note: -

The information provided above does not grant approval for any designs/drawings submitted for the capacity analysis. The results quoted above are only valid for 12 months from the date of issue of this letter.

SOUTHERN WATER

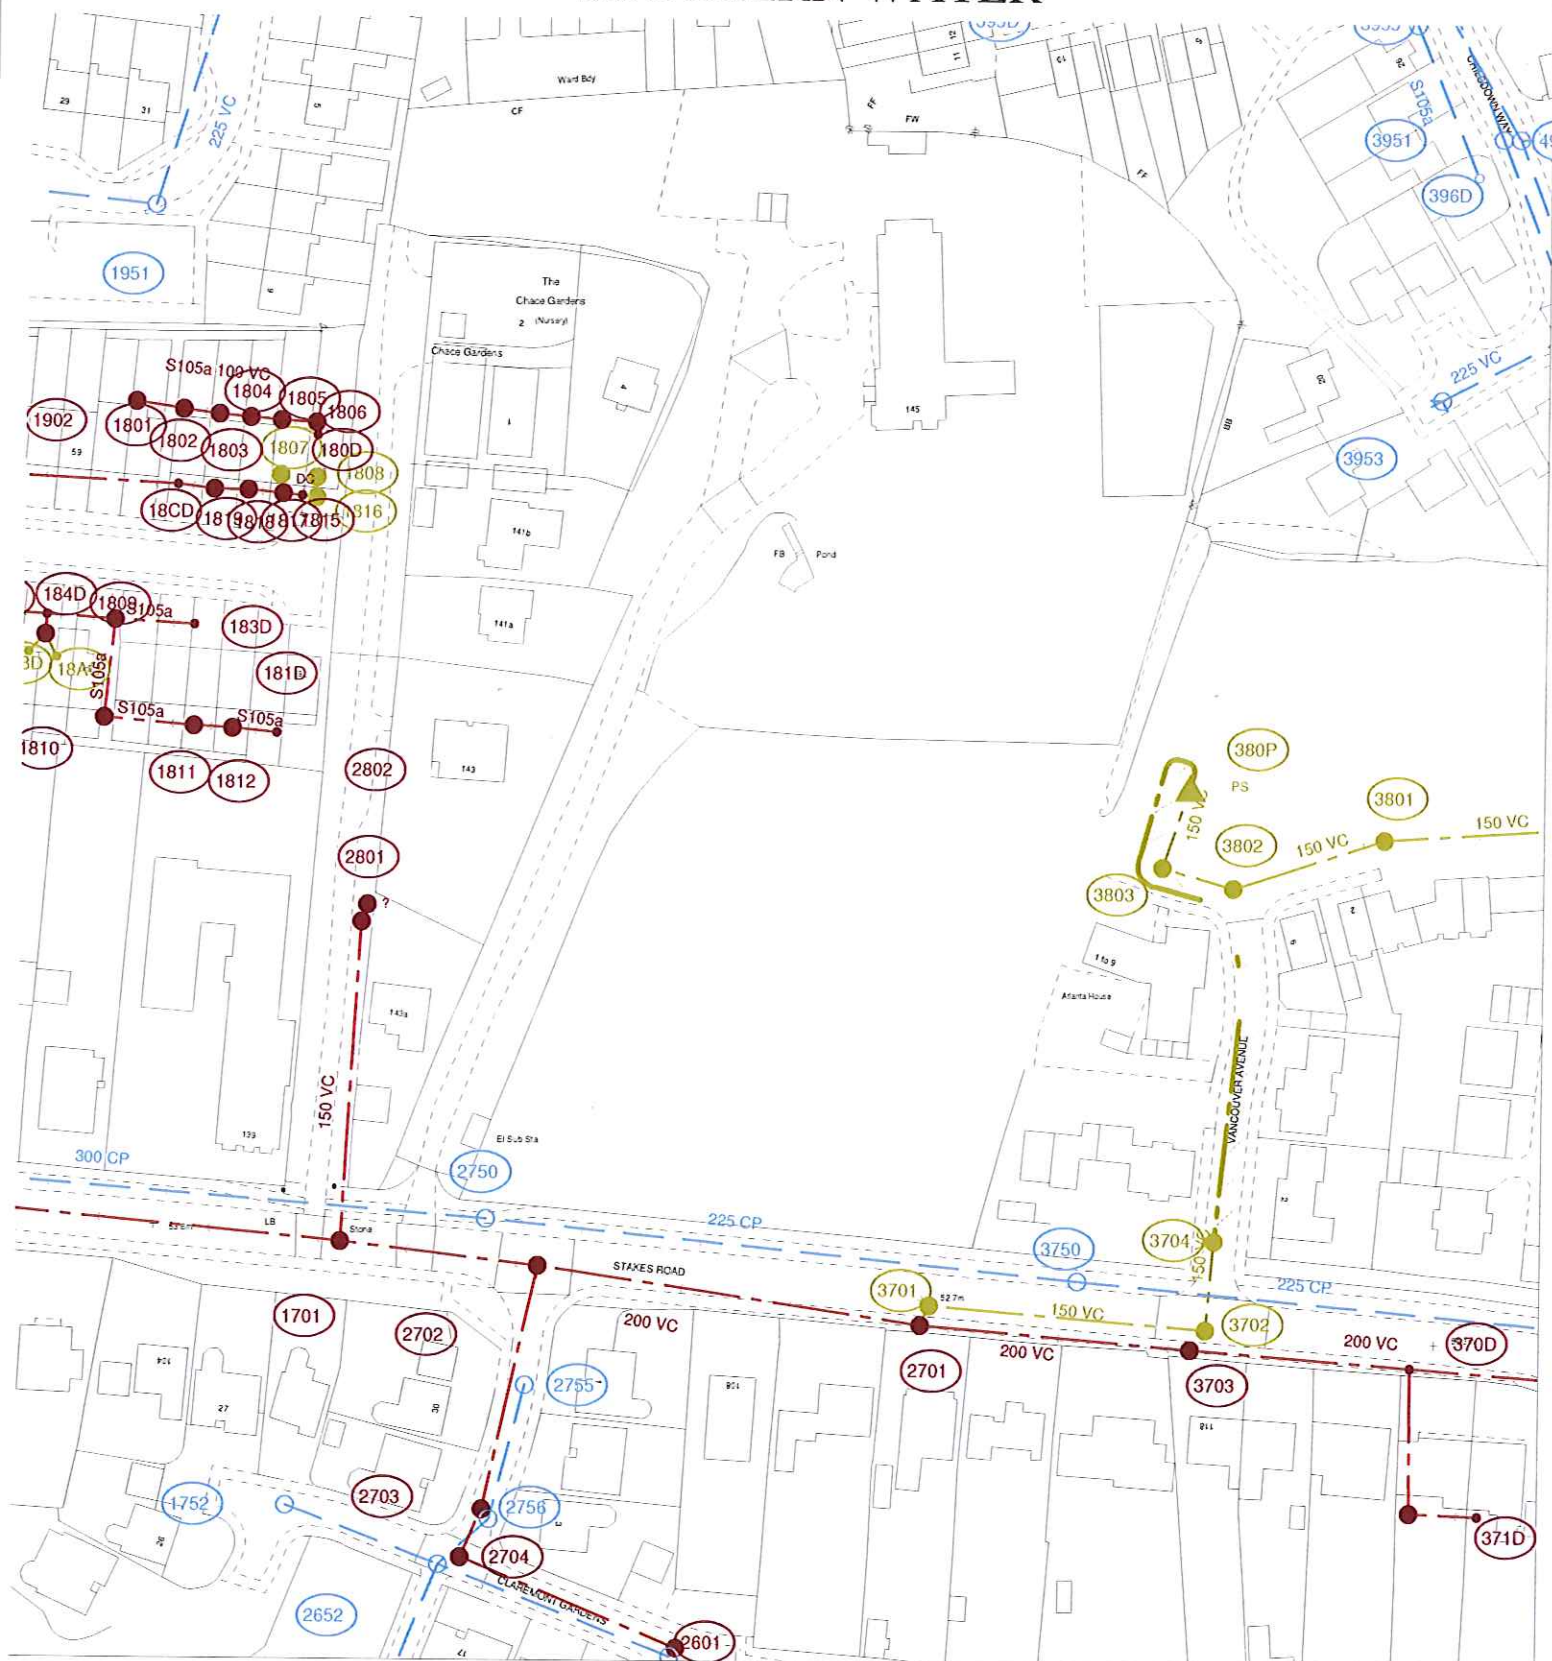

The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU6807NW

Scale: 1:1250

Sewer Plot

WARNING: BAC pipes are constructed of Bonded Asbestos Cement

WARNING: Unknown (UNK) materials may include Bonded Asbestos Cement



Printed By: giriyar

Date: 24-8-2015

Southern Water MapGuide Browser

Requested By:

