


Scale 1:150




**SOUTH ELEVATION
AS PROPOSED**

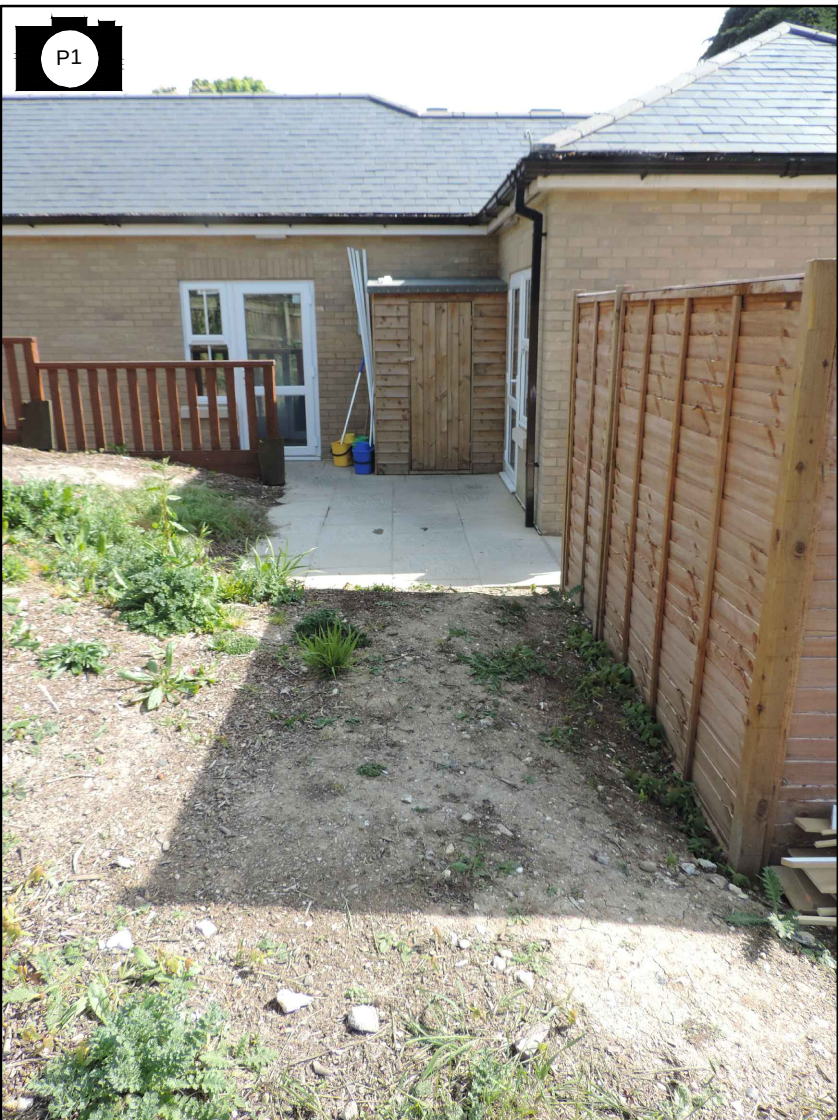


Existing area of hardstanding and disturbed ground is within the radially calculated RPA of tree 26, but no roots are anticipated to be present due to the present conditions and so the foundations of the proposed building will have no adverse impact on the health or vitality of the tree.


Scale 1:150

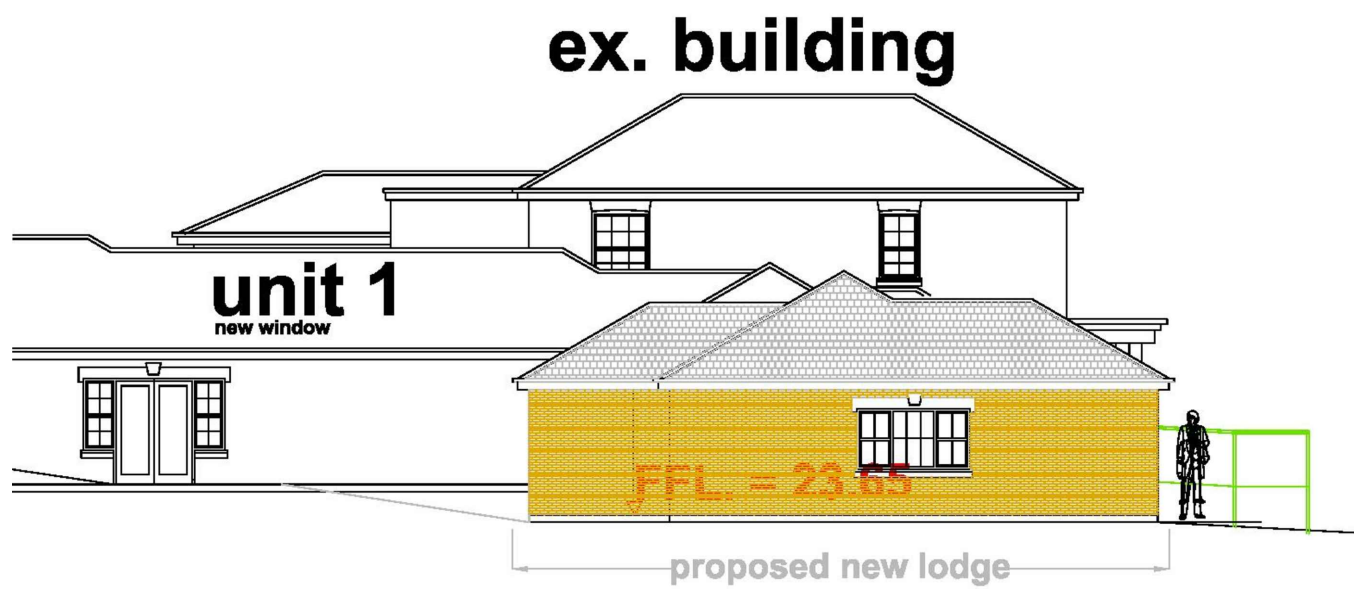

SECTION A-A LOOKING EAST

Tree schedule				
Tree No	Species	Category	RPA Radius	Tree Works
All retained trees				Carry out safety check and lift over site to 3-4m as necessary.
T24	Acacia	C	3.6	-
T25	Cypress	C	6.0	-
T26	Sycamore	B	8.1	-
T27	Sycamore	A	See Plan BT6	-
T28	Cypress	C	4.8	-
G32	Sycamore	C	1.8	-
T33	Sycamore	C	2.4	-
T34	Hornbeam	B	4.5	-
T35	Lime	B	4.8	-
T41	Beech	B	10.8	-

-  BS category A Tree of high quality
-  BS category B Trees of moderate quality
-  BS category C Trees of low quality
-  Proposed layout
-  Estimated tree positions not included on original land survey and /or adjusted crown spreads
-  Construction exclusion zone (CEZ) to be protected by fencing and/or ground protection
-  Root protection area (RPA) boundaries for category A and B trees
-  Root protection area (RPA) boundaries for category C trees

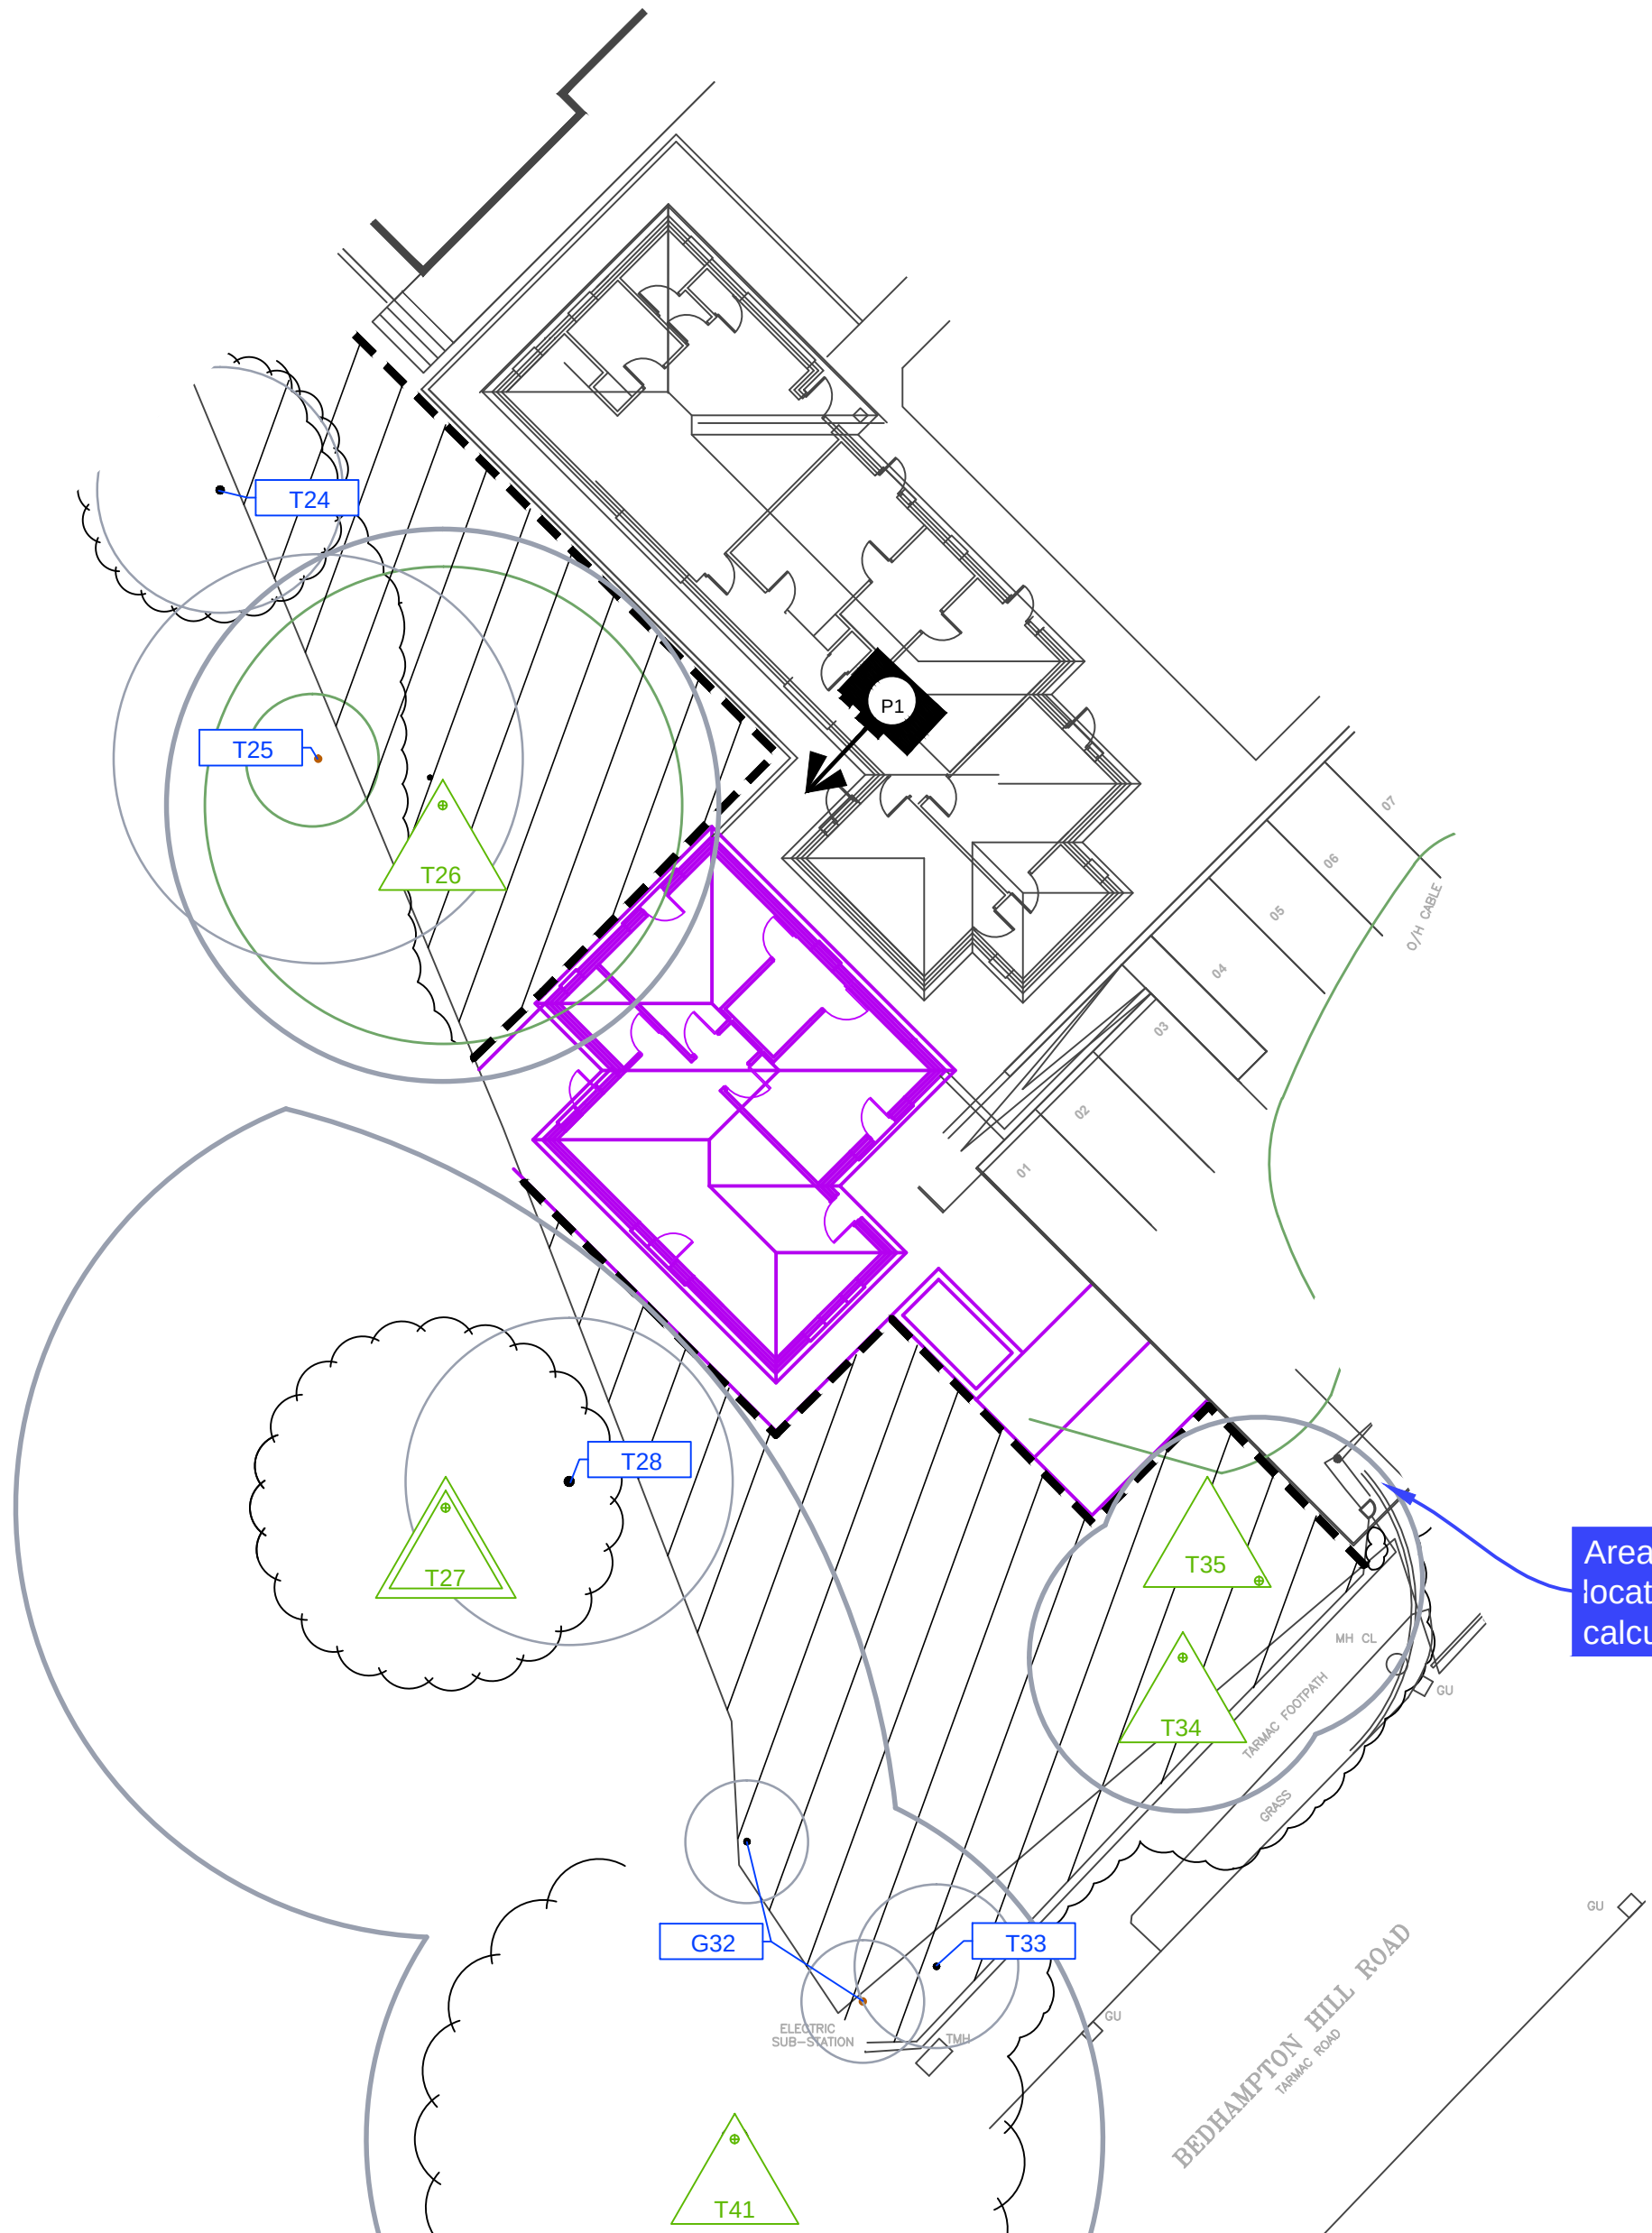

Area of existing hardstanding located within the radially calculated RPA of tree 35.

This drawing contains:
Topo - (June 04 2013) 94857.0001
Layout = (April-27-2017) 17/301/P01 Rev B
Diagram 1 = (April-27-2017) 17/301/P02 Rev A
Diagram 2 = (April-27-2017) 17/301/P03 Rev A