

PROPOSED SINGLE STOREY REAR ADDITION. 15, MENGHAM AVE, HAYLING ISLAND, HANTS. FOR MR & MRS K. HURL.

ELECTRICAL INSTALLATION BY APPROVED
CERTIFICATED ELECTRICIAN TO COMPLY WITH
APPROVED DOCUMENT P.
CERTIFICATE TO BE ISSUED ON COMPLETION OF WORK.
BY COMPETENT APPROVED CERTIFICATED ELECTRICIAN
USE ENERGY EFFICIENT LIGHT BULBS AND FITTINGS.

WALLS FACEBRICK TO MATCH EXTERNALLY 100MM
CAVITY WITH 50MM CELOTEX INSULATION CLIPPED TO
AN INSIDE SKIN OF 100MM CELCON SOLAR BLOCKS
INTERNALLY RENDER AND SET TIE WALLS WITH
APPROVED STAINLESS-STEEL WALL TIES EVERY 750MM
HORIZONTALLY AND 450MM VERTICALLY

CATNIC LINTELS OVER ALL NEW OPENINGS, SIZE IN
ACCORDANCE WITH THE MANUFACTURERS SPAN
TABLES MINIMUM 150MM END BEARINGS.


STRAP DOWN NEW ROOF WITH MILD STEEL ANCHORS
MINIMUM CROSS SECTION 30MMX5MM AND AT 1.2M
CENTRES.
CLOSE TOP OF NEW CAVITY WALLS WITH BRICKWORK.

WINDOWS TO BE DOUBLE AND TO ACHIEVE A U VALUE
OF 1.6W/M2K TO GIVE A MINIMUM 1/20TH OF THE
FLOOR AREA AS OPENING. PROVIDE 10,000 MM SQ.
TRICKLE VENTS TO ALL NEW ROOMS. ANY LOW-LEVEL
GLAZING TO CRITICAL AREAS IN DOORS/WINDOWS
SIDELIGHTS ETC. TO BE SAFETY GLASS TO B.S 6206

RAINWATER DISPOSAL VIA 100MM DIAMETER GUTTERS
AND DOWNPIPE TO PICK UP INTO EXISTING SURFACE
WATER DRAINS IF FOUND AVAILABLE TO LA APPROVAL
ON SITE, ALTERNATIVELY TO NEW SOAKAWAYS MIN 5M
FROM ANY BUILDING AND MIN 1M/3

PROVIDE MECHANICAL VENTILATION TO NEW KITCHEN
AND BATHROOM ALSO UTILITY AND SHOWER DUCTED TO
THE EXTERNAL AIR MINIMUM CAPACITY 60 LITRES/SEC

NEW DRAINS TO BE 100MM DIAMETER APPROVED
PLASTIC LAID 1.40 BEDDED AND SURROUNDED IN
150MM PEASHINGLE HAUNCH IN 150MM CONCRETE
UNDER BUILDING PROTECT WITH LINTELS THROUGH
FOUNDATIONS

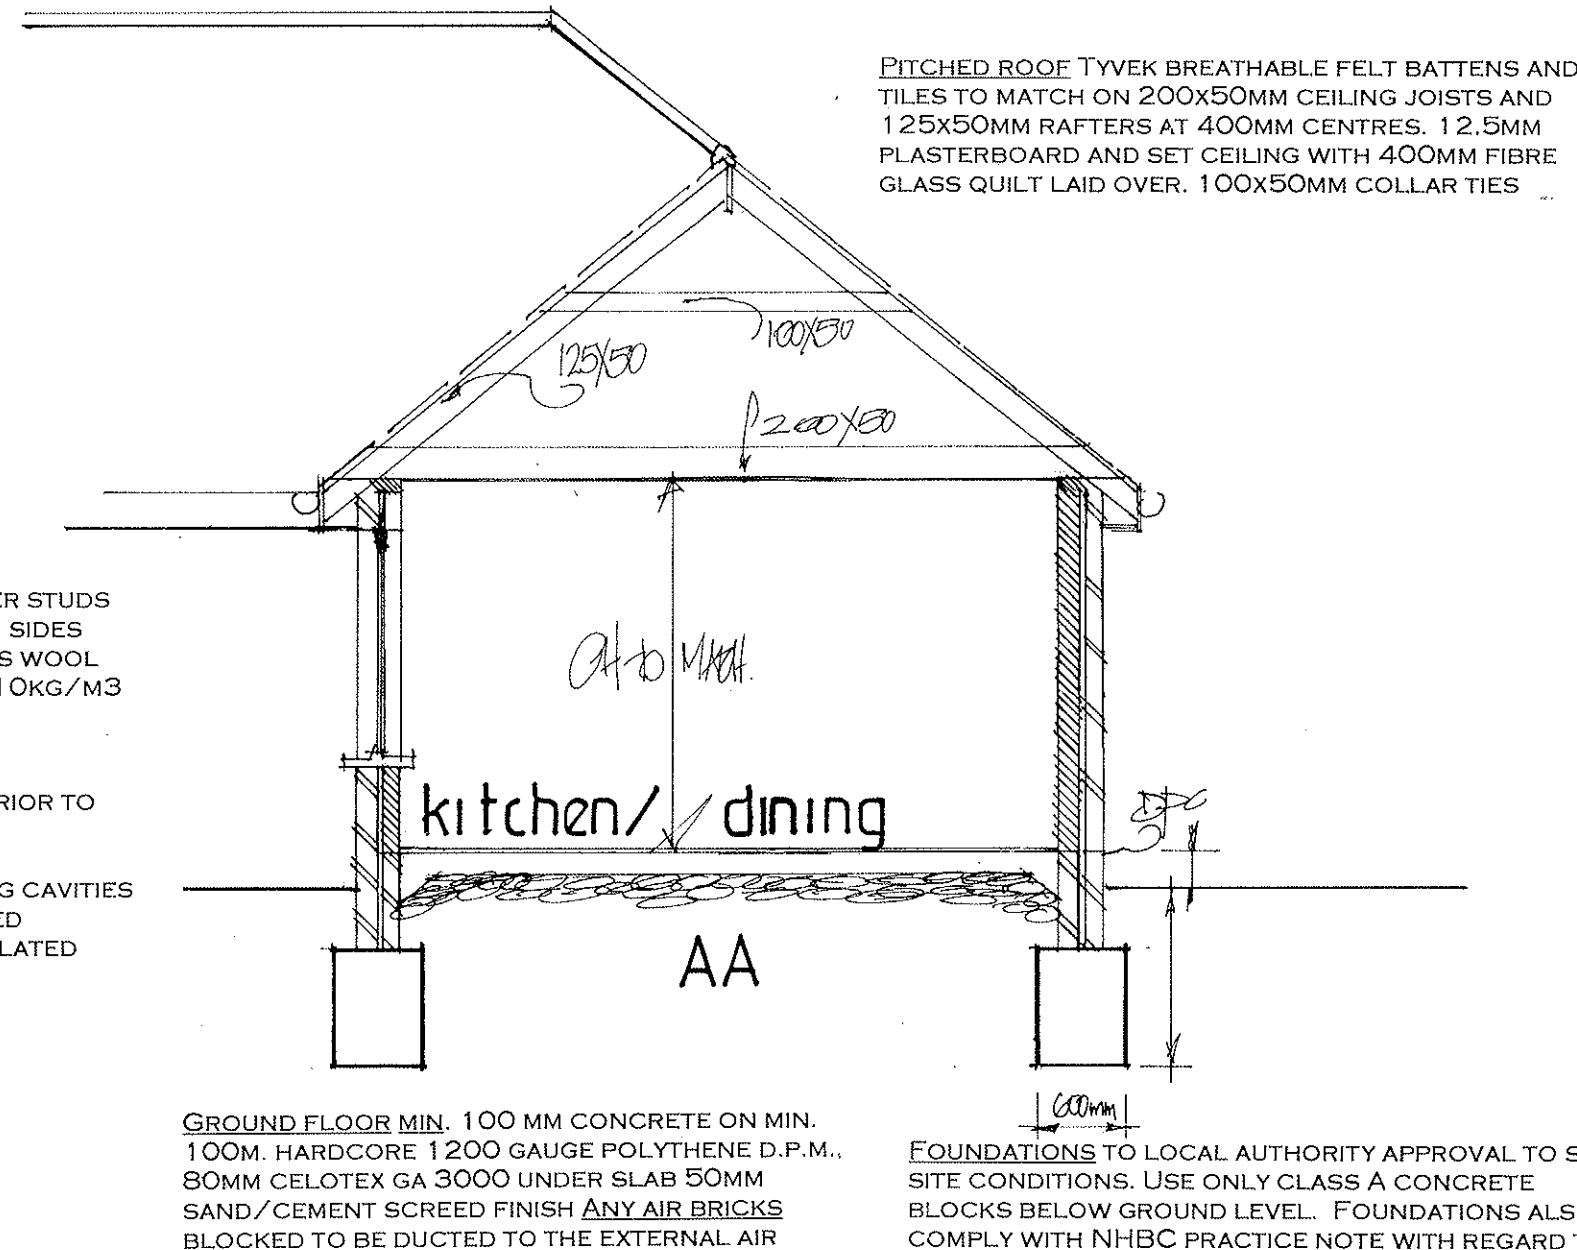

AMENDED
date may 22
scale 1:50

SECTION DRAWING AA

PETER J. WALKER
ISLAND DESIGN
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9AN
TEL : 02392467571