




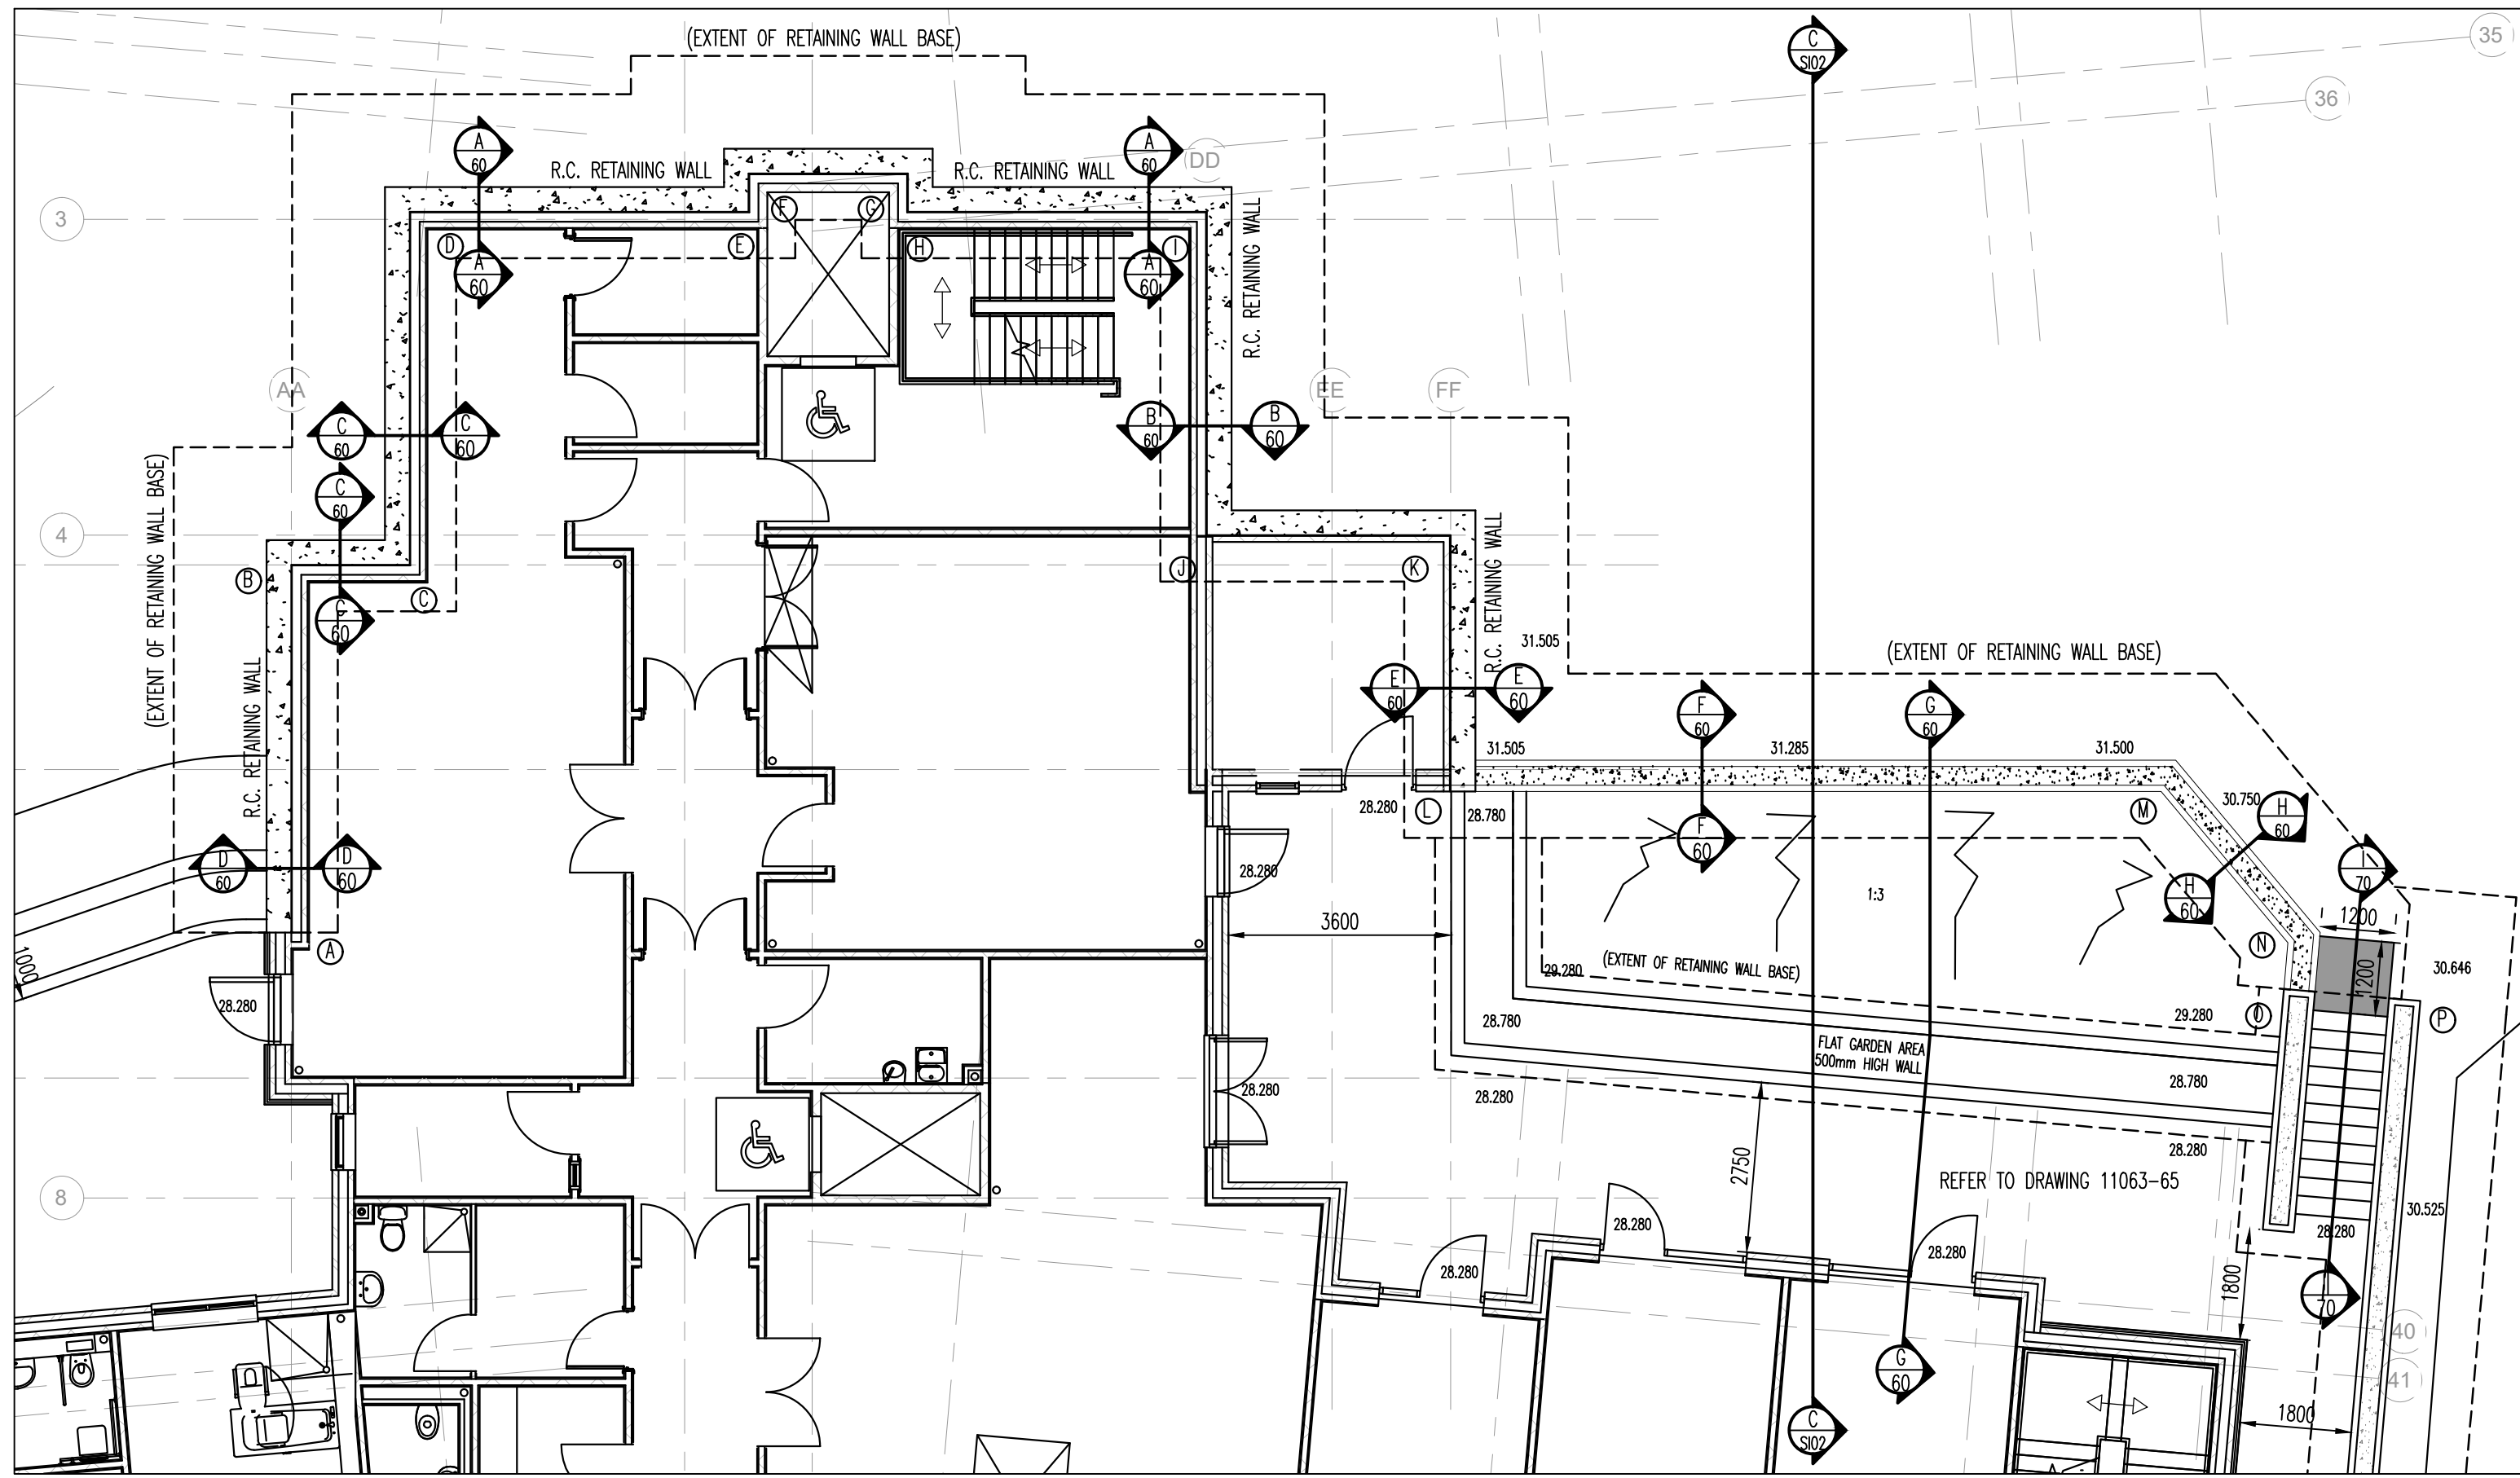


RETAINING WALL PLAN
(SCALE 1:100)

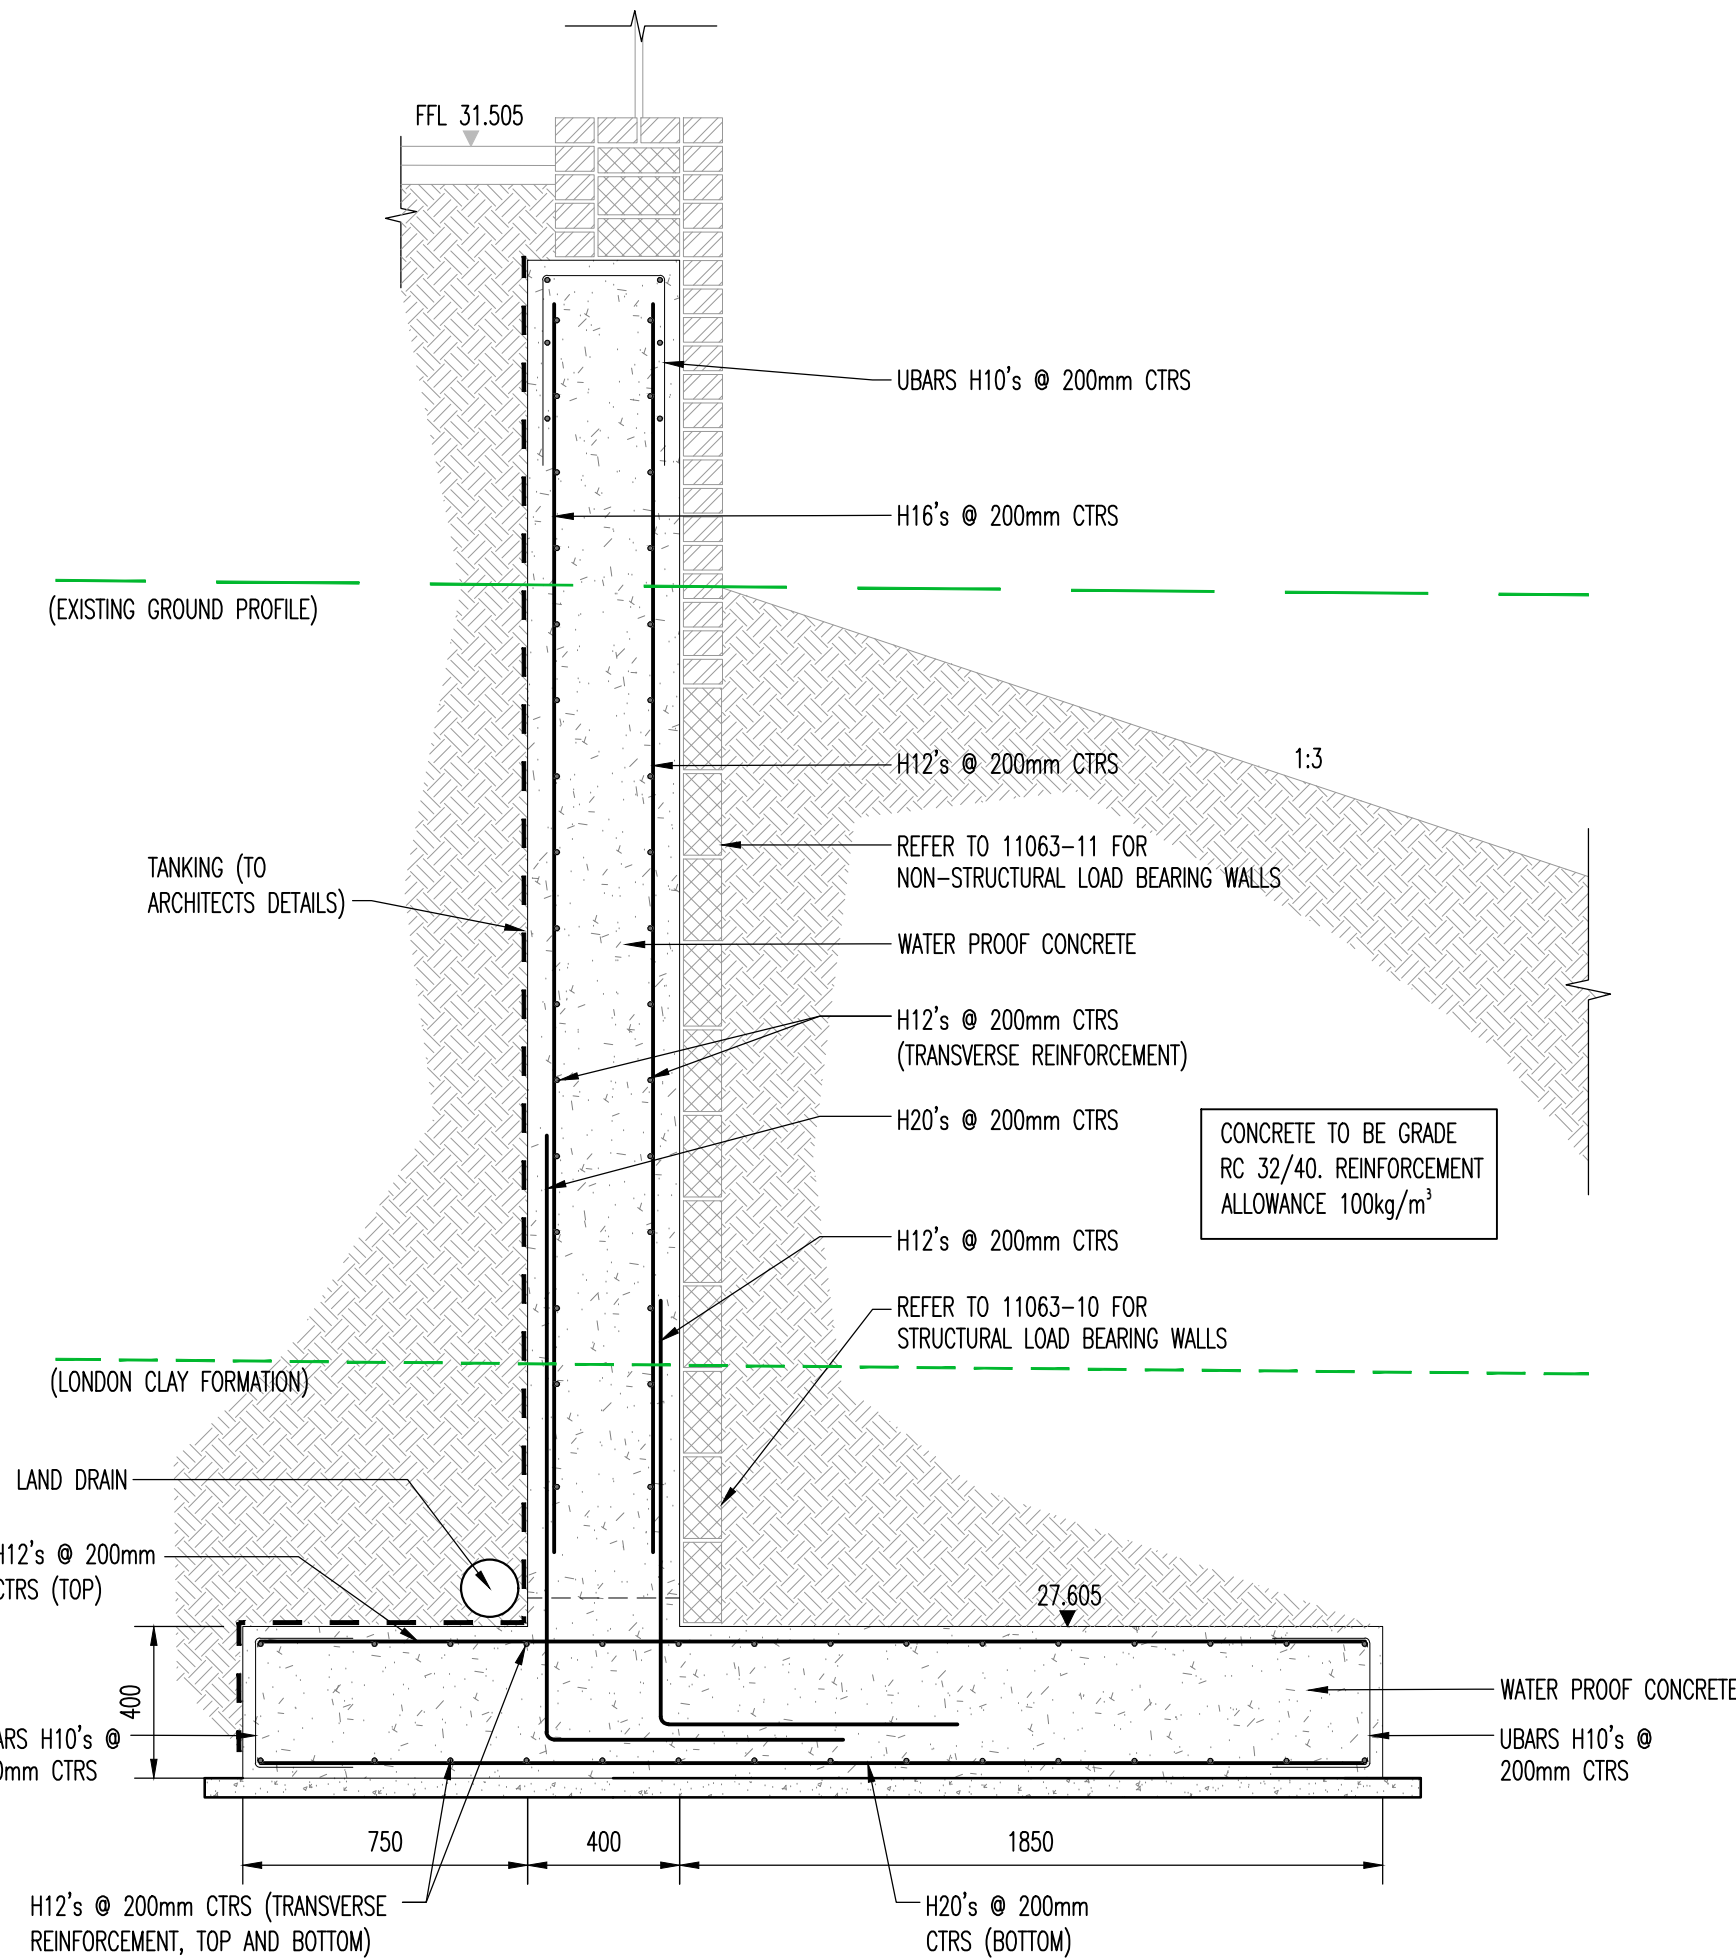

SECTION F-F
(SCALE 1:20)

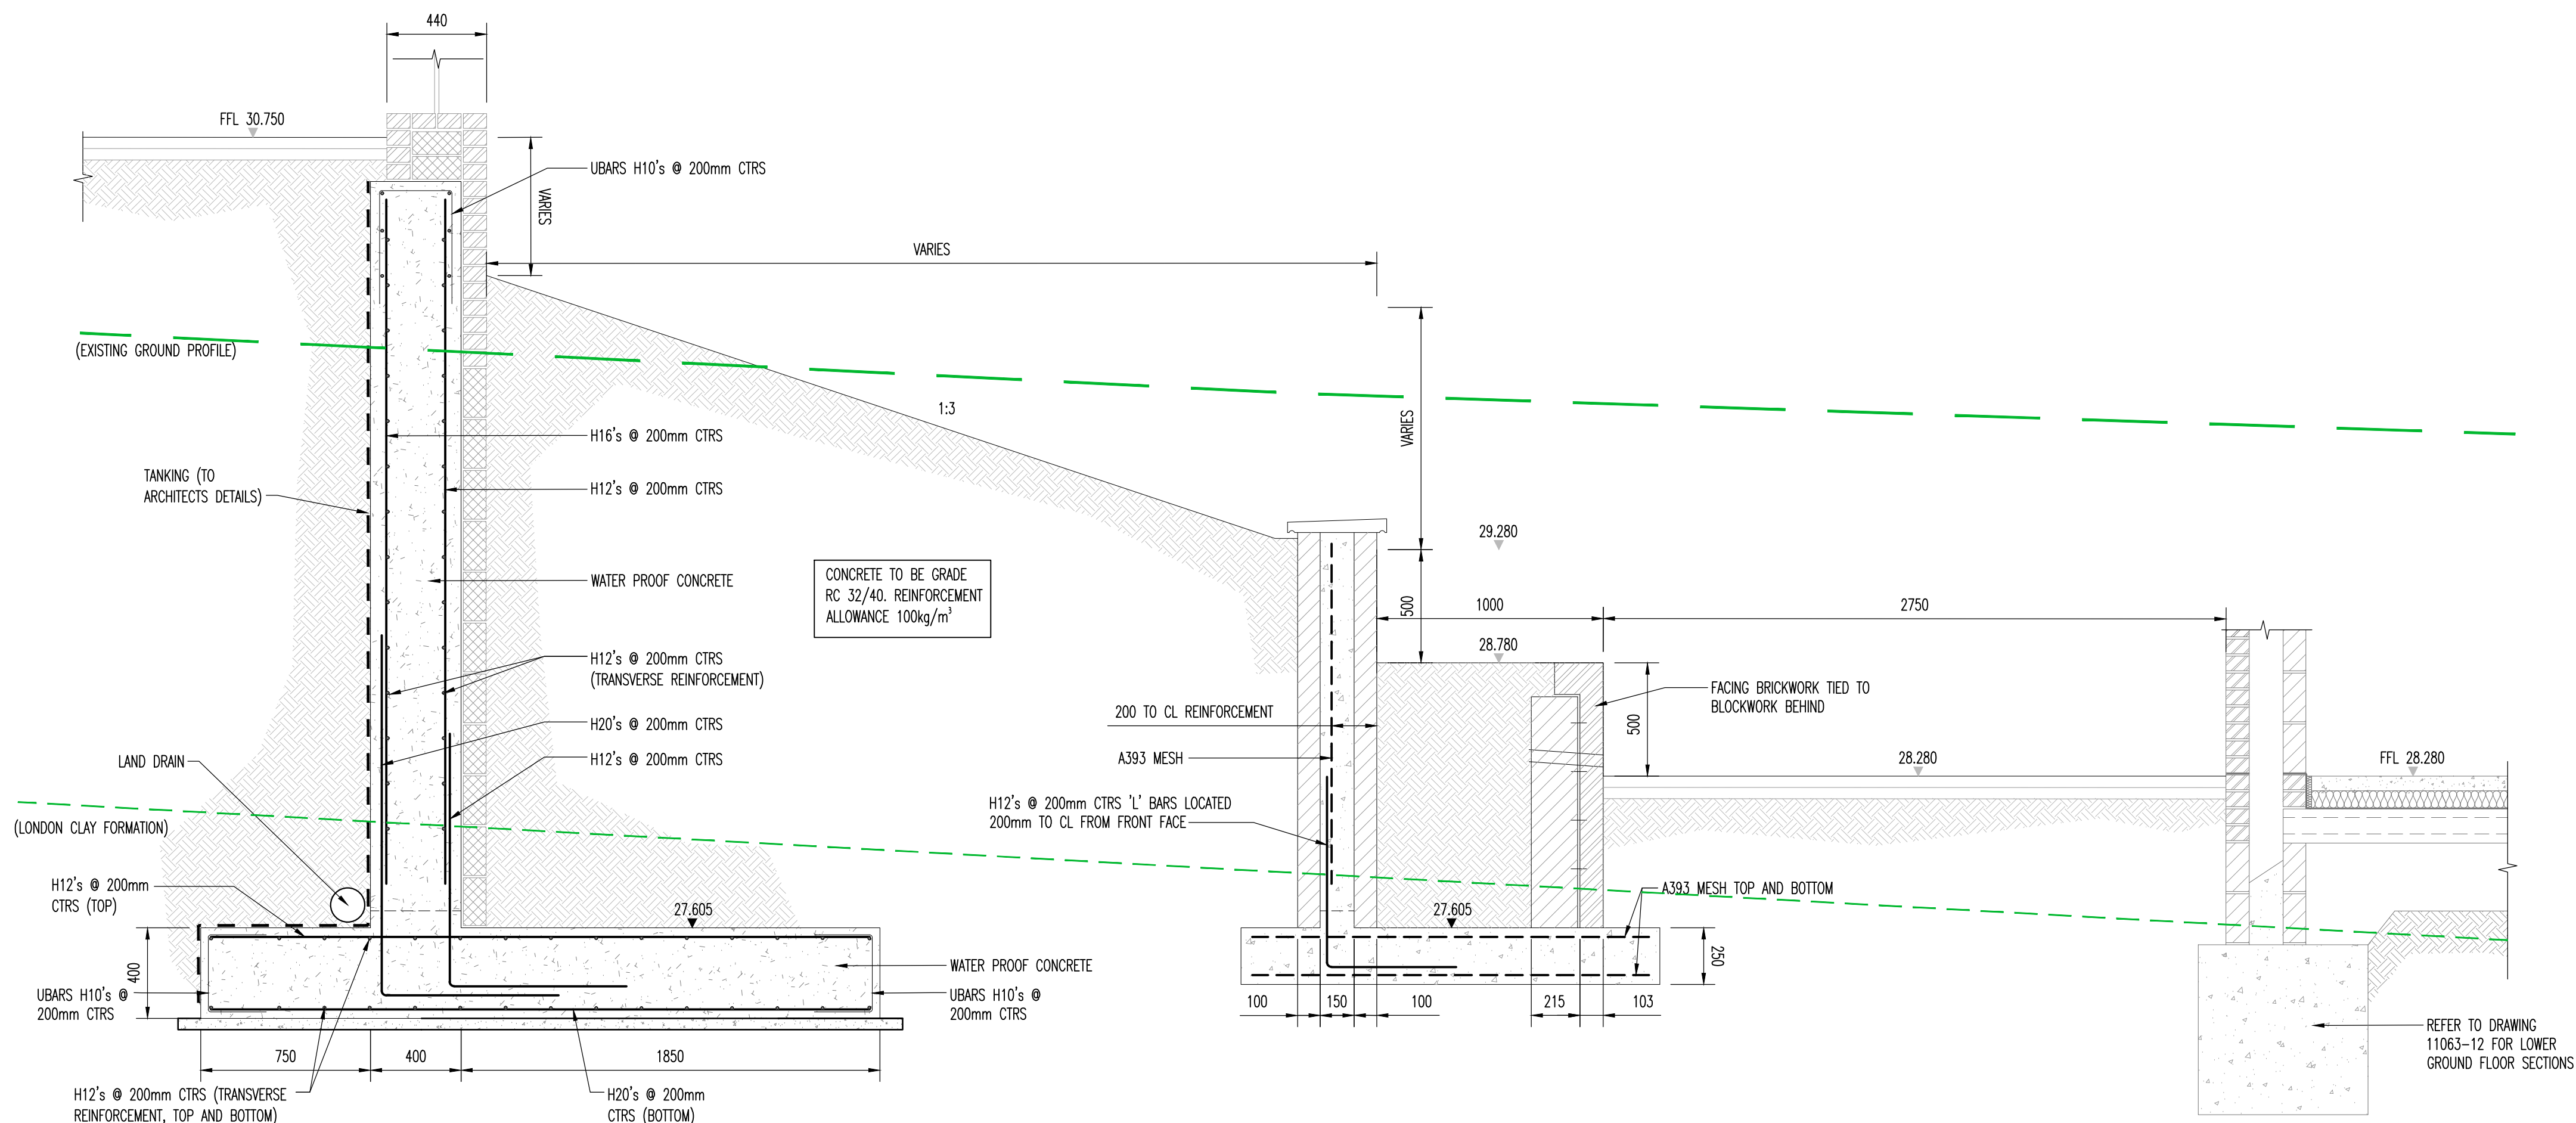

SECTION G-G
(SCALE 1:20)

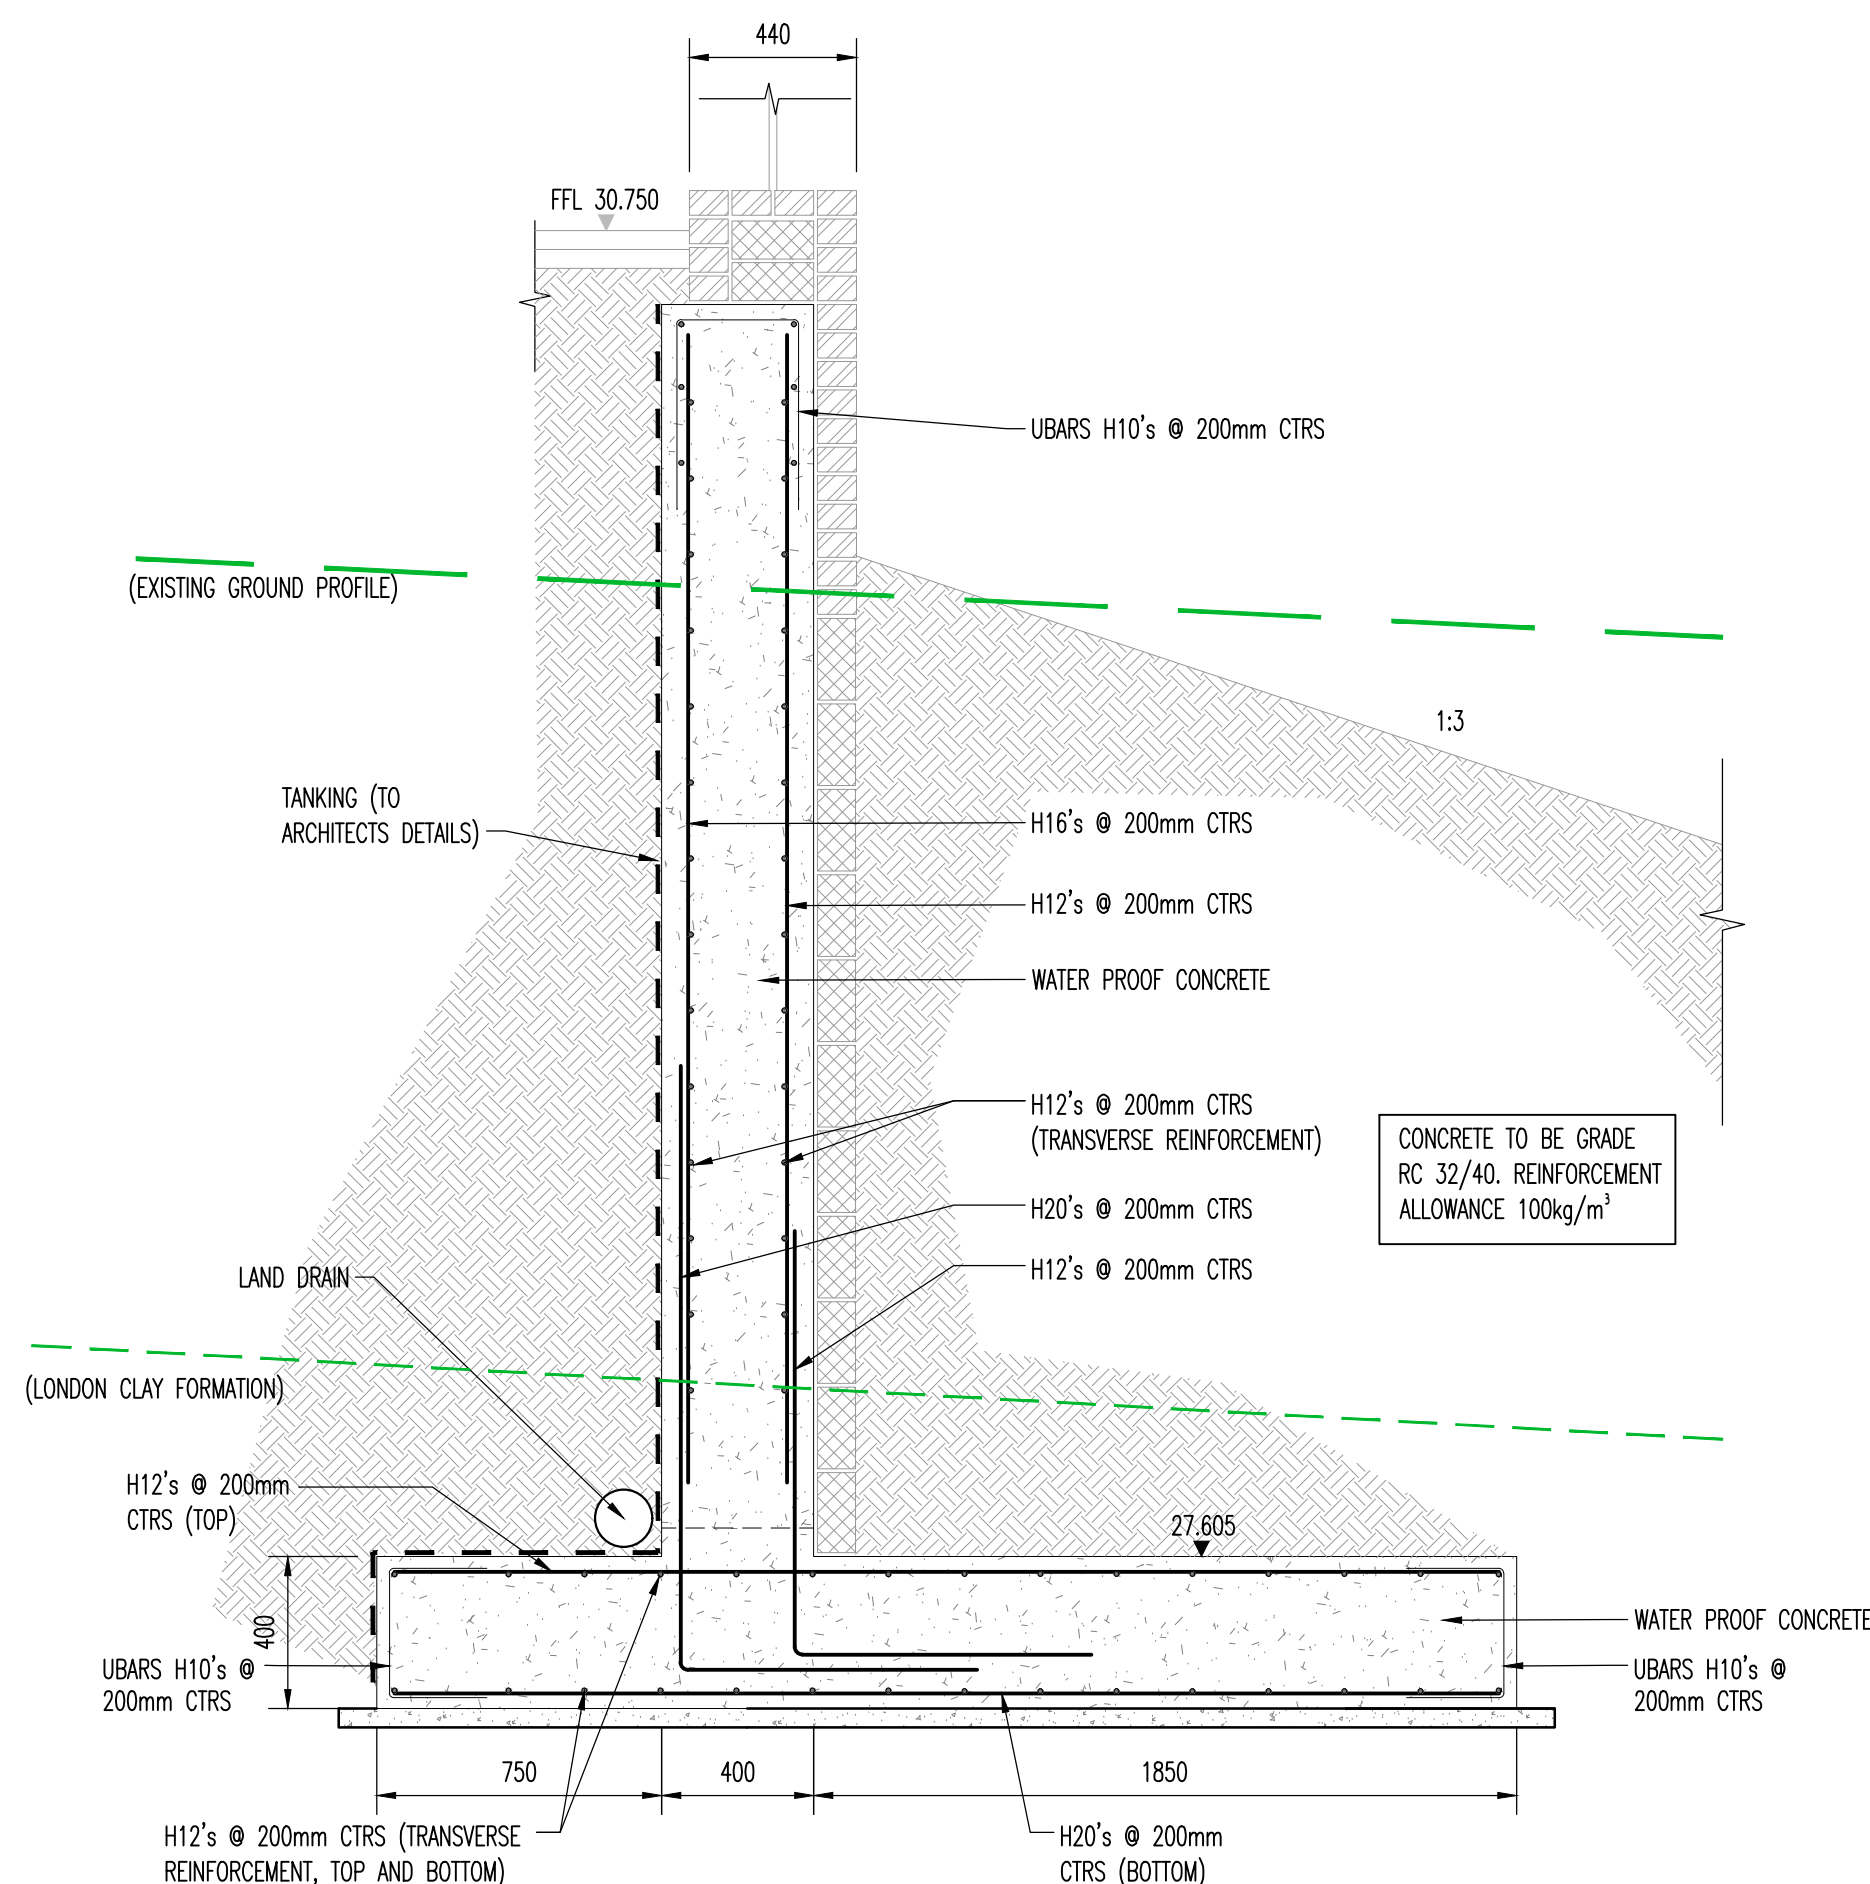

SECTION H-H
(SCALE 1:20)

- NOTES:
1. ALL MASONRY WORKS TO BE IN ACCORDANCE WITH BS 5628
 2. ALL CONCRETE WORKS TO BE IN ACCORDANCE WITH BS 8110.
 3. MAXIMUM HEIGHT OF UNPROPPED MASONRY FOR GROUTING NOT TO EXCEED 0.45m.
 4. CONCRETE INFILL AND GROUT TO BE EITHER FOLLOWING PROPORTIONS BY VOLUME OF DRY MATERIAL 1:3 TO 1/4 4:3:2 CEMENT/LIME/SAND/10mm MAX SIZE AGGREGATE OR A PRESORBED OR DESIGNED MIX OF GRADE C35 WITH 10mm AGGREGATE AND SLUMP BETWEEN 75mm AND 175mm/MIXTURES TO BE IN ACCORDANCE WITH CLAUSE 15 BS 5628 PART 2
 5. MORTAR TO BE TABLE 1 BS 5628 PART 2 CLASS M6

NOTES

1. DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS ONLY, IF IN DOUBT ASK.
2. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS AND ARCHITECTS DRAWINGS AND SPECIFICATIONS.

T1	ISSUED FOR TENDER	JA
07.06.24		NR
DATE	COMMENT	BY
Client: ANAVO DEVELOPMENTS LIMITED		
Project Title: HAVANT : HAVANT CARE HOME BARTONS ROAD, HAVANT		
Drawing Title: LOWER GROUND FLOOR RETAINING WALL SECTIONS SHEET 2		
Drawn By: JA	Scale: 1:20, 1:100 @ A1	
Date: APRIL 2024	Drawing Number:	Rev:
Checked By: NR	11063-61	T1
Date: APRIL 2024		
Drawing Status: TENDER		
NJP Consulting Engineers Limited 20 St Andrews Crescent Cireffit CT10 3DD Tel: 029 2072 9500 Email: info@njpuk.com Web: www.njpuk.com		