




ELEVATIONAL SECTION ALONG RETAINING WALL
(SCALE 1:50)

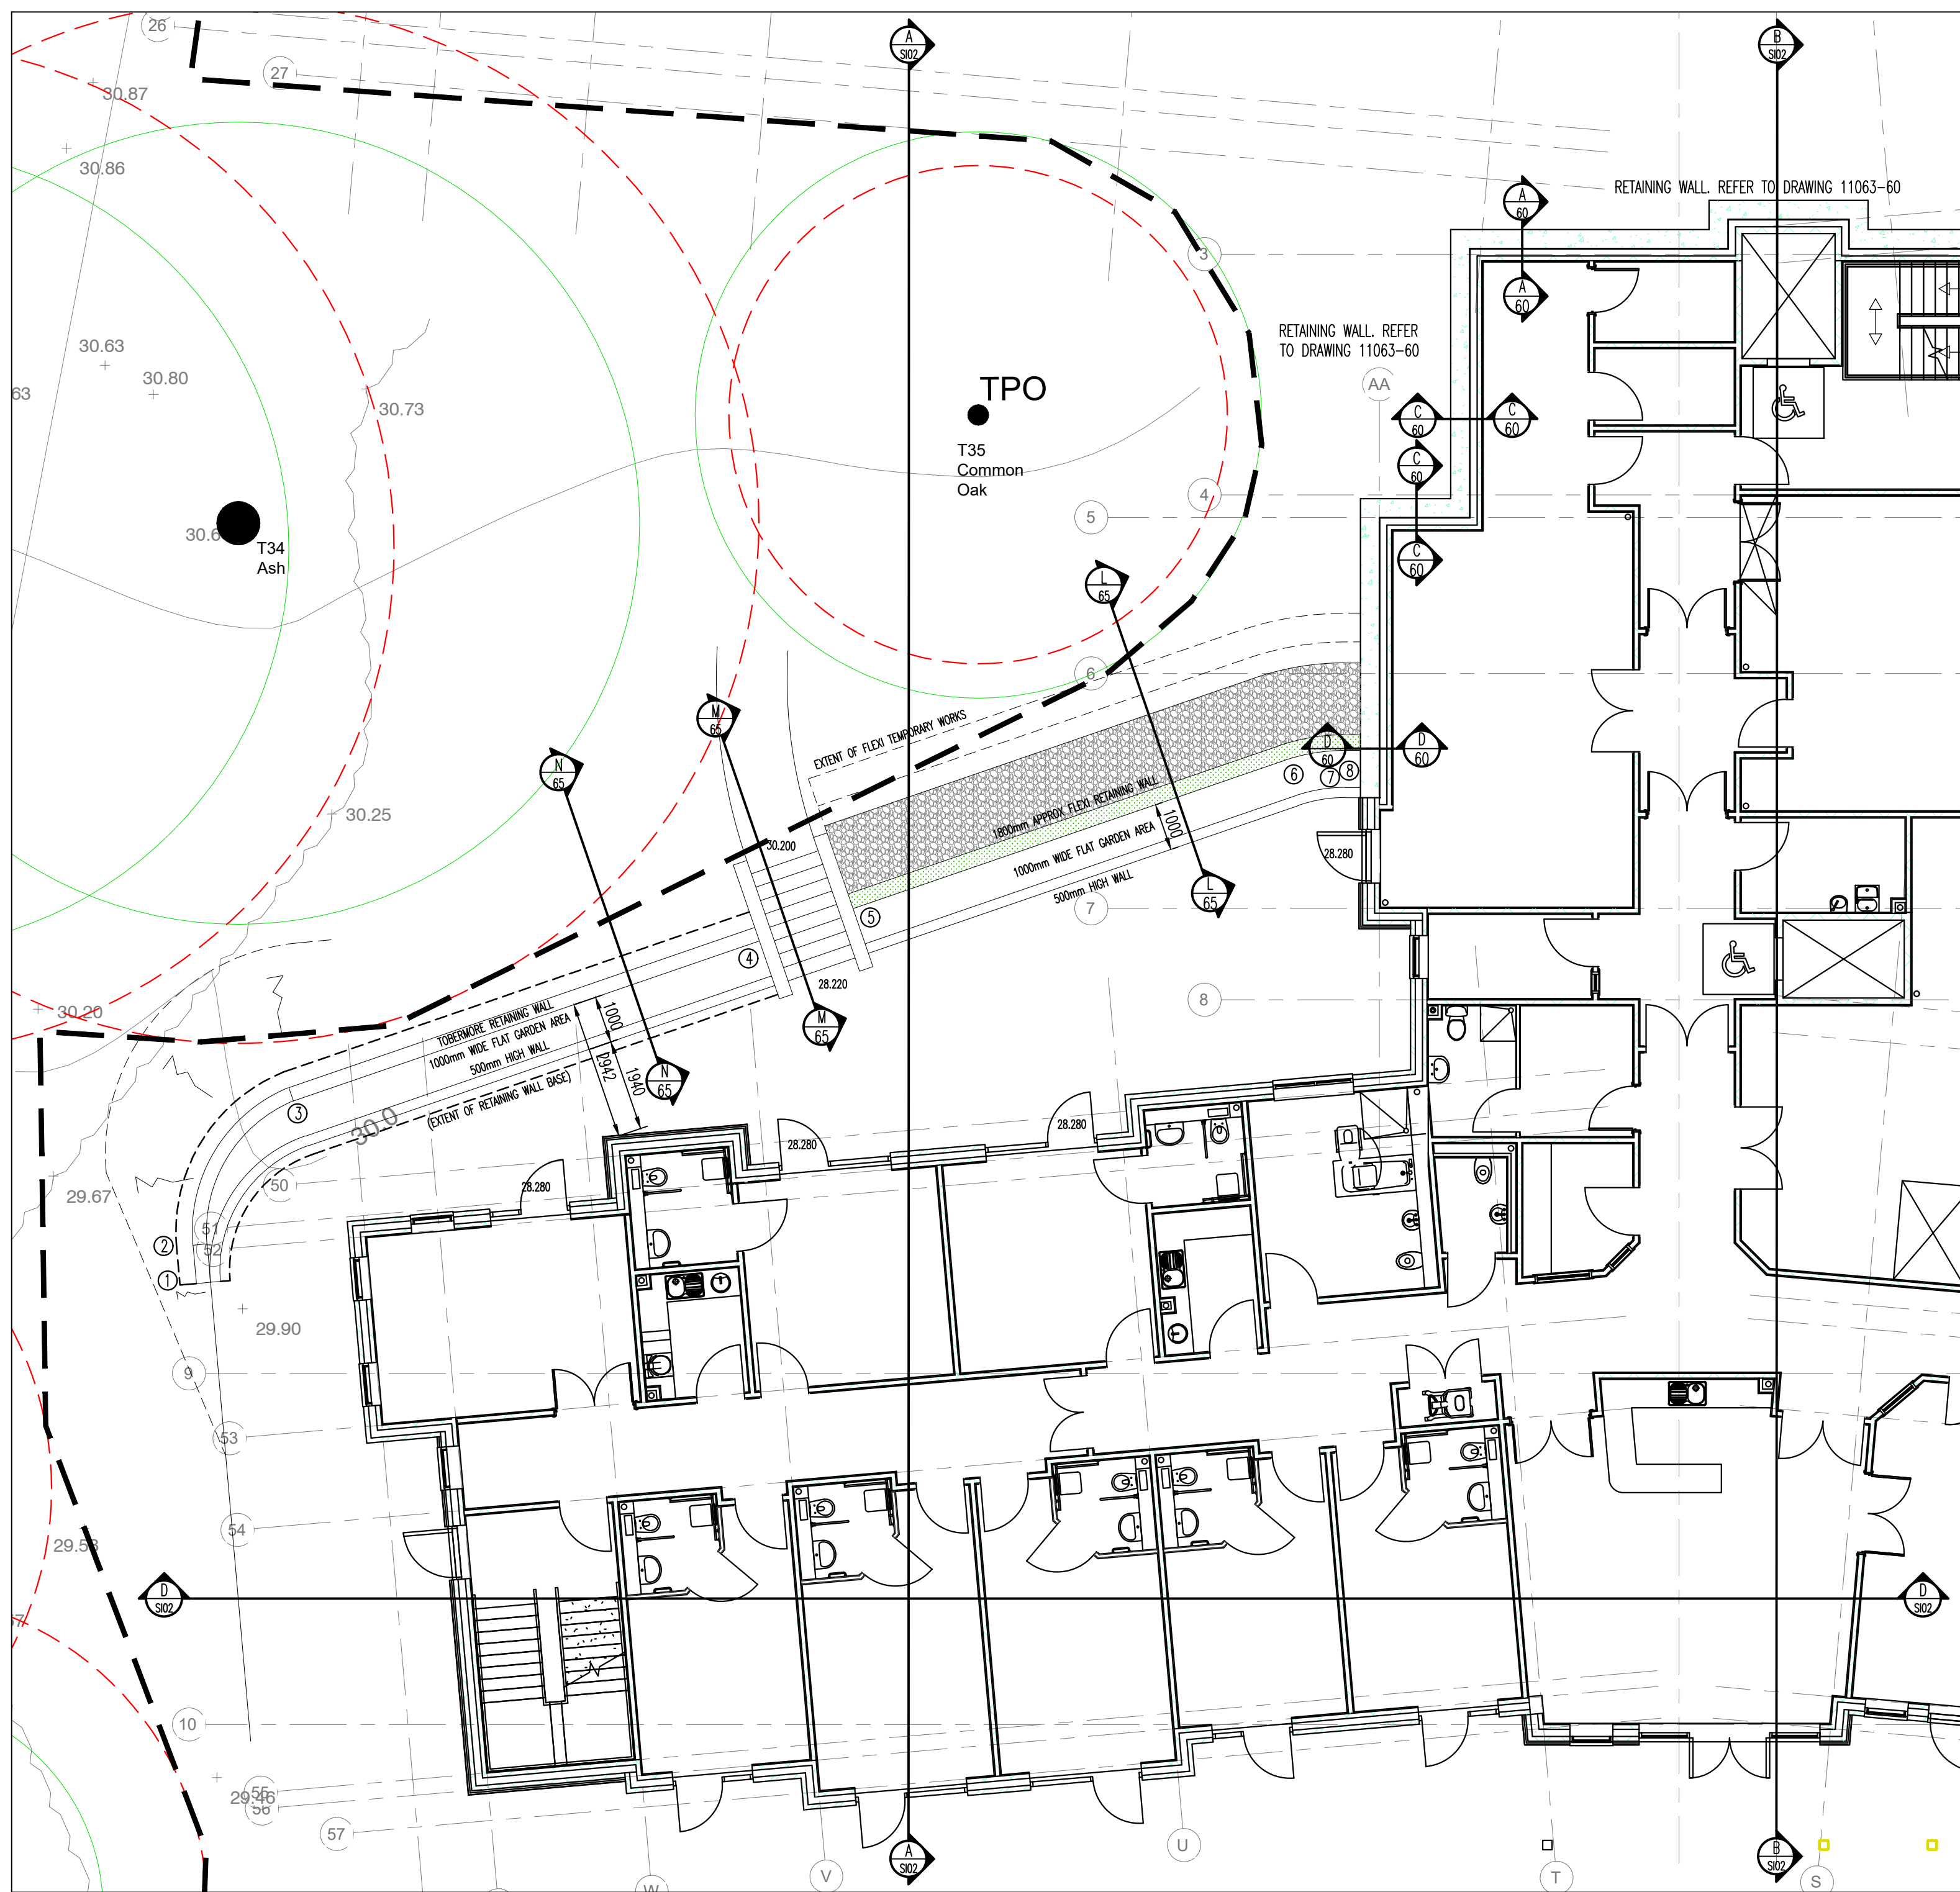


RETAINING WALL PLAN
(SCALE 1:100)

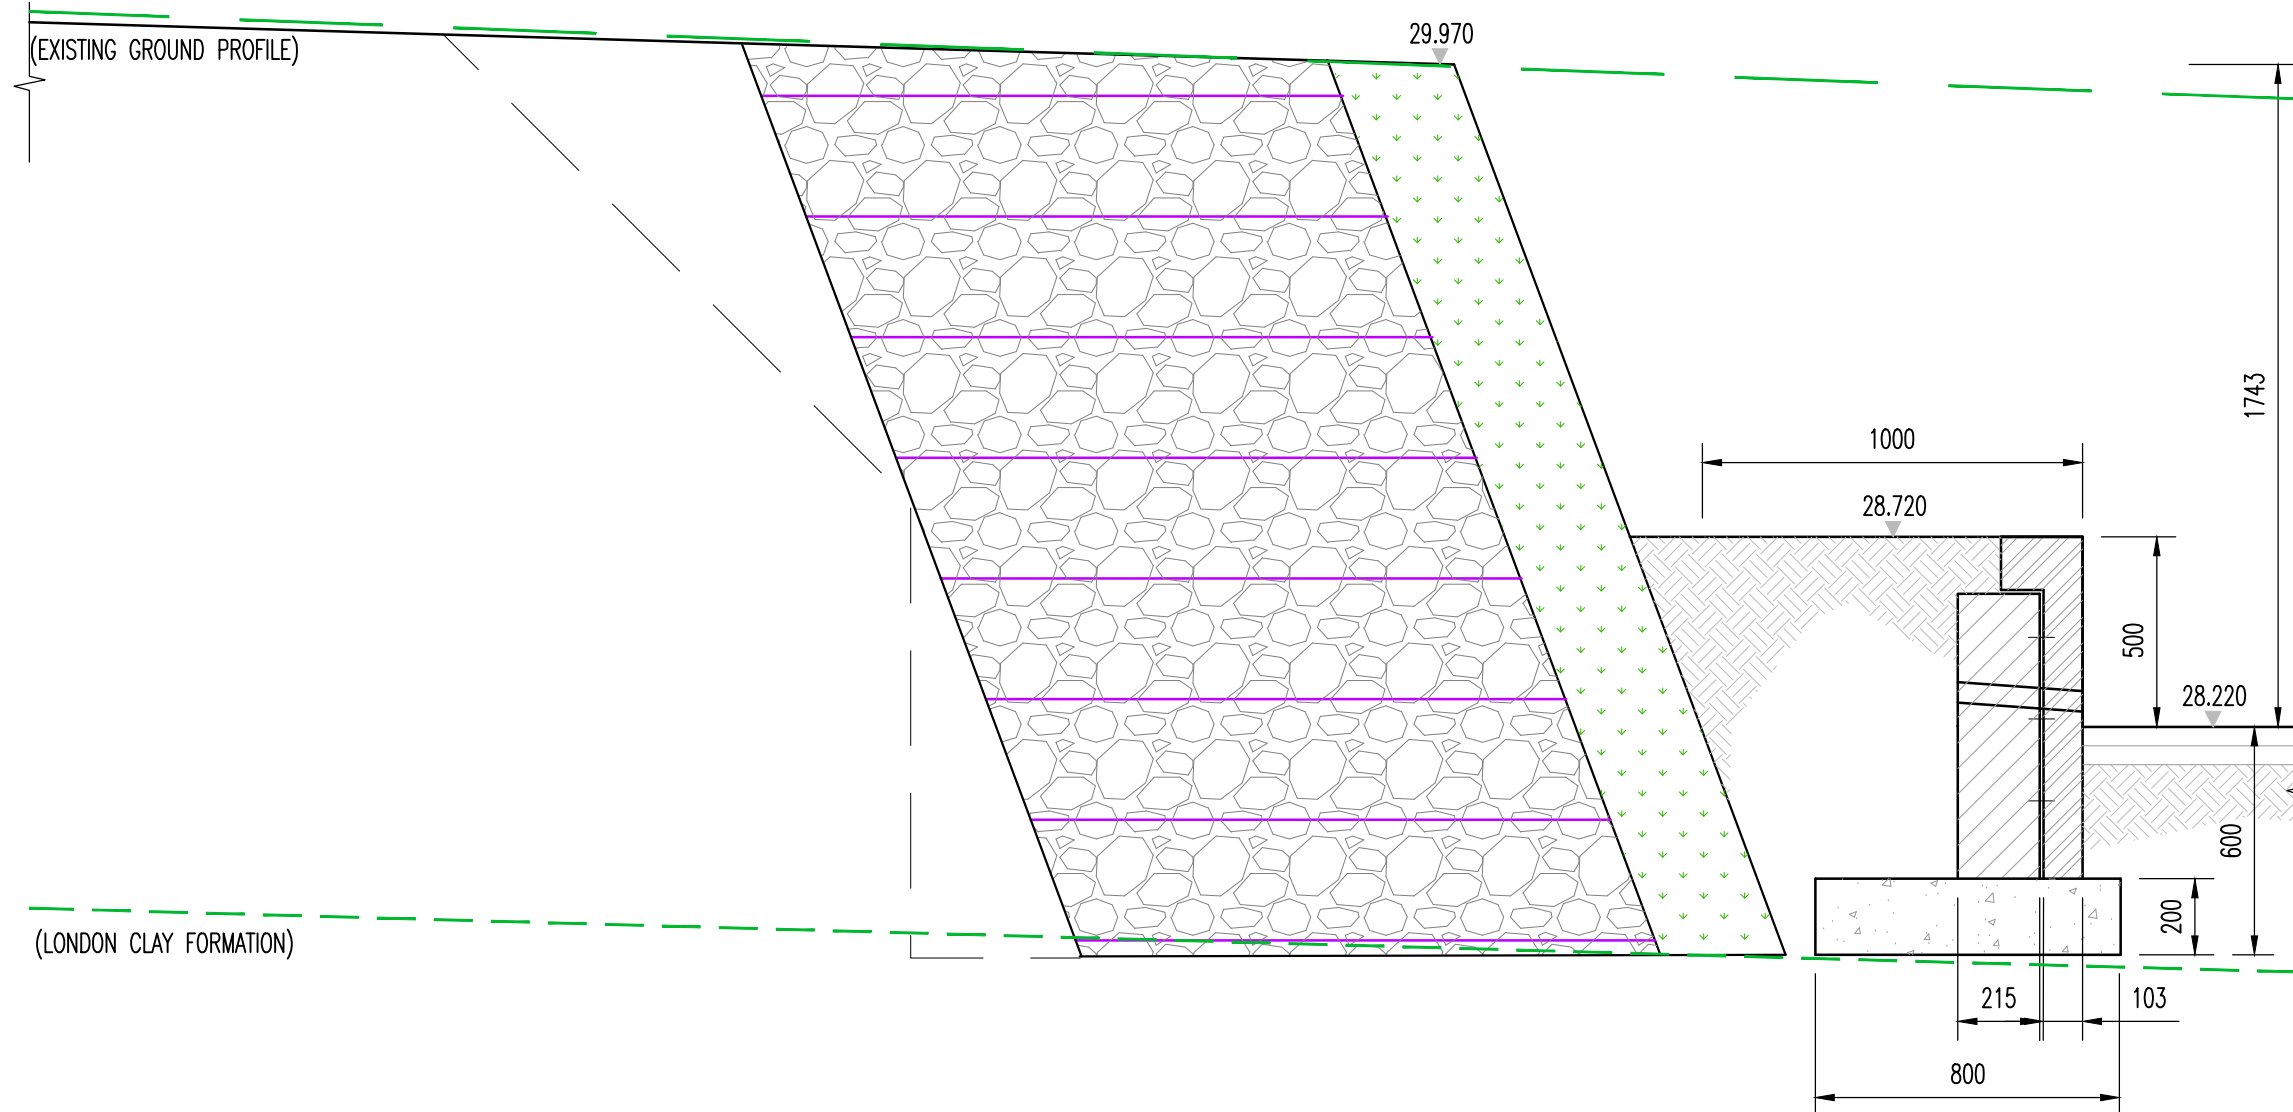

SECTION L-L
(SCALE 1:20)

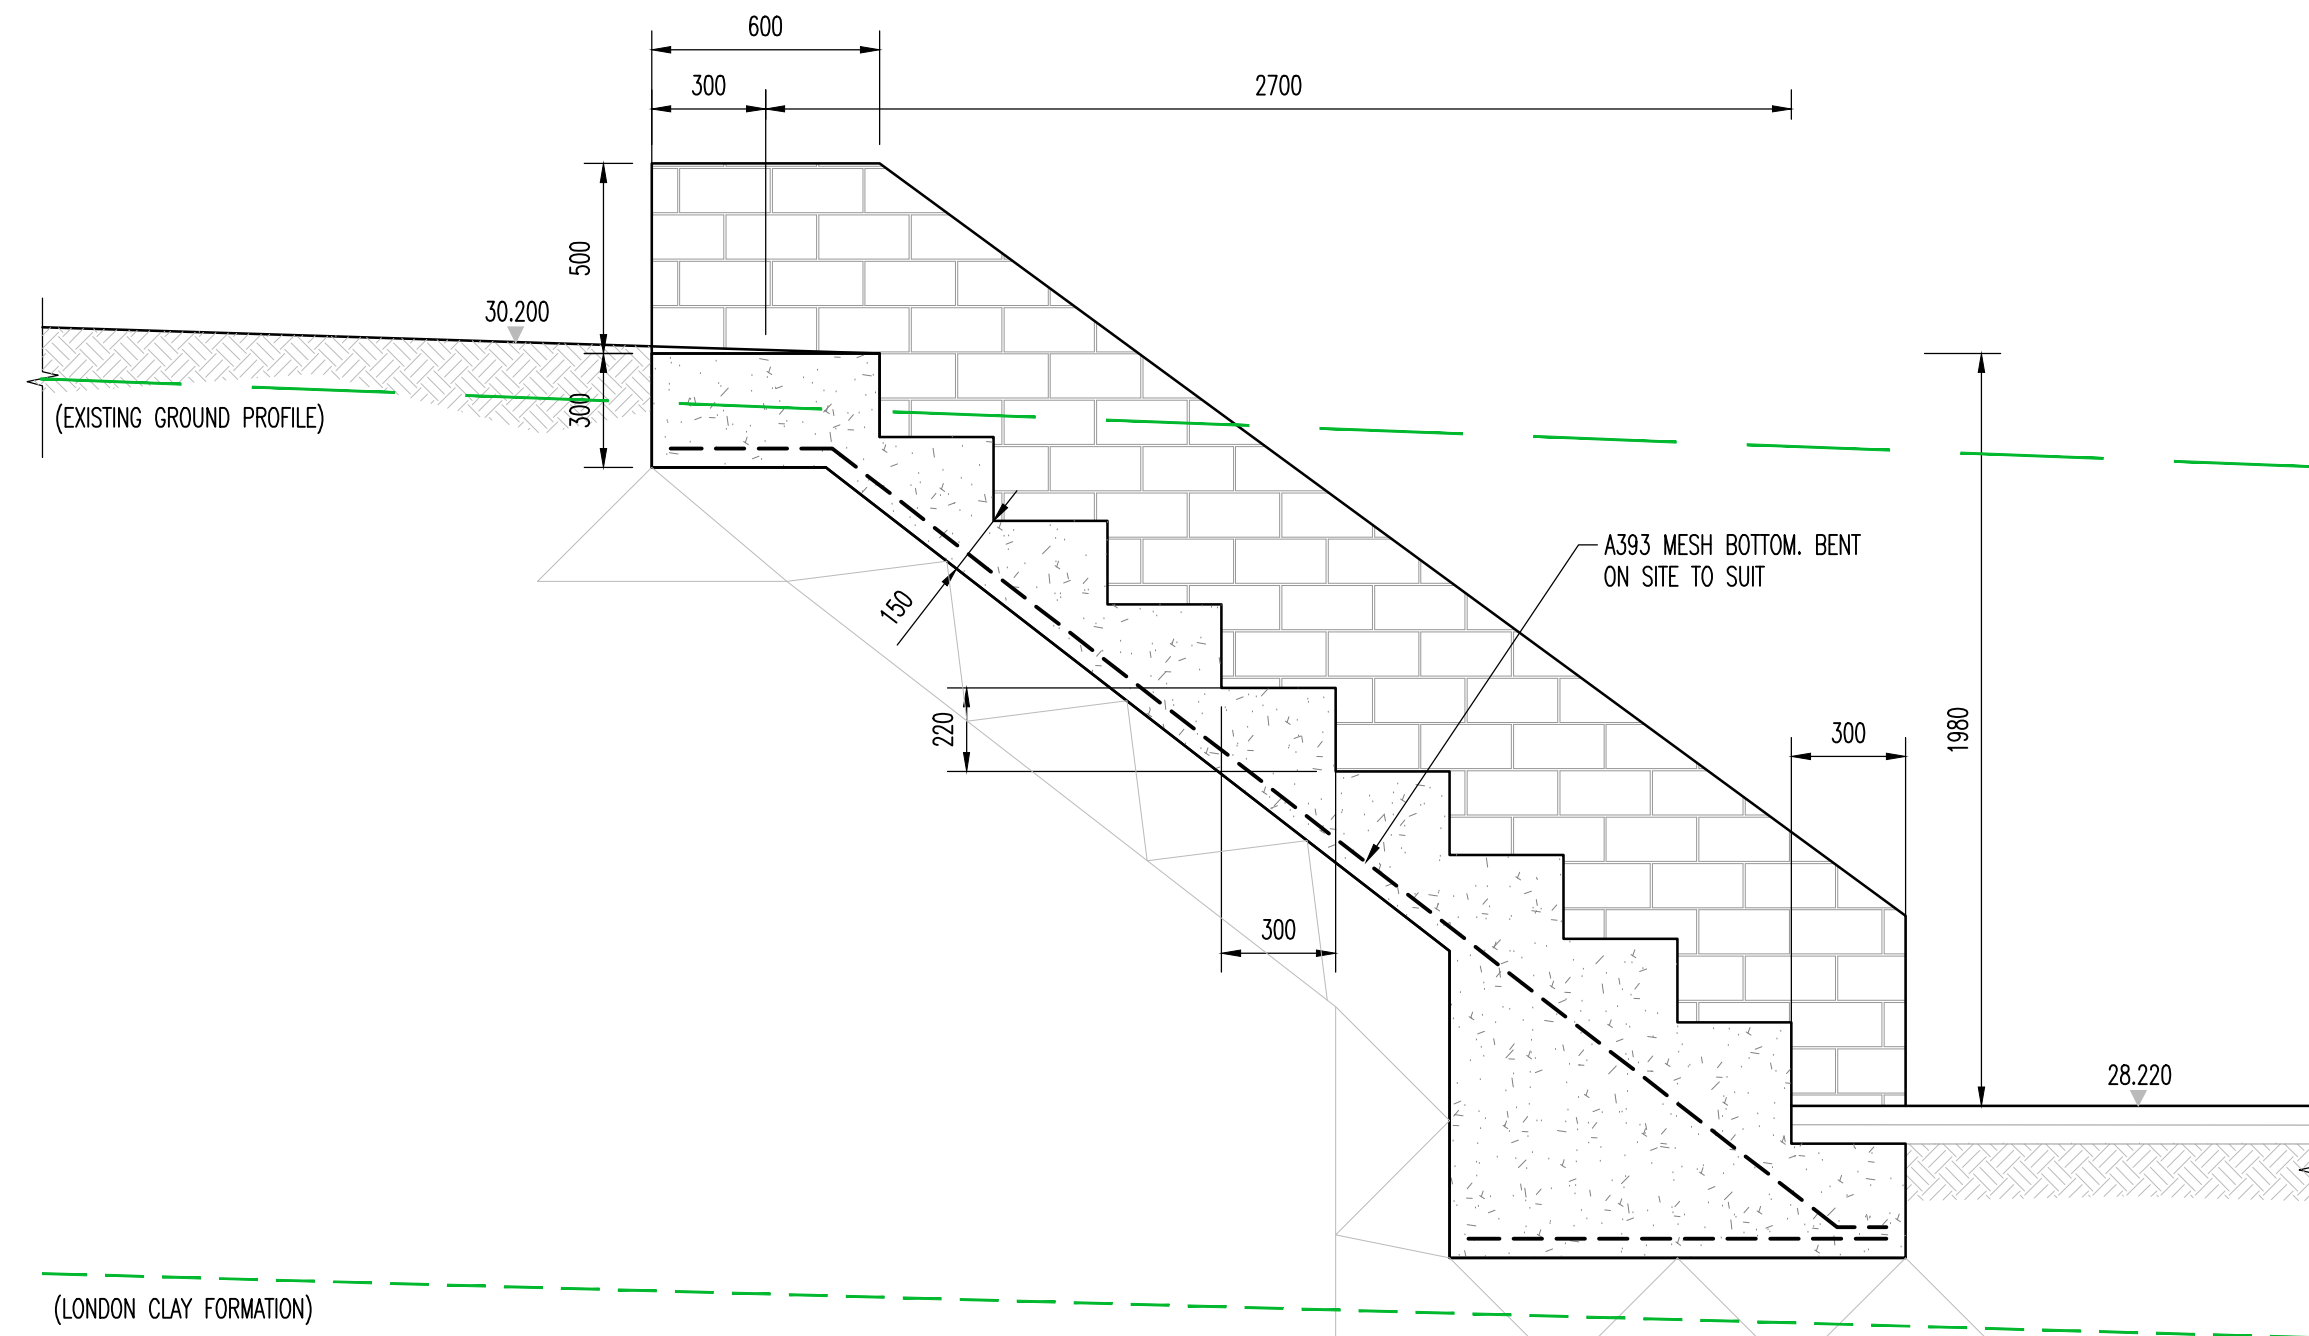

SECTION M-M
(SCALE 1:20)

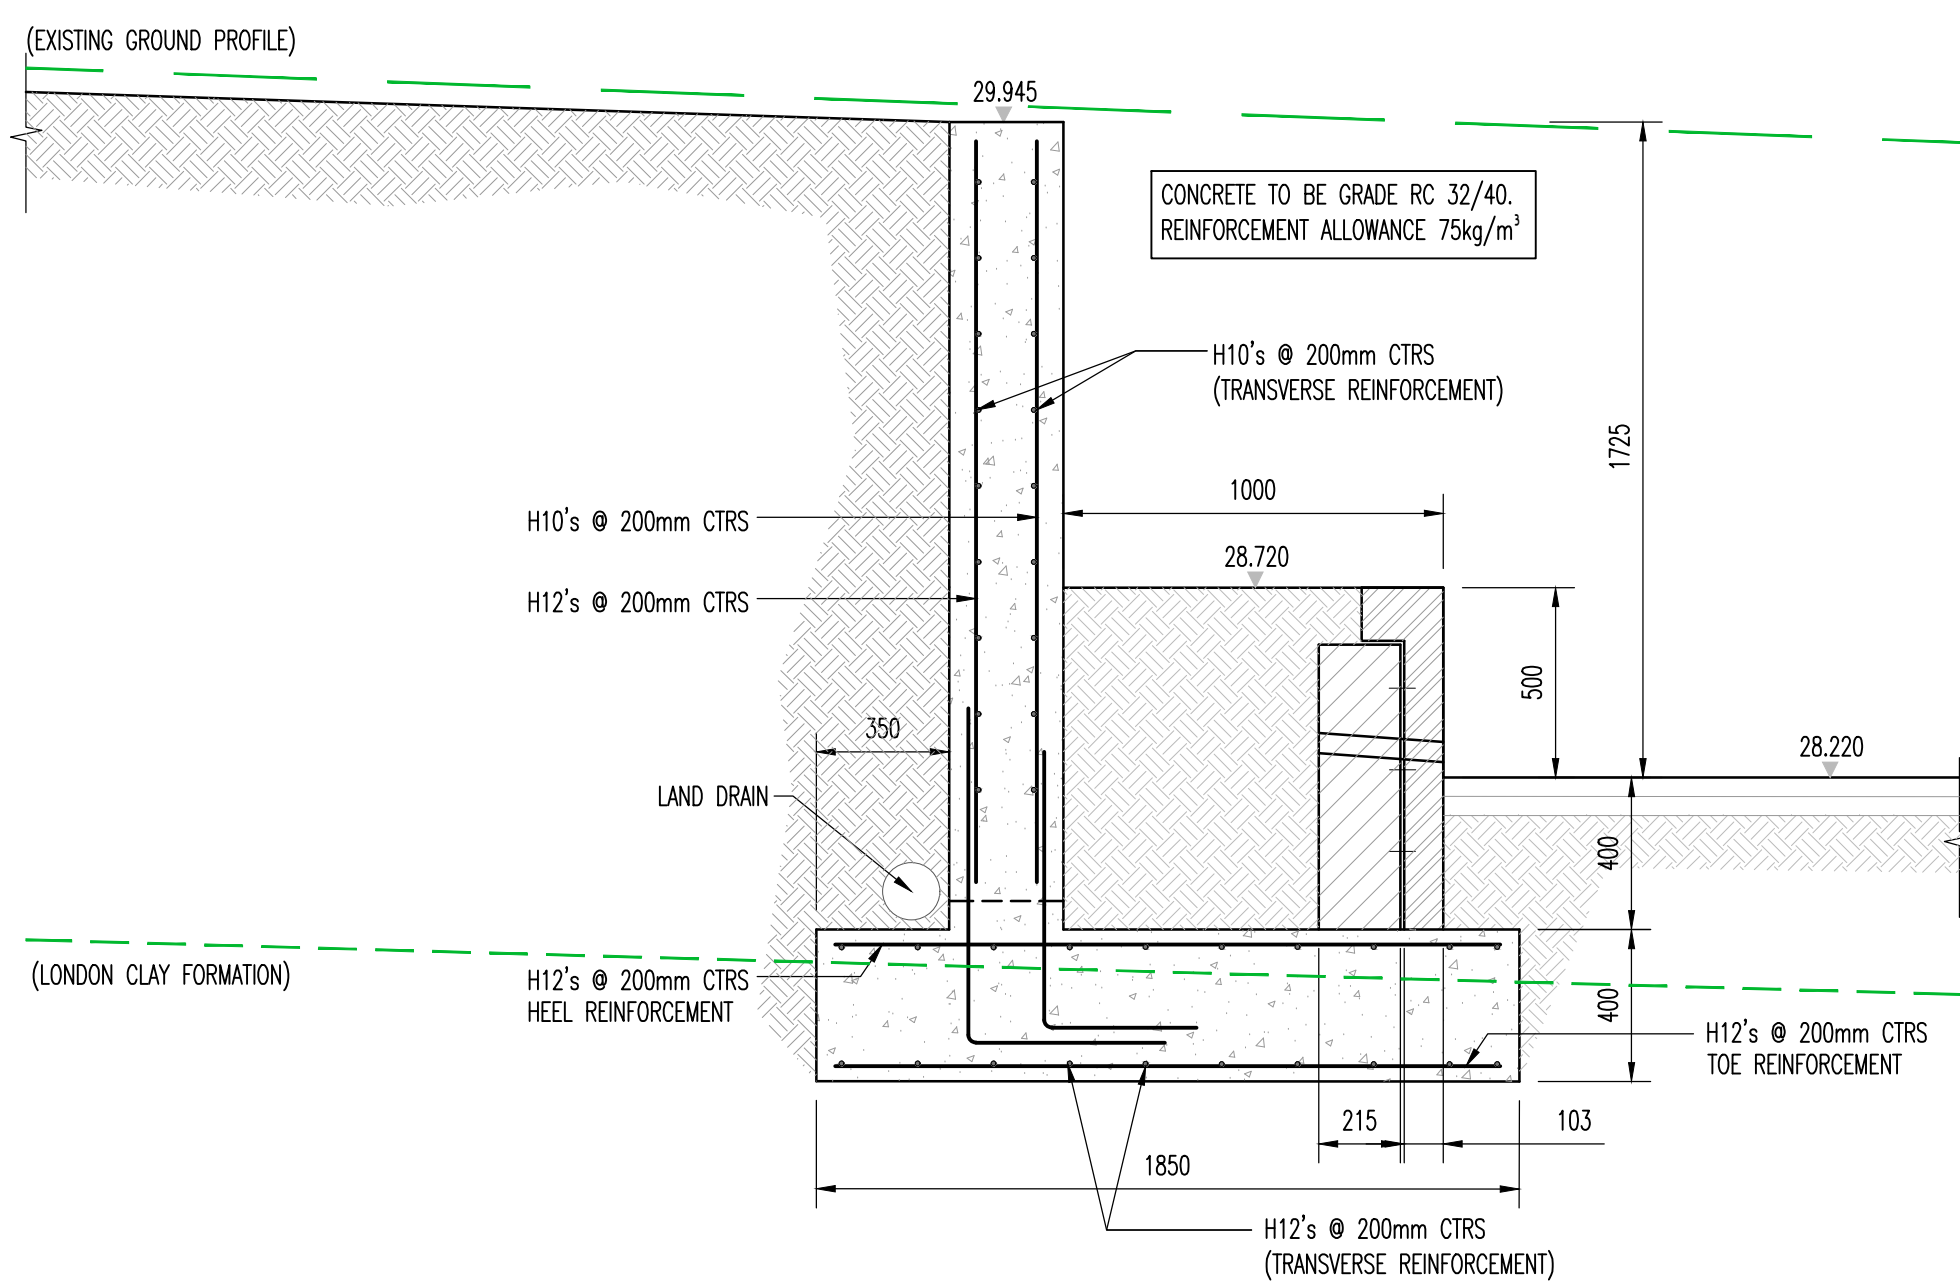

SECTION N-N
(SCALE 1:20)

NOTES

1. DO NOT SCALE FROM THIS DRAWING. USE FIGURED DIMENSIONS ONLY, IF IN DOUBT ASK.
2. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ENGINEERS AND ARCHITECTS DRAWINGS AND SPECIFICATIONS.

T1	ISSUED FOR TENDER		JA
03.06.24	DATE		NR
NR	COMMENT		NR
NR	COMMENT		NR
Client:			
ANAVO DEVELOPMENTS LIMITED			
Project Title:			
HAVANT : HAVANT CARE HOME BARTONS ROAD, HAVANT			
Drawing Title:			
EXTERNAL LANDSCAPED RETAINING WALL SECTIONS			
Drawn By: JA	Scales: 1:20, 1:50 & A1		
Date: APRIL 2024	Drawing Number:		Rev:
Checked By: NR	11063-65		T1
Date: APRIL 2024			
Drawing Status:	TENDER		
			
NJP Consulting Engineers Limited 20 St Andrews Crescent Cireffit, CT10 3DD			
Tel: 029 2072 9500 Email: info@njguk.com Web: www.njguk.com			

- NOTES:
1. ALL MASONRY WORKS TO BE IN ACCORDANCE WITH BS 5628
 2. ALL CONCRETE WORKS TO BE IN ACCORDANCE WITH BS 8110.
 3. MAXIMUM HEIGHT OF UNPROPPED MASONRY FOR GROUTING NOT TO EXCEED 0.45m.
 4. CONCRETE INFILL AND GROUT TO BE EITHER FOLLOWING PROPORTIONS BY VOLUME OF DRY MATERIAL 1:0 TO 1/4 A-3:2 CEMENT-LIME-SAND:10mm MAX.SIZE AGGREGATE OR A PRESCRIBED OR DESIGNED MIX OF GRADE C35 WITH 10mm AGGREGATE AND SLUMP BETWEEN 75mm AND 175mm MIXTURES TO BE IN ACCORDANCE WITH CLAUSE 15 BS 5628 PART 2
 5. MORTAR TO BE TABLE 1 BS 5628 PART 2 CLASS M6