


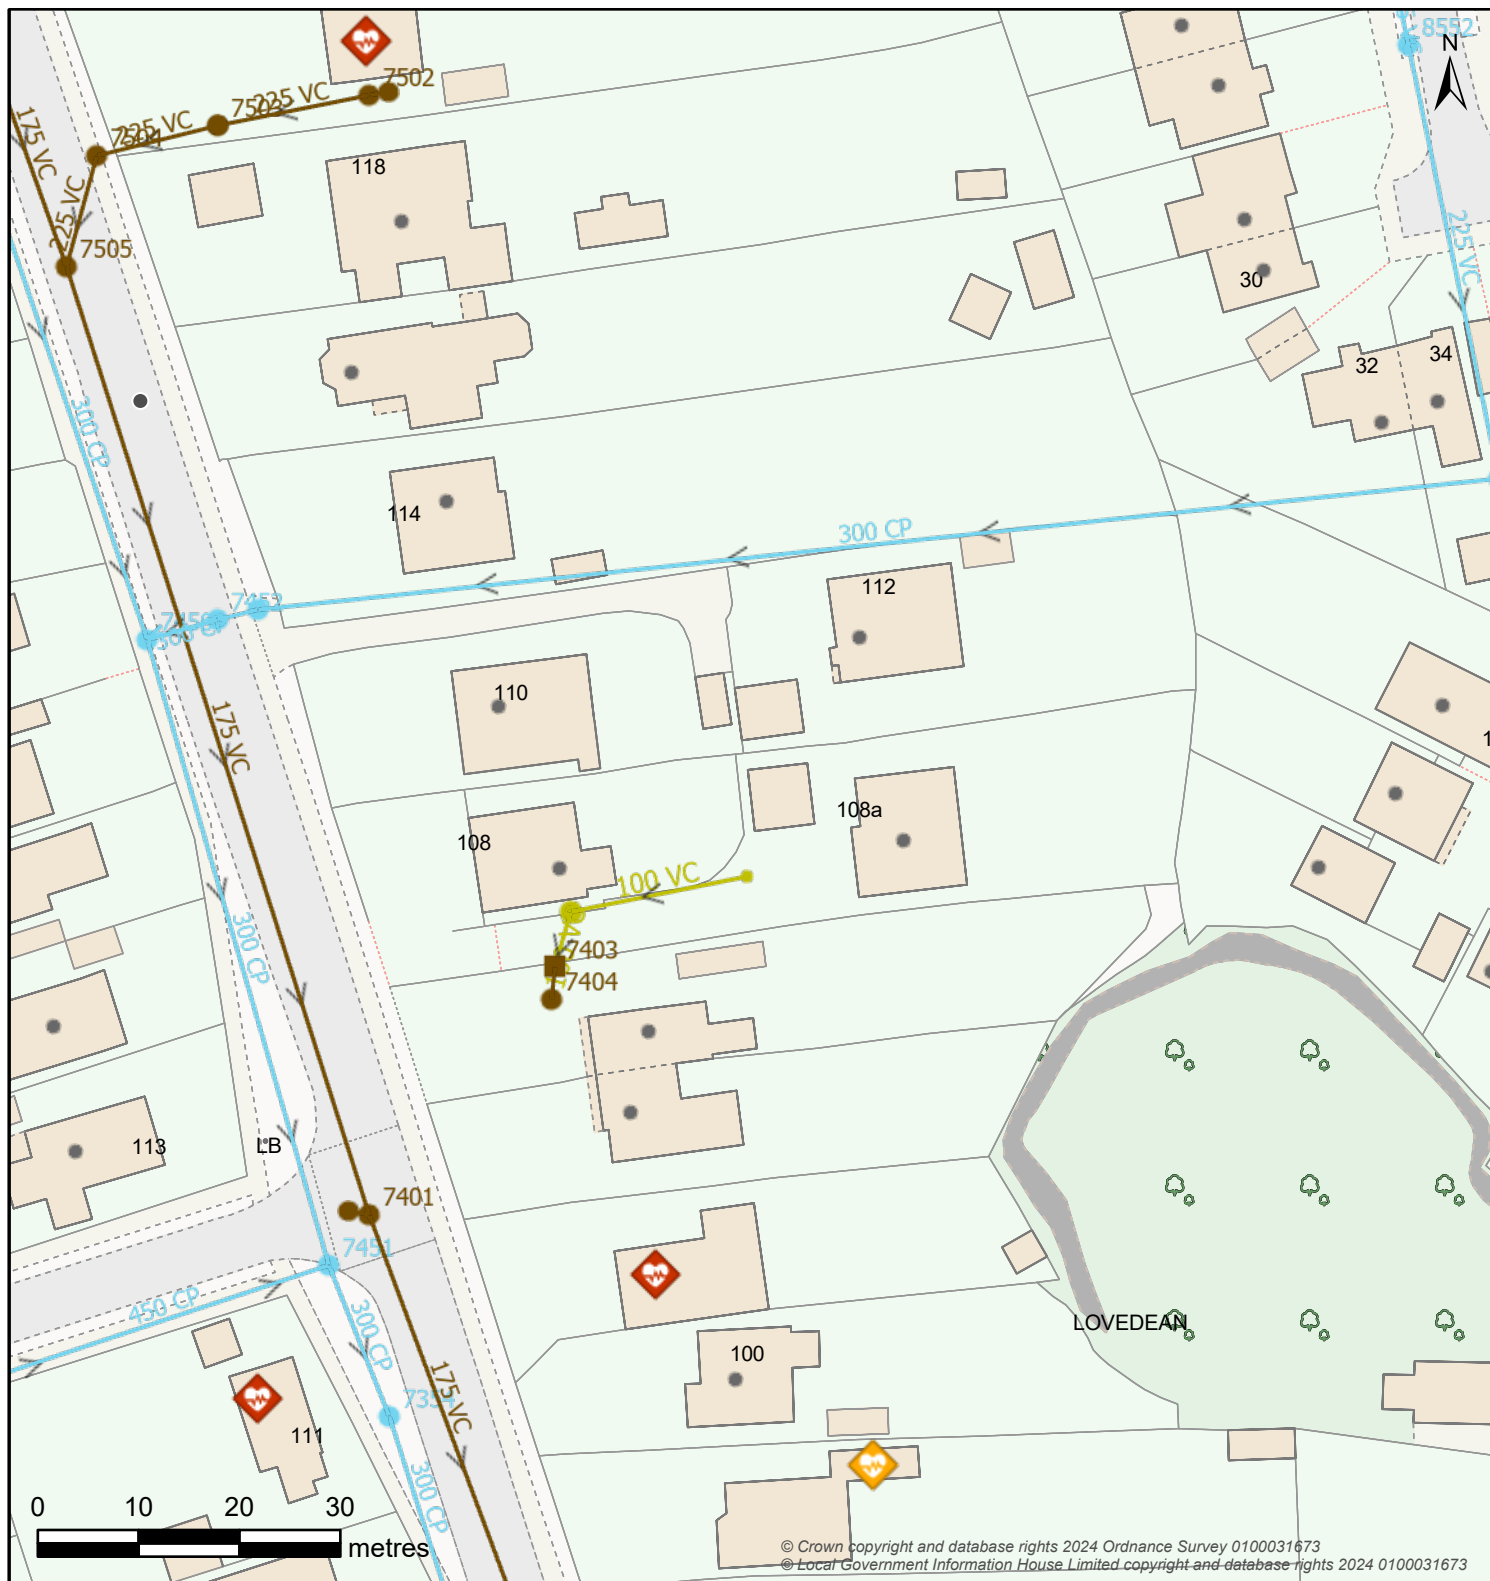

Boundary Box		Break Pressure Tank		Capped End		Hydrant	
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	WOH Washout Hydrant		
Pressure Monitoring		Service Reservoir		Meter		Valve - Controllable	
Logger	Covered	Tower	Meter	Open Valve	Closed Valve	Stop Tap	
Site			Valve - Flow				
Abstraction Point	Supply Works	AV Air Valve	NRV Non-Return Valve	WO Washout Empty Valve			
Booster Station	Transfer Station	Valve - Pressure			Pipe Bridge		
Surface Reservoir	Underground Source	PRV Pressure Reducing Valve	PSV Pressure Sustaining Valve	Pipe Bridge			
Water Pipe				Water Area			
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area			
Distribution	Raw	Discolouration					
Non-Potable	Private						

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 22/07/2024

Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

