




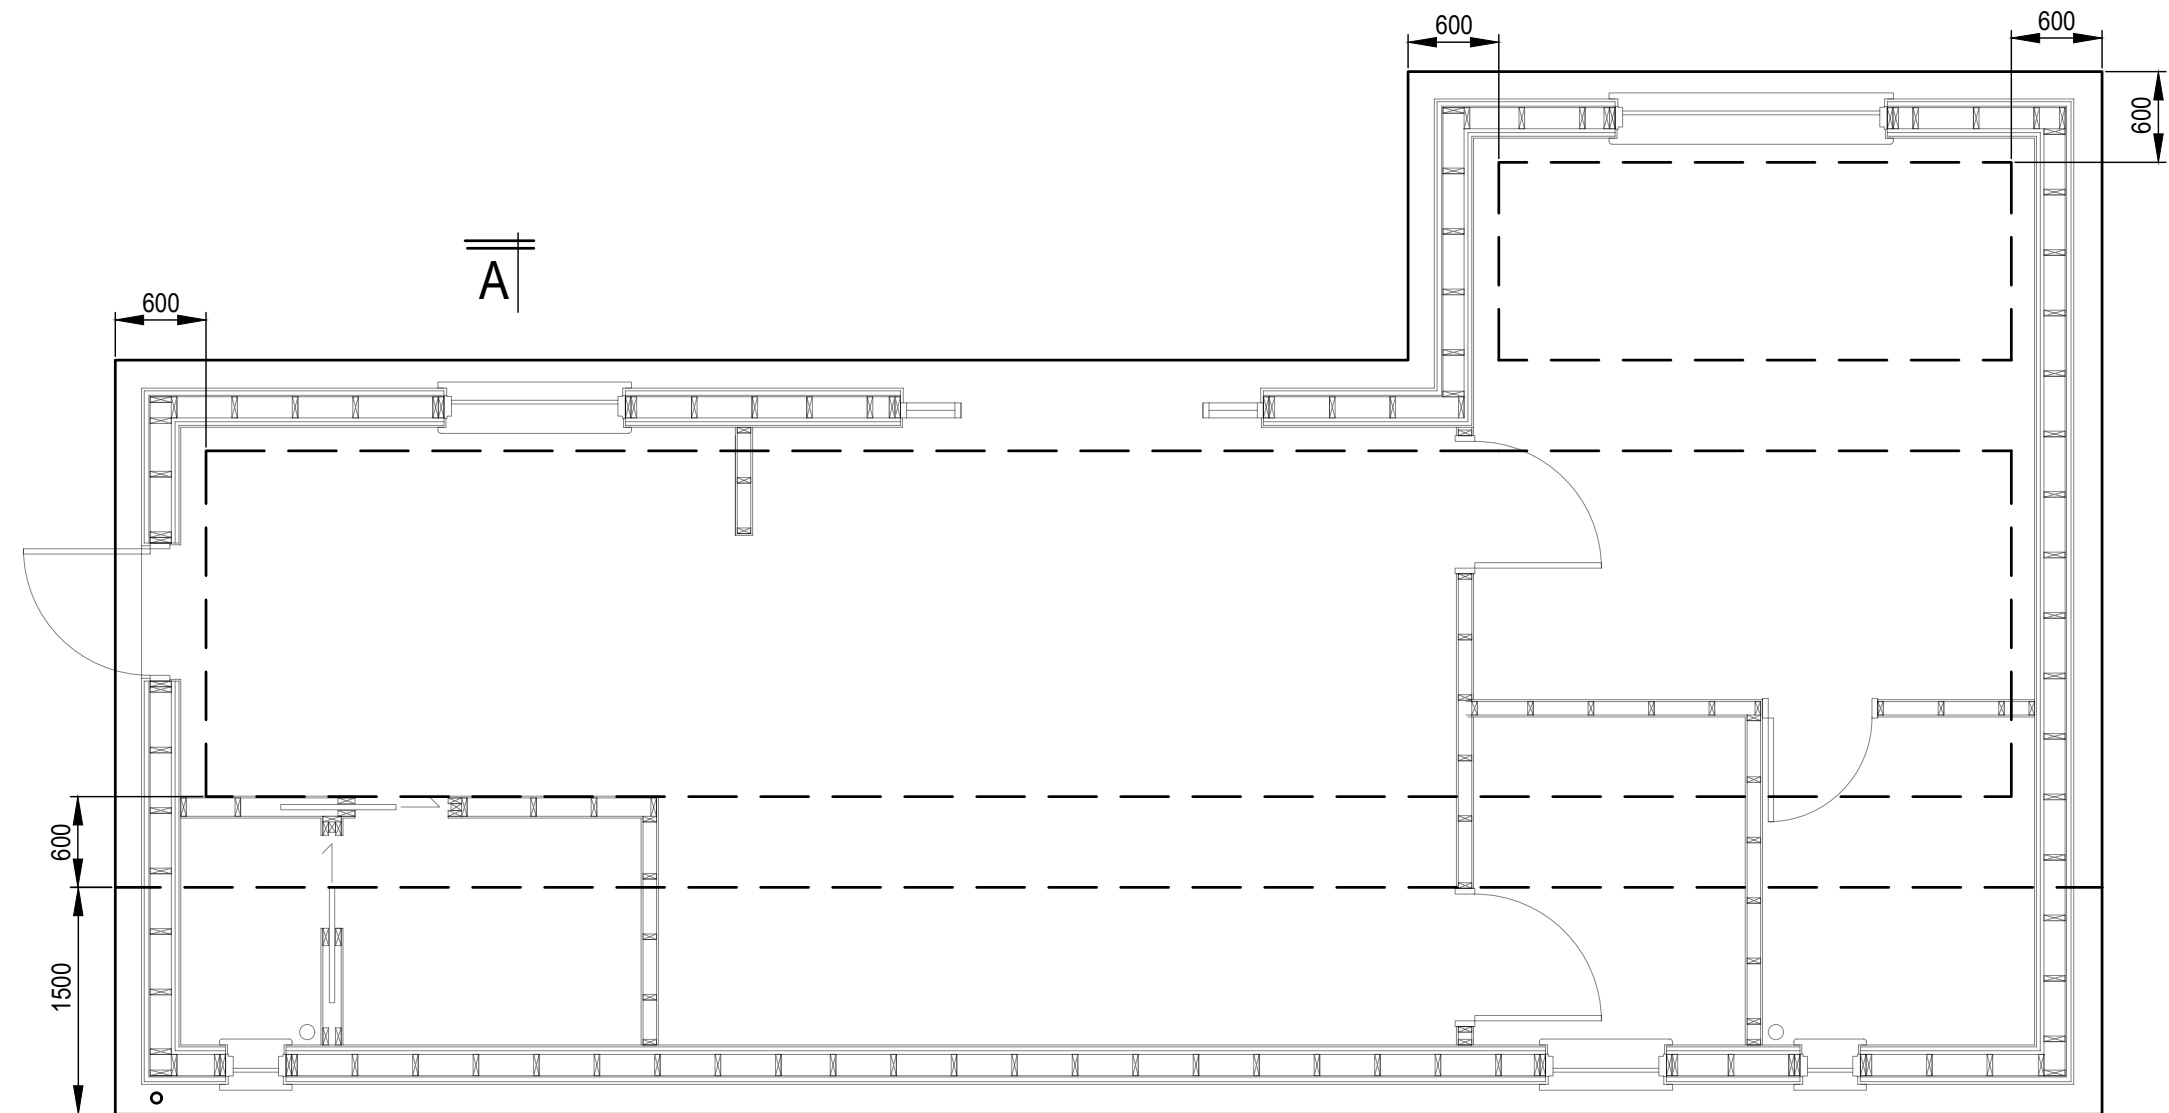


Plan
(1:50)

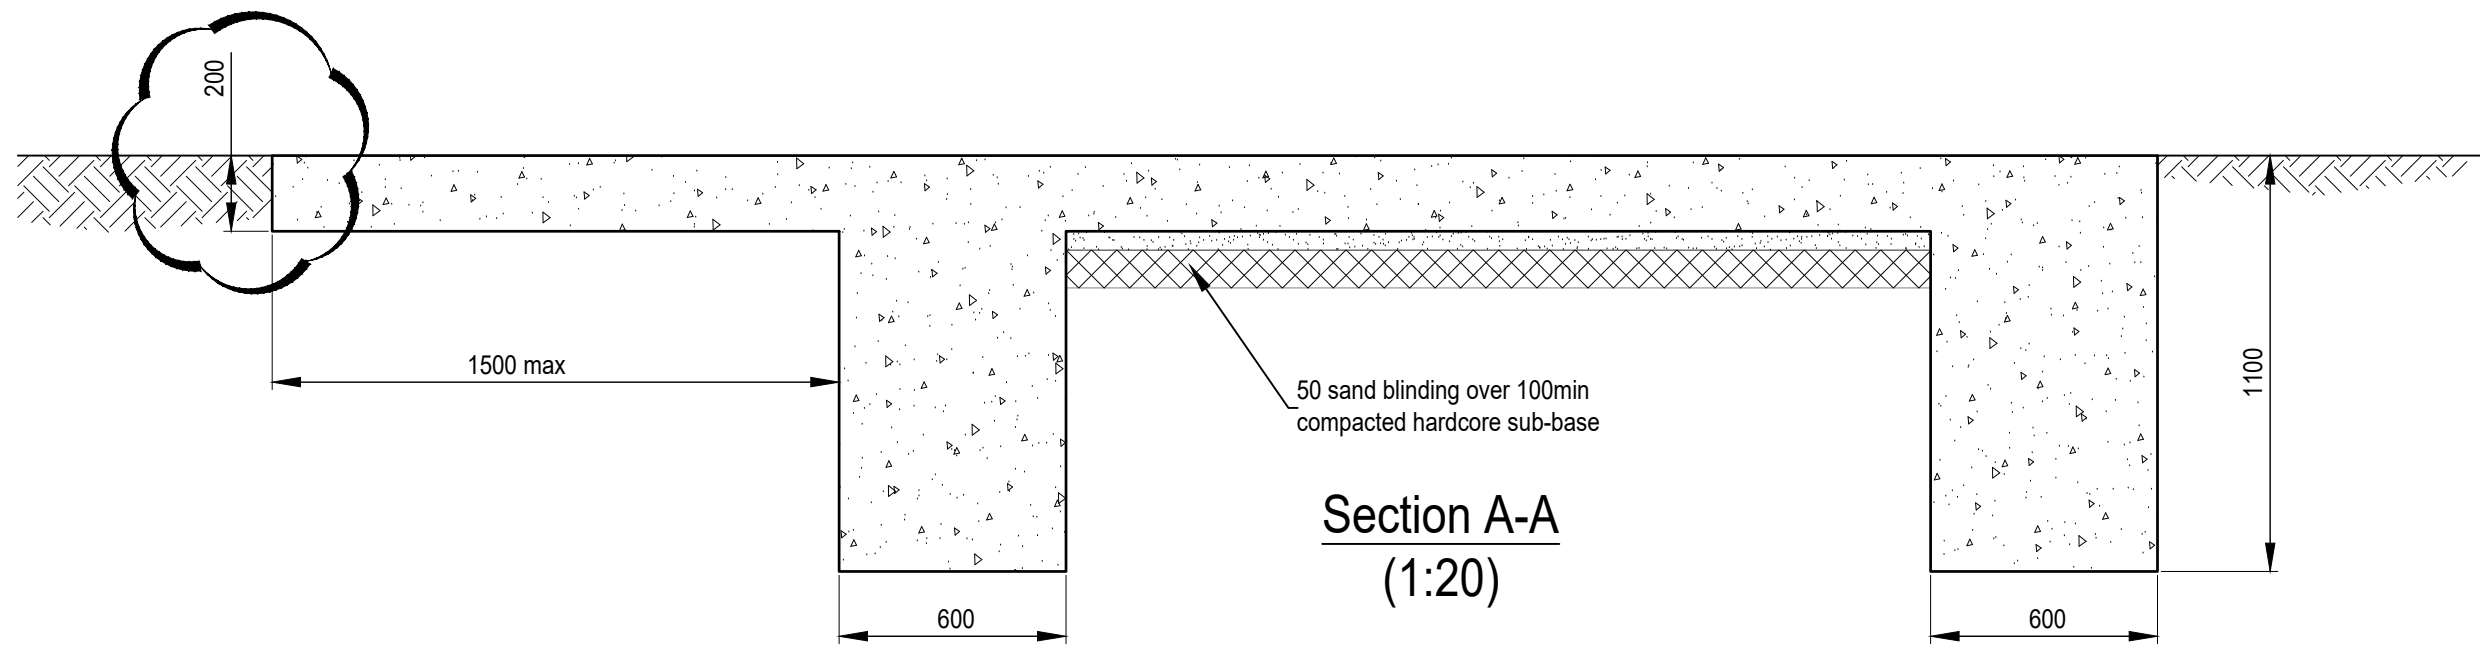

Section A-A
(1:20)

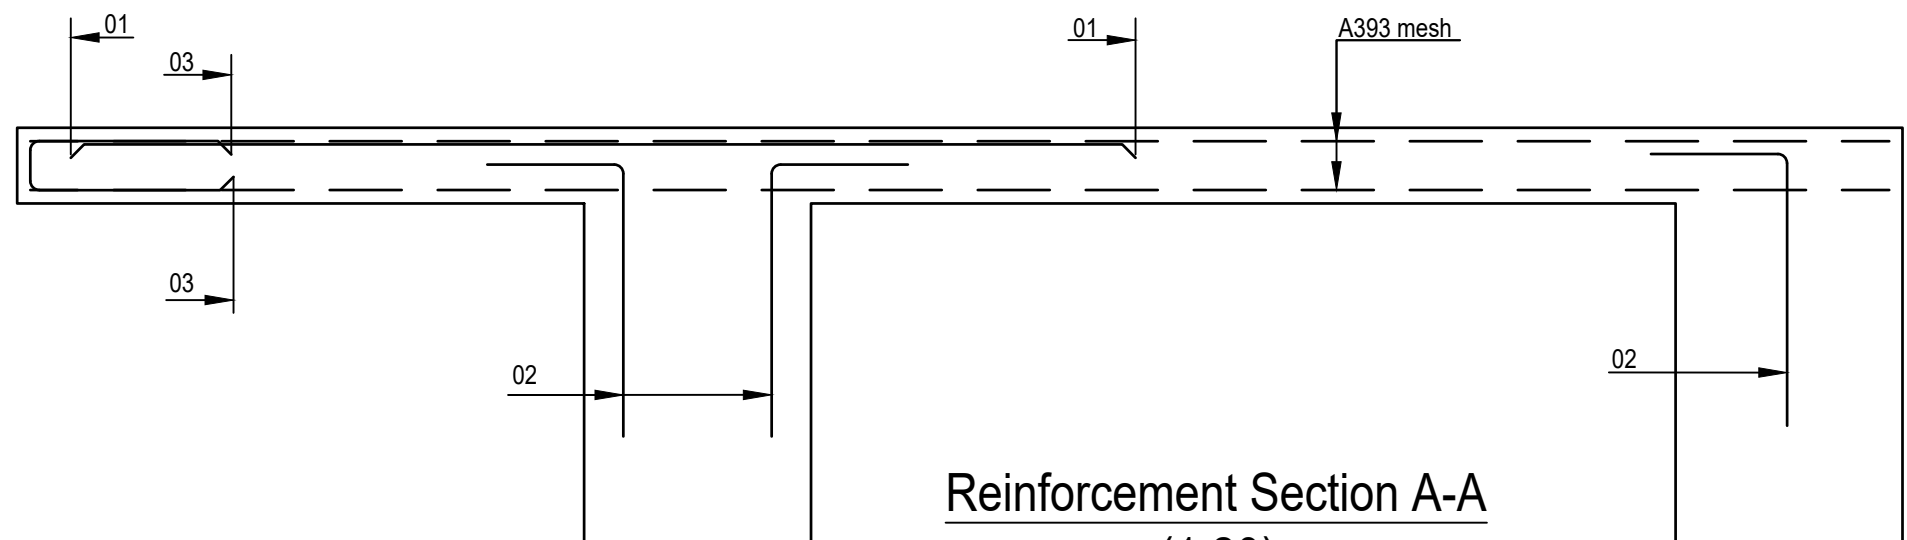

Reinforcement Section A-A
(1:20)

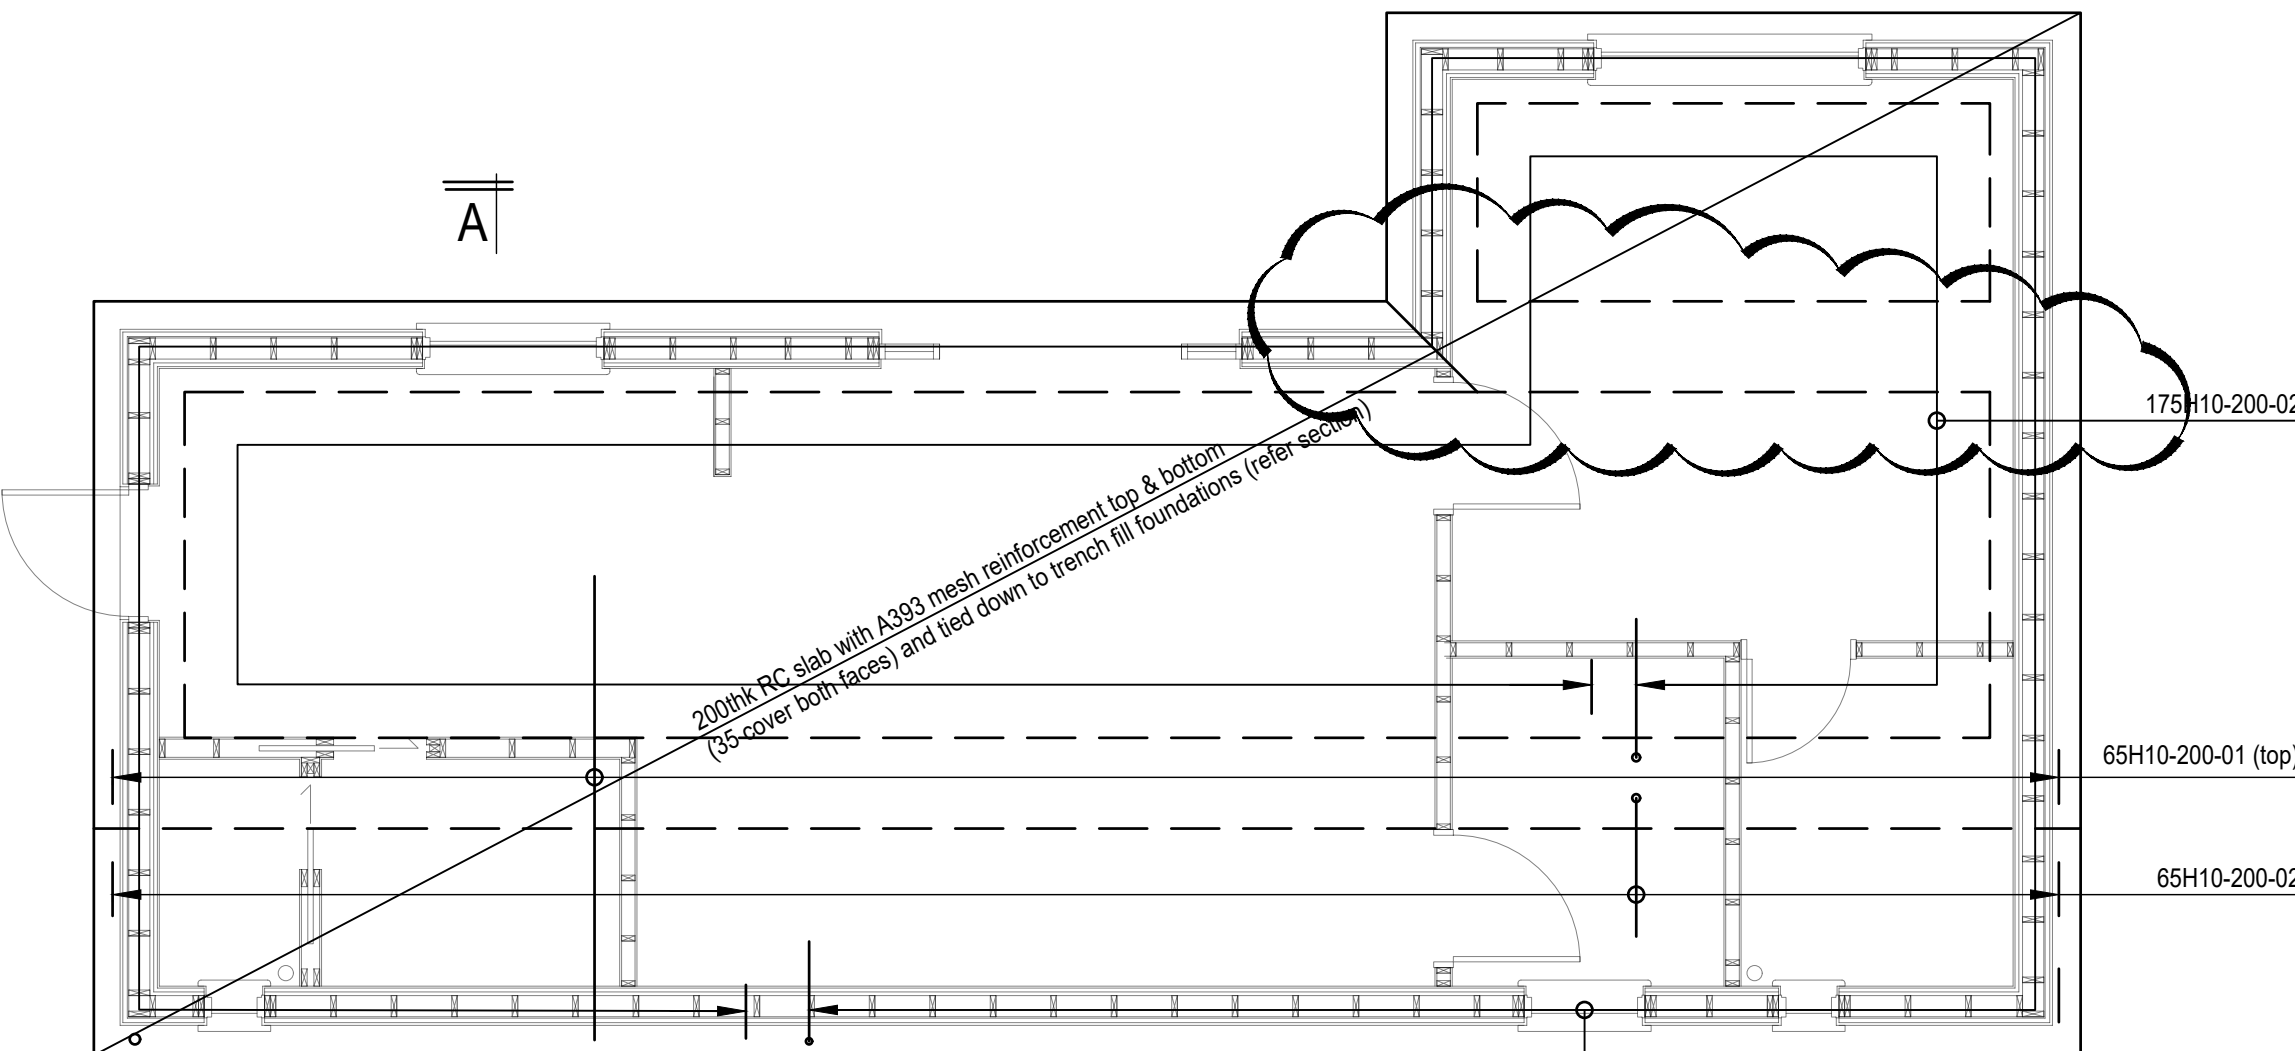

Reinforcement Plan
(1:50)

NOTES

Foundations

- Formation levels are to be approved by the Certifying Authority (for example the Local Authority Building Control) on site prior to pouring concrete.
- Unless noted in calculations, foundation sizes have been based on an allowable bearing pressure of 100kN/m2. This is to be approved by the Certifying Authority prior to pouring concrete.
- All soft spots shall excavated & be backfilled with either blinding concrete or well graded, well compacted granular fill.
- Construction joints for unreinforced trench fill foundations may be formed by forming a 'V' at the stop end.

Concrete

- Unless noted otherwise, all structural concrete shall be Designated mixes as shown below.

Unless noted otherwise:-

unreinforced concrete :- GEN3

reinforced concrete :- RC25/30

All from suitably approved ready-mix supplier

- All reinforcement to be deformed Type 2 with minimum grade of 500B in accordance with BS4449.
- Minimum lap length is to be a minimum of 40 times bar diameter.

A	additional strip footing added and slab thickness reduced	16.10.24
-	Issued for construction	15.10.24

Rev	Revision note	Date
-----	---------------	------

vkhp-consulting
civil and structural



340 High Street, Dorking, Surrey RH4 1QX
01306 881012 / dkg@vkhp.co.uk

Surrey 01306 881012 / dkg@vkhp.co.uk
Kent 01892 521841 / tw@vkhp.co.uk
West Sussex 01903 740090 / stb@vkhp.co.uk
National & International 01306 881012 / info@vkhp.co.uk

Project
108A Lovedean Lane
Waterlooville
PO8 9SN

Title
Proposed New Outbuilding
Foundations
Plans & Sections

Dm By ab	Chk By	DRG NO 647324/01	REV A
Date Oct 2024	Scale @A1 as shown		