



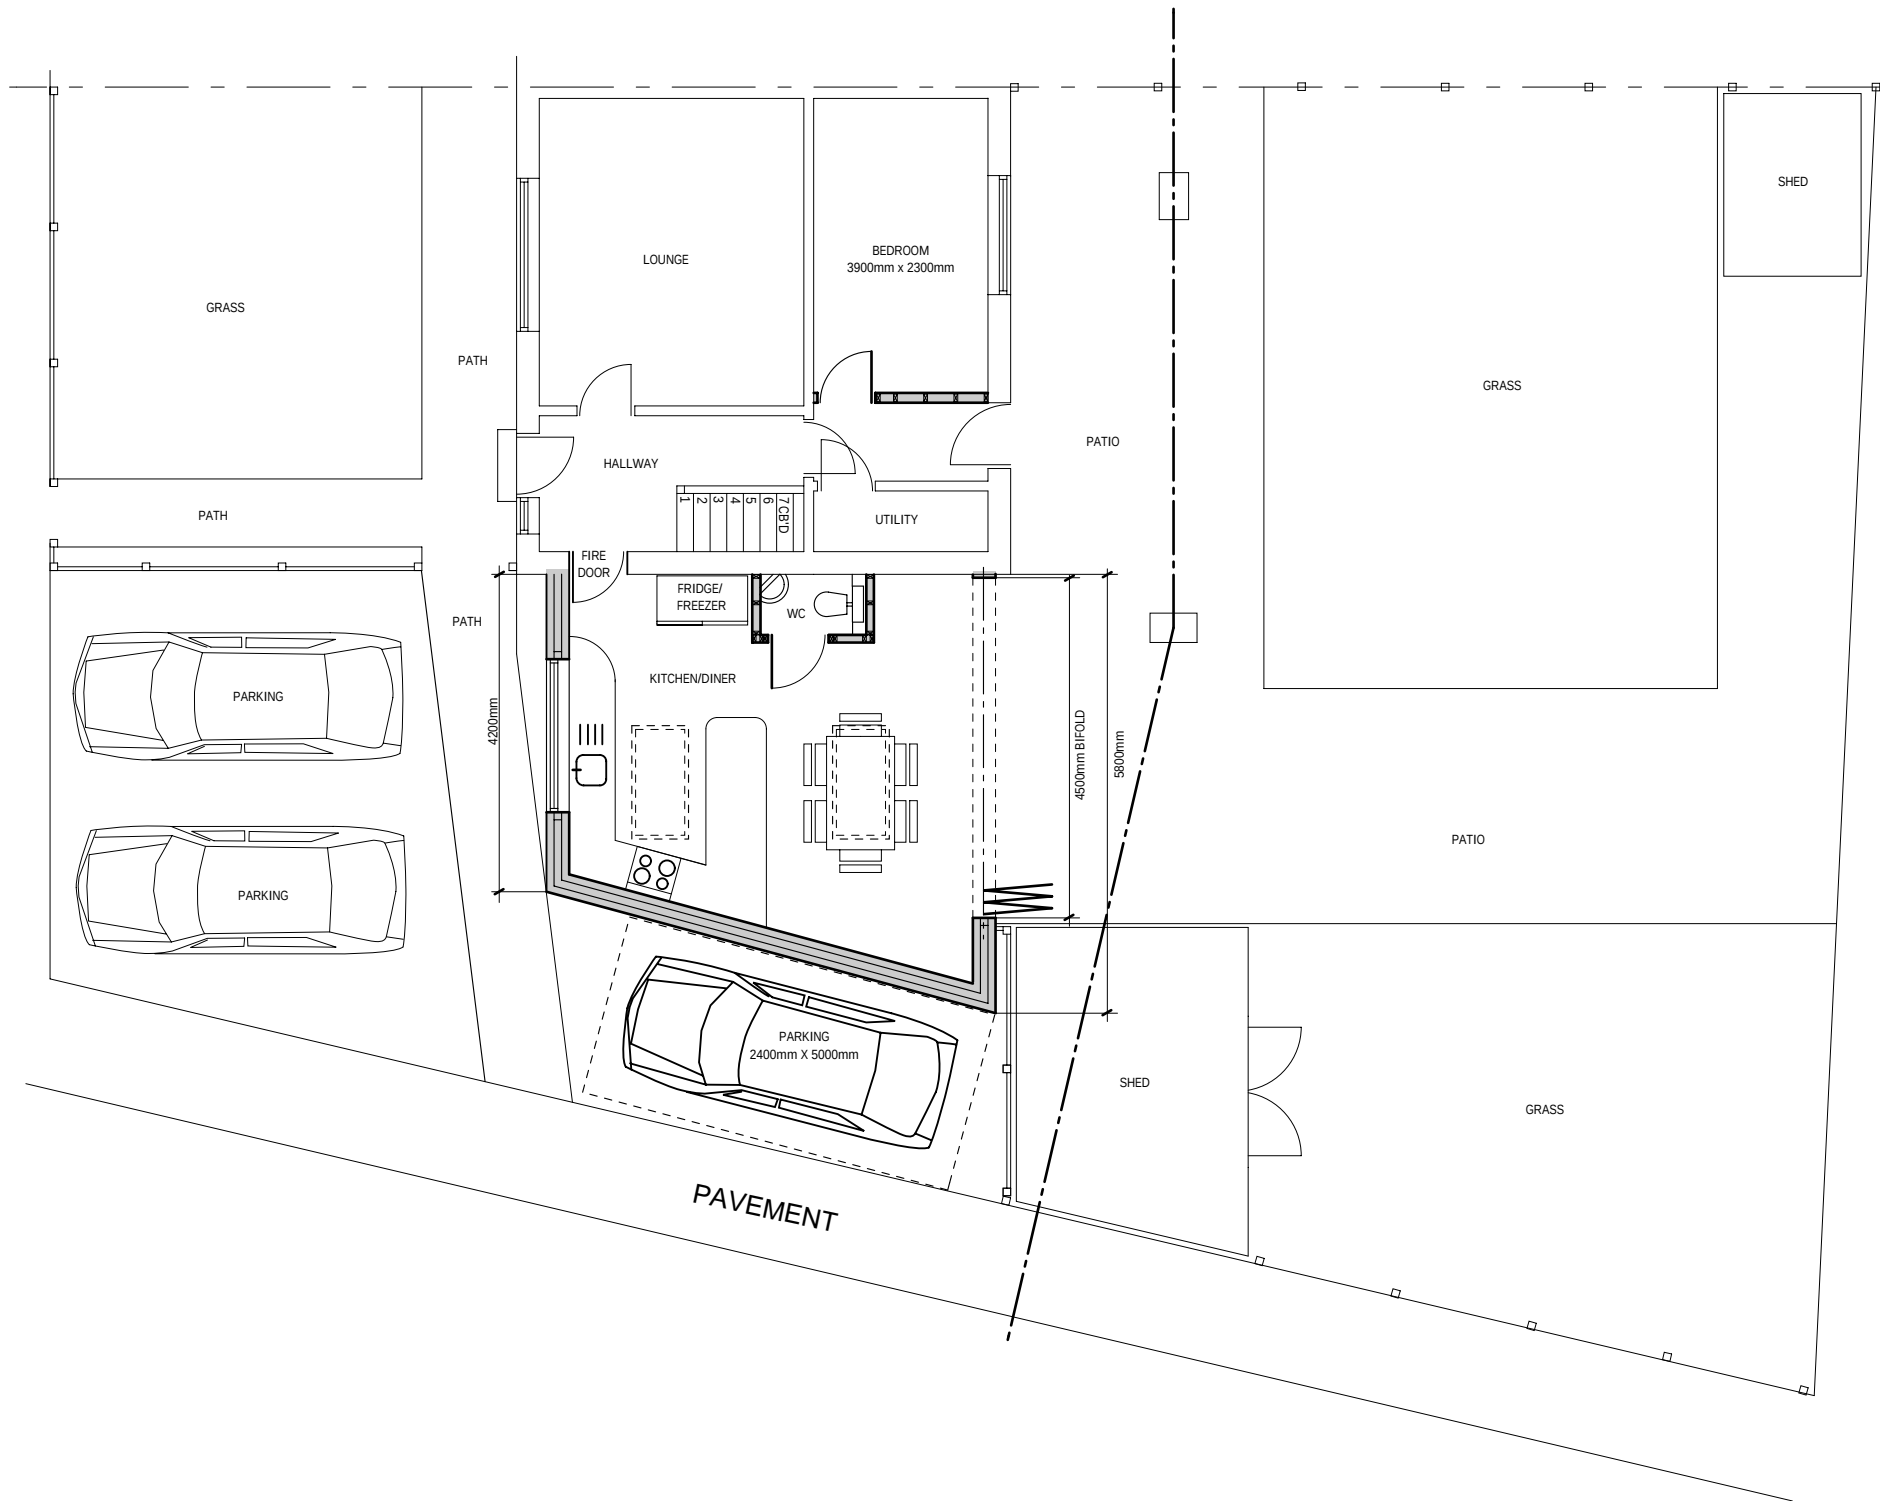

Drainage :
All to comply with BS8301. Any drain not used to be sealed to La's approval.
100 mm diameter below ground pipes bedded and surrounded on 150 mm of pea shingle and laid to a fall of 1 : 40. Provide concrete lintels over the pipes as they pass through the external walls. (a) No structure (footings, walls etc) running within 500mm of the ext'g public foul sewer/manhole will be per permitted. (b) Where within 3 mtr's of the sewer foundations must be taken down a minimum 150mm below the invert of the sewer/manhole. (c) the build over of public sewers in pitch fibre or plastic material or any material in poor condition is not permitted by Southern Water. (d) No internal public manholes are permitted by Southern Water, therefore if a public manhole is present within the proposed extension area or within 500mm of a footing it must be removed or resited if area permits. Underground quality proprietary UPVC 450mm dia.inspection chambers to be provided at all changes of level, direction and connections where new pipe joins existing drain line. Inspection chambers to have screw down double sealed covers .

THIS DRAWING IS THE COPYRIGHT OF BOTH CREATIVE PARTNERSHIP AND MAY NOT BE COPIED ALTERED OR REPRODUCED IN ANY FORM OR PASSED TO A THIRD PARTY WITHOUT THE WRITTEN CONSENT OF BOTH CREATIVE PARTNERSHIP

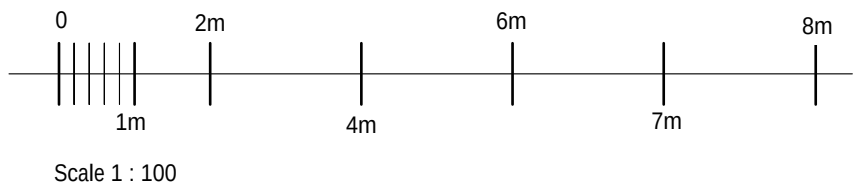

PROPOSED SIDE SINGLE STOREY
EXTENSION WITH PARKING
FOR 391 PURBROOK WAY
HAVANT
PO9 3SE

SCALE 1:100 A3

DRAWING No 19072022 4A3 REV 1