


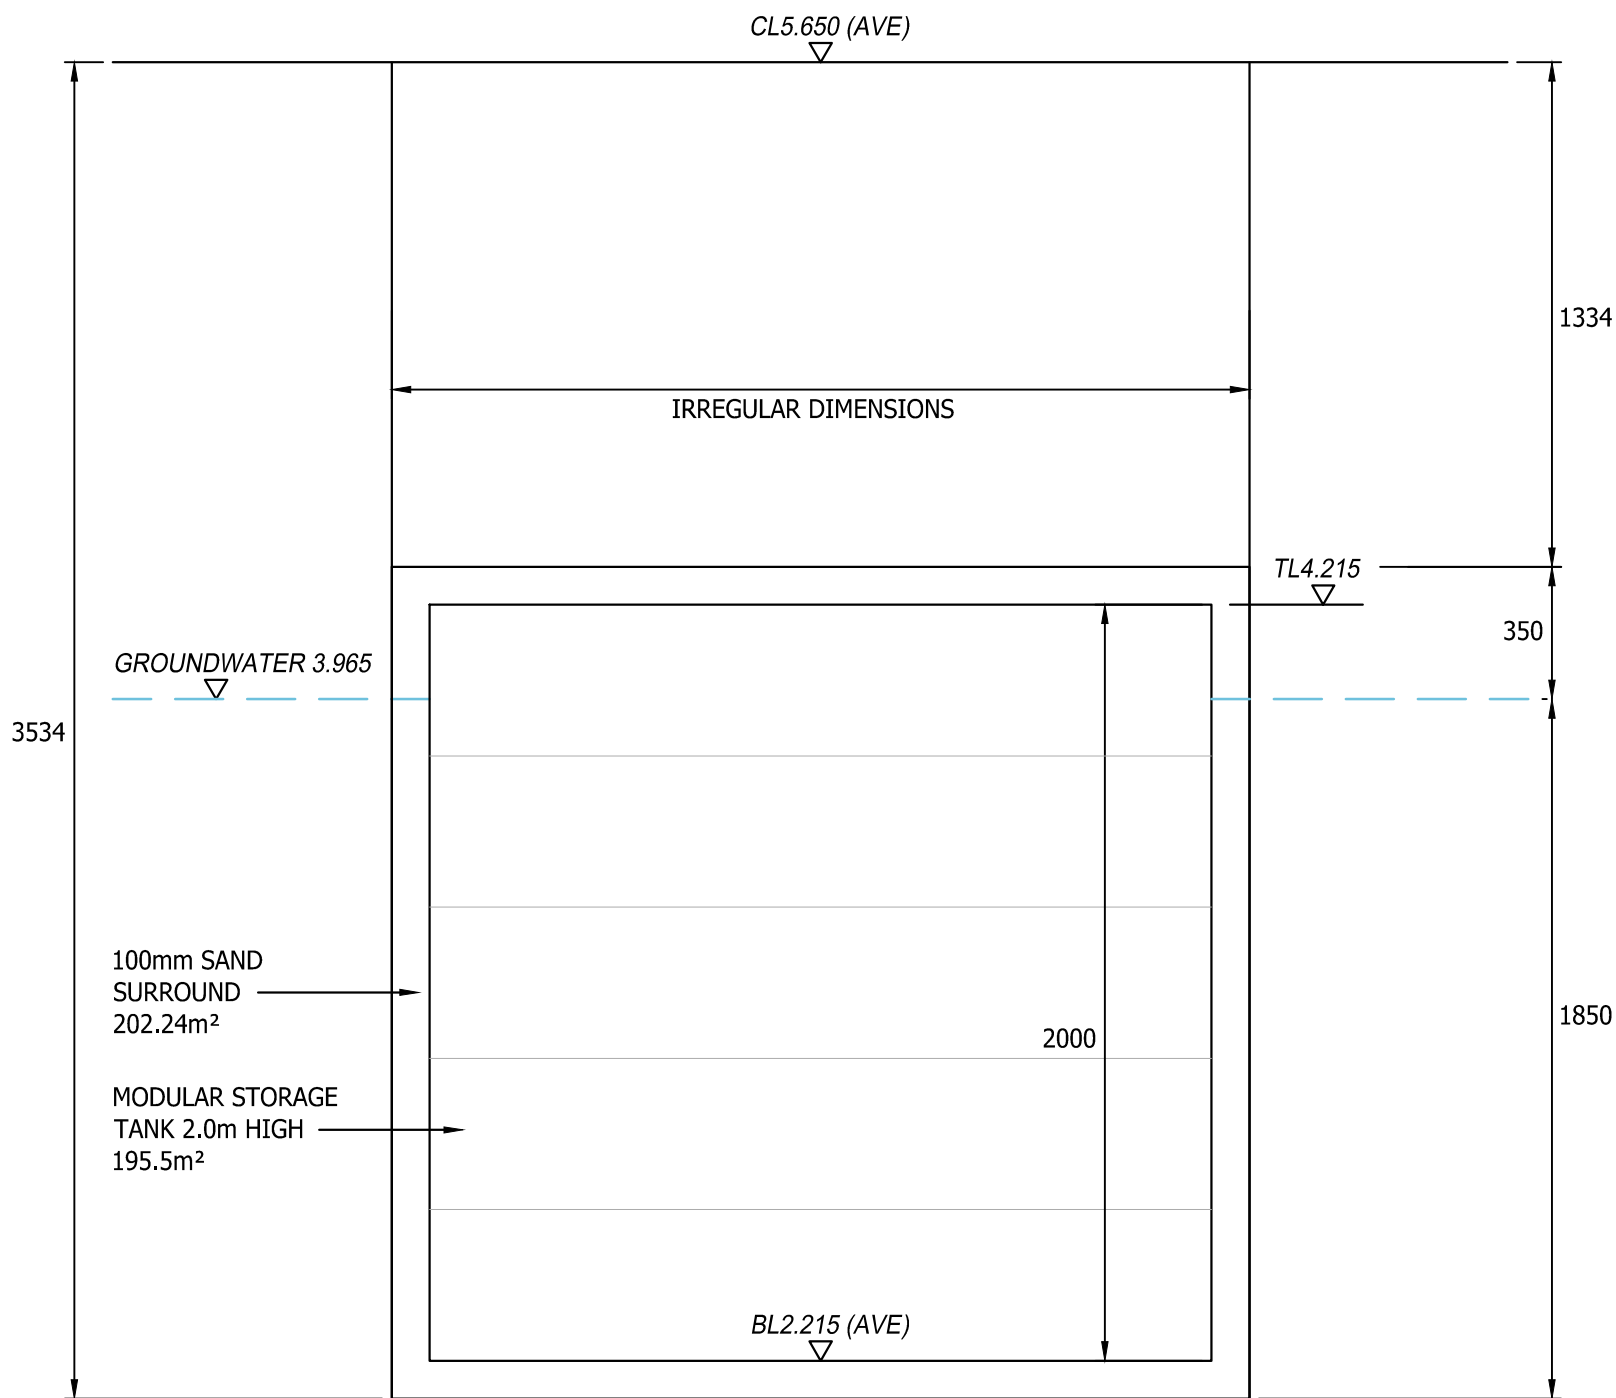

NORTHERN MODULAR STORAGE TANK (WITHOUT FLOTATION MITIGATION)

FLOTATION CALCULATIONS

WATER DISPLACED BY CHAMBER & SURROUND:

VOLUME = $m^2 \times h$
= $202.24^2 \times 1.850$
= $374.144m^3$

MASS = $pw \times V$
= $1000 \text{ kg/m}^3 \times 374.144$
= 374144 kg
x g (9.8 m/s²) = 3666611.2 N
= 3666.61 kN

FACTOR OF SAFETY = 1.2

i.e 3666.61×1.2 = **4399.9 kN** (BUOYANCY FORCE)

TANK SELF-WEIGHT:

MODULAR UNITS = $1955 \times 9 \text{ kg ea.} = 17595 \text{ kg}$
x g (9.8 m/s²) = 172431 N
= **172.431 kN**

SAND SURROUND

SATURATED VOLUME = $(A_s \times H) - (A_t \times H)$
= $(202.24 \times 1.850) - (195.5 \times 1.750)$
= $374.144 - 342.125$
= $32.019m^3$

DENSITY OF SATURATED SAND = 1900 kg/m^3
i.e. 1900×32.019 = 60836.1 kg
x g (9.8 m/sec²) = 596193.78 N
= **596.19 kN**

UNSATURATED VOLUME = $(A_s \times H) - (A_t \times H)$
= $(202.24 \times 0.350) - (195.5 \times 0.250)$
= $70.784 - 48.875$
= $21.909m^3$

DENSITY OF UNSATURATED SAND = 1600 kg/m^3
i.e. 1600×21.909 = 35054.4 kg
x g (9.8 m/sec²) = 343533.12 N
= **343.53 kN**

UNSATURATED BACKFILL VOLUME = $202.24m^2 \times 1.334m$
= $269.788m^3$

DENSITY OF UNSATURATED BACKFILL = 1020 kg/m^3
i.e. 1020×269.788 = 275183.9 kg
x g (9.8 m/s²) = 2696802.4 N
= **2696.8 kN**

i.e. STORAGE TANK SELF-WEIGHT TOTAL
= $172.431 + 596.19 + 343.53 + 2696.8$
= **3808.95 kN**

4399.9 > 3808.95 kN :: NOT OK (FLOTATION)

FLOTATION CALCULATIONS

WATER DISPLACED BY CHAMBER & SURROUND:

VOLUME = $m^2 \times h$
= $202.24^2 \times 1.850$
= $374.144m^3$

MASS = $pw \times V$
= $1000 \text{ kg/m}^3 \times 374.144$
= 374144 kg
x g (9.8 m/s²) = 3666611.2 N
= 3666.61 kN

FACTOR OF SAFETY = 1.2

i.e 3666.61×1.2 = **4399.9 kN** (BUOYANCY FORCE)

TANK SELF-WEIGHT:

MODULAR UNITS = $1955 \times 9 \text{ kg ea.} = 17595 \text{ kg}$
x g (9.8 m/s²) = 172431 N
= **172.431 kN**

SAND SURROUND

SATURATED VOLUME = $(A_s \times H) - (A_t \times H)$
= $(202.24 \times 1.850) - (195.5 \times 1.750)$
= $374.144 - 342.125$
= $32.019m^3$

DENSITY OF SATURATED SAND = 1900 kg/m^3
i.e. 1900×32.019 = 60836.1 kg
x g (9.8 m/sec²) = 596193.78 N
= **596.19 kN**

UNSATURATED VOLUME = $(A_s \times H) - (A_t \times H)$
= $(202.24 \times 0.350) - (195.5 \times 0.250)$
= $70.784 - 48.875$
= $21.909m^3$

DENSITY OF UNSATURATED SAND = 1600 kg/m^3
i.e. 1600×21.909 = 35054.4 kg
x g (9.8 m/sec²) = 343533.12 N
= **343.53 kN**

CONCRETE COVER SLAB = $212.5m^2 \times 0.15$
= $31.875 m^3$

MASS = $31.875 \times 2500 \text{ kg/m}^3$
= 79687.5 kg
x g (9.8 m/sec²) = 780937.5 N
= **780.93 kN**

UNSATURATED BACKFILL VOLUME = $212.5m^2 \times 1.185m$
= $251.81m^3$


DENSITY OF UNSATURATED BACKFILL = 1020 kg/m^3
i.e. 1020×251.81 = 256848.75 kg
x g (9.8 m/s²) = 2517117.75 N
= **2517.1 kN**

i.e. STORAGE TANK SELF-WEIGHT TOTAL
= $172.431 + 596.19 + 343.53 + 780.93 + 2517.1$
= **4410.18 kN**

4410.18 > 4399.9 kN :: OK (NO FLOTATION)

GENERAL NOTES

- The location, size, depth and identification of existing services that may be shown or referred to on this drawing have been assessed from non intrusive observations, record drawings or the like. The contractor shall safely carry out intrusive investigations, trial holes or soundings prior to commencing work to satisfy himself that it is safe to proceed and that the assessments are accurate. any discrepancies shall be notified to gta prior to works commencing.
- Tender or billing drawings shall not be used for construction or the ordering of materials.
- Do not scale. All dimensions and levels to be site confirmed.
- This drawing shall be read in conjunction with all relevant architects, consultants drawings and specifications, together with H&S plan requirements
- Copyright : This drawing must not be copied, amended nor reproduced without the prior written agreement of gta.
- All drawings specifications and recommendations made by gta are subject to Local Authority and other relevant Statutory Authorities approval. Any works or services made abortive due to the client proceeding prior to these approvals is considered wholly at the Clients risk. gta hold no responsibility for resulting abortive works or costs.

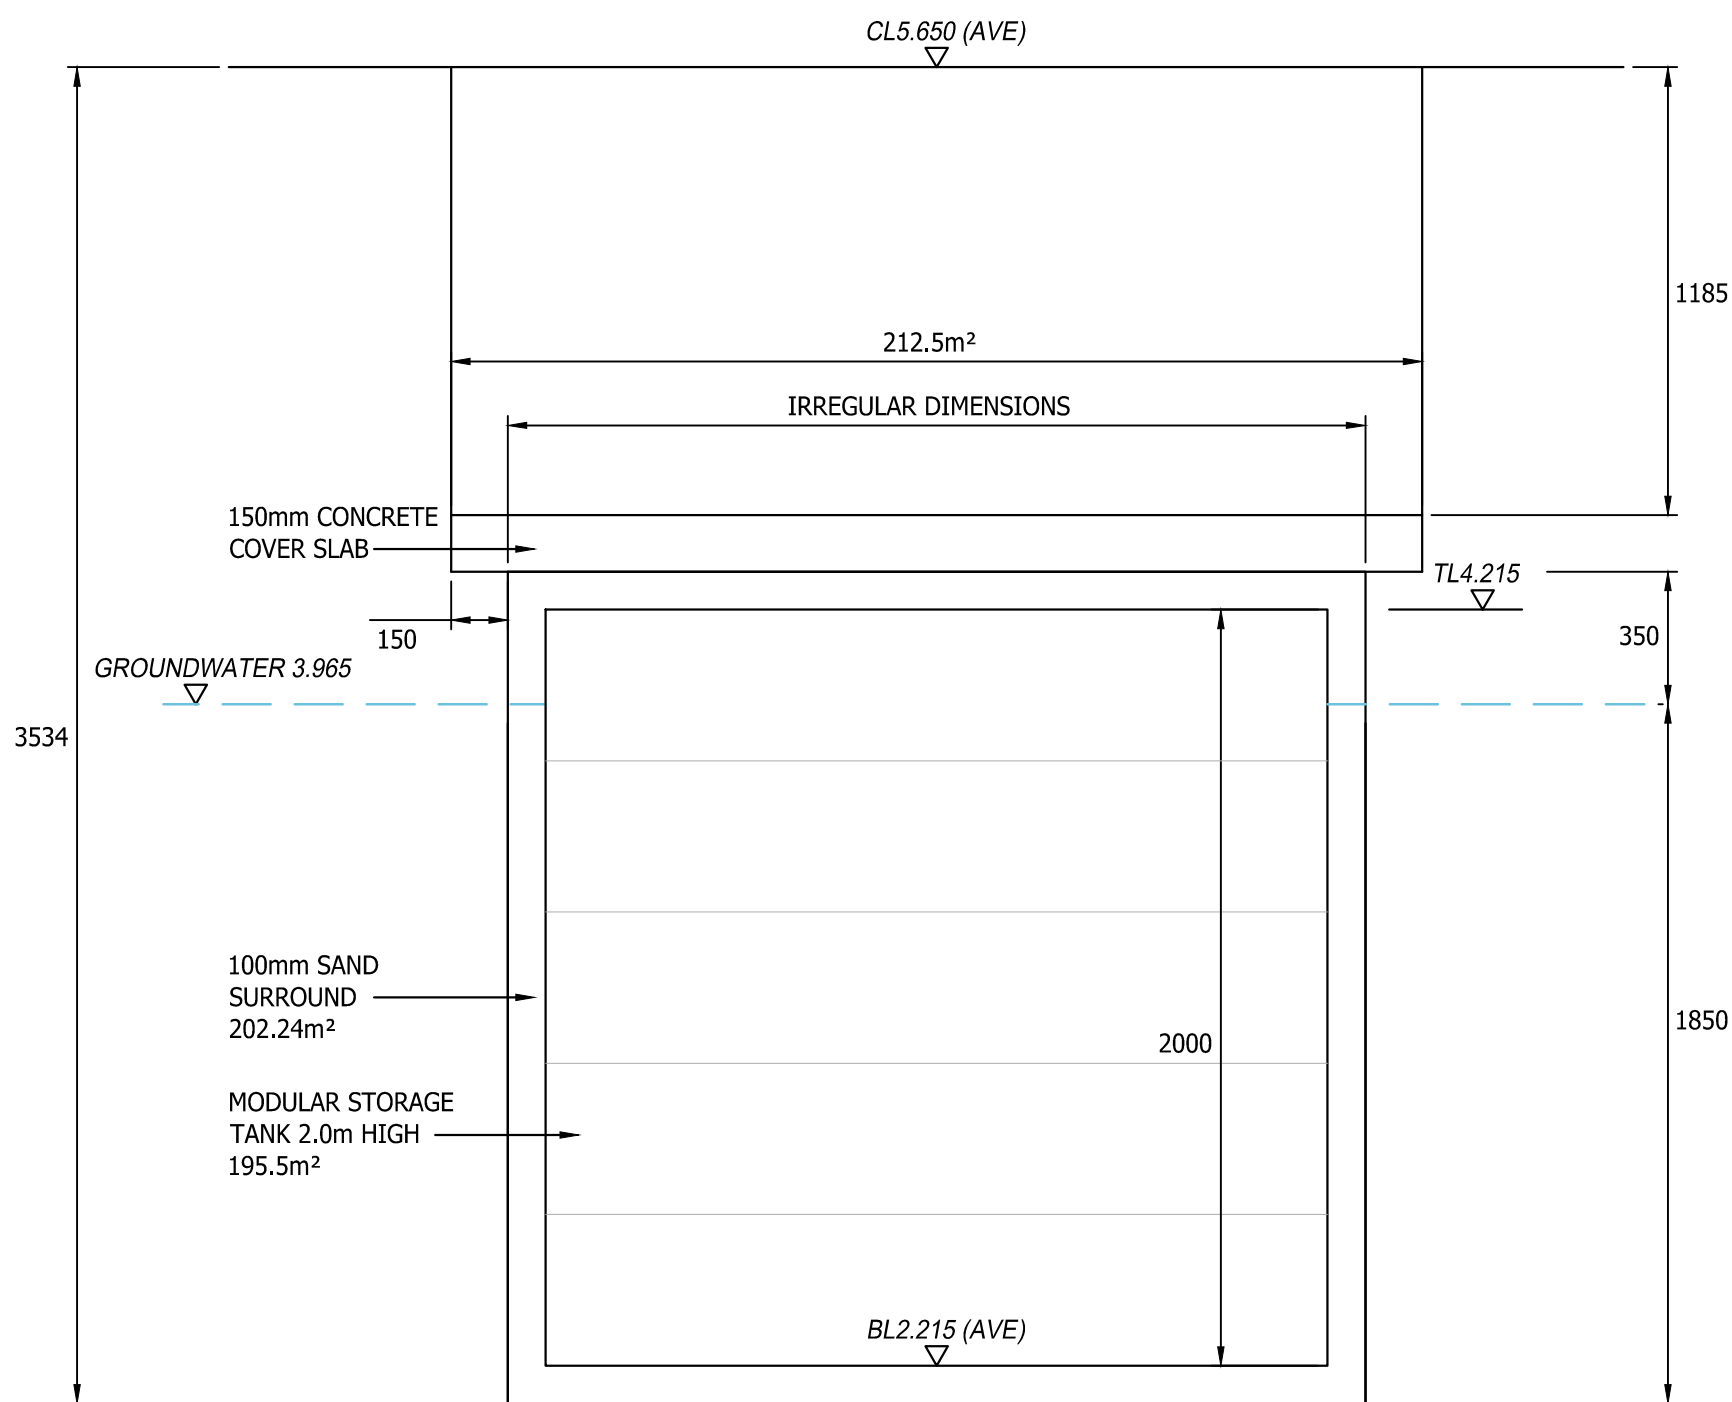

NORTHERN MODULAR STORAGE TANK (WITH FLOTATION MITIGATION)

T1	INITIAL ISSUE		03.07.20	DMS	ds
Rev	Amendments		Date	Dsn	Chk
Status	INFORMATION				
Client	 BARRATT HOMES				
Project	PEBBLE WALK, SINAH LANE HAYLING ISLAND, HANTS				
Title	FLOTATION CALCULATIONS MODULAR STORAGE TANK NORTHERN STORAGE TANK				
Date	JULY 2020	Scale @ A1	1:20		
Base Layout Ref.			CAD File ref.		
Clients Ref.			Project Ref.	10162	
 Gloucester House, 66a Church Walk, Burgess Hill, West Sussex, RH15 9AS Tel.01444 871444 Web: www.gtacivils.co.uk					
Drawing Number	10162/1106			Rev.	T1