

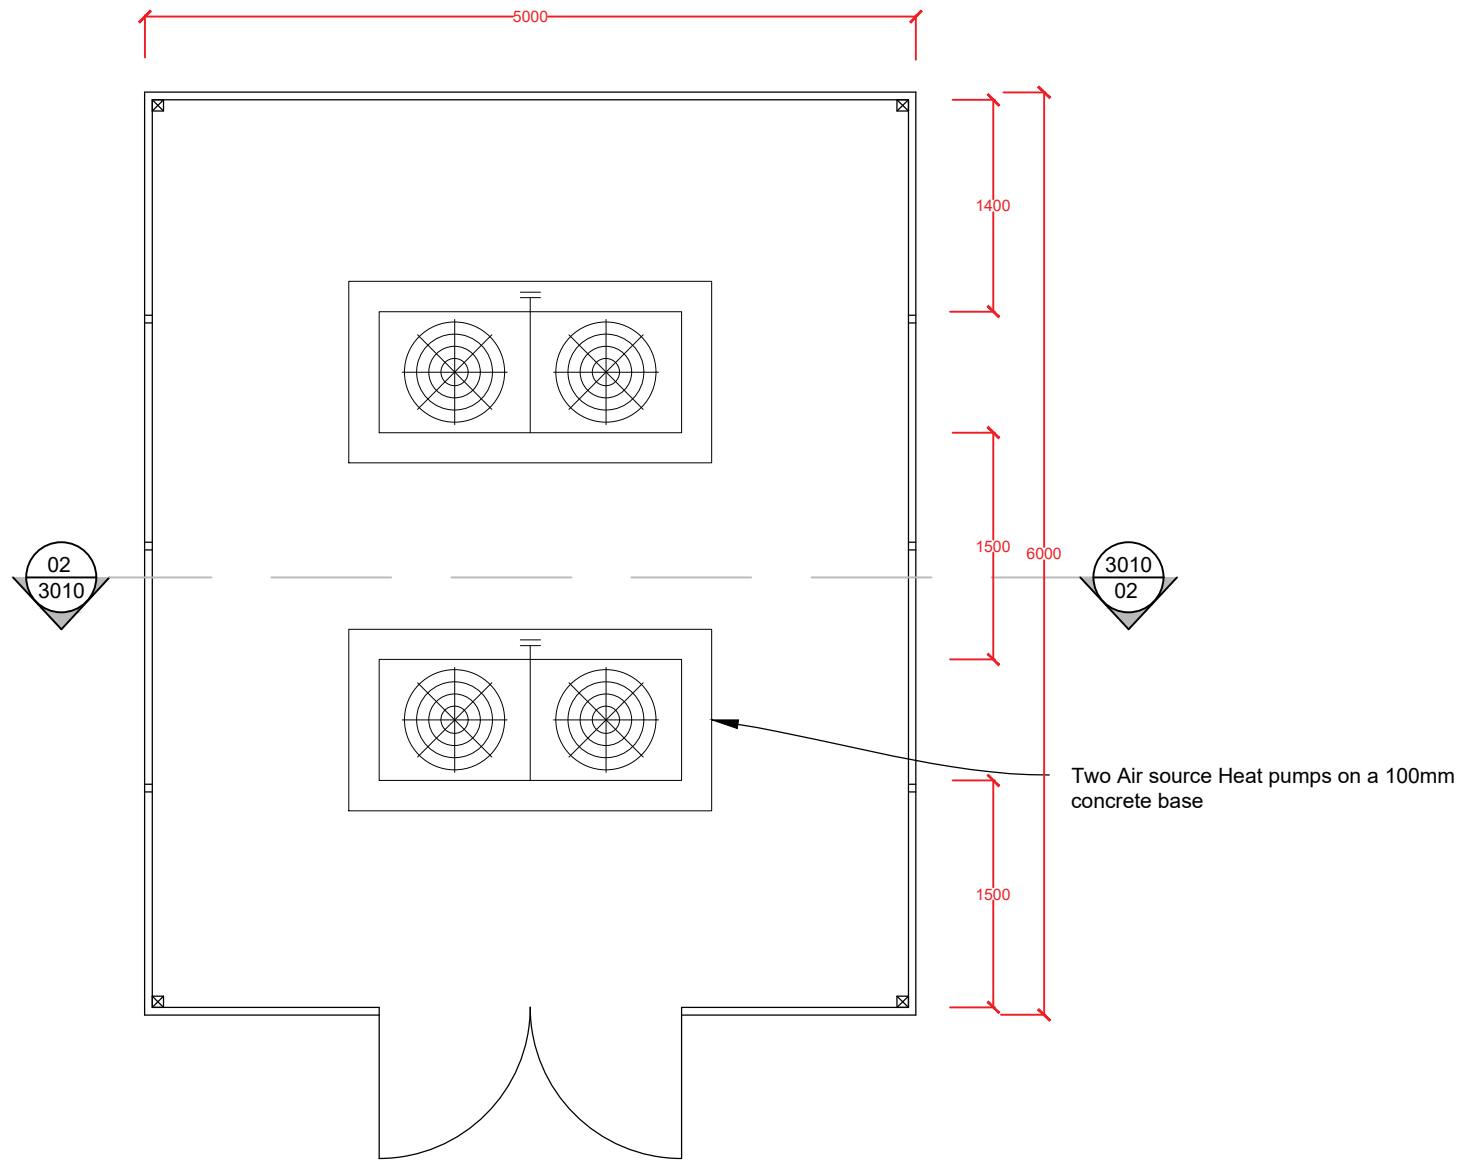




01 Plant Enclosure - As Proposed
3010 1:50 (at A3)

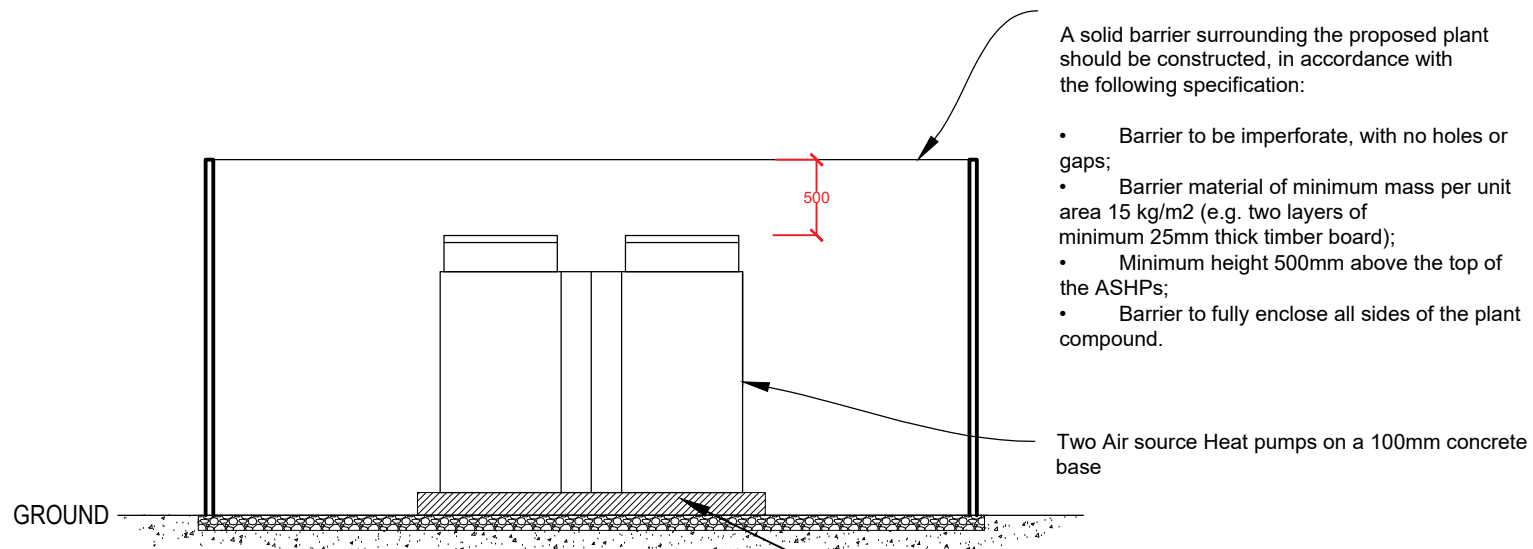


A solid barrier surrounding the proposed plant should be constructed, in accordance with the following specification:


- Barrier to be imperforate, with no holes or gaps;
- Barrier material of minimum mass per unit area 15 kg/m² (e.g. two layers of minimum 25mm thick timber board);
- Minimum height 500mm above the top of the ASHPs;
- Barrier to fully enclose all sides of the plant compound.

Two Air source Heat pumps on a 100mm concrete base


02 Cut A - A - As Proposed
3010 1:50 (at A3)

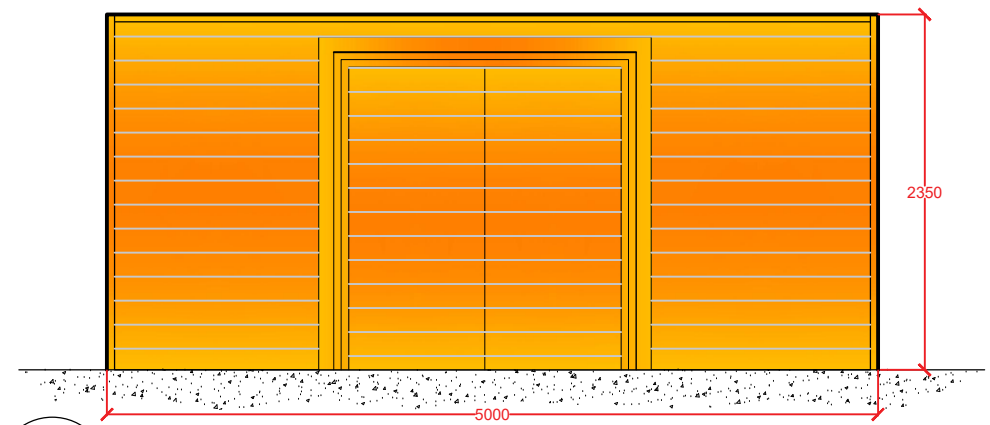

03 Front Elevation - As Proposed
3010 1:50 (at A3)

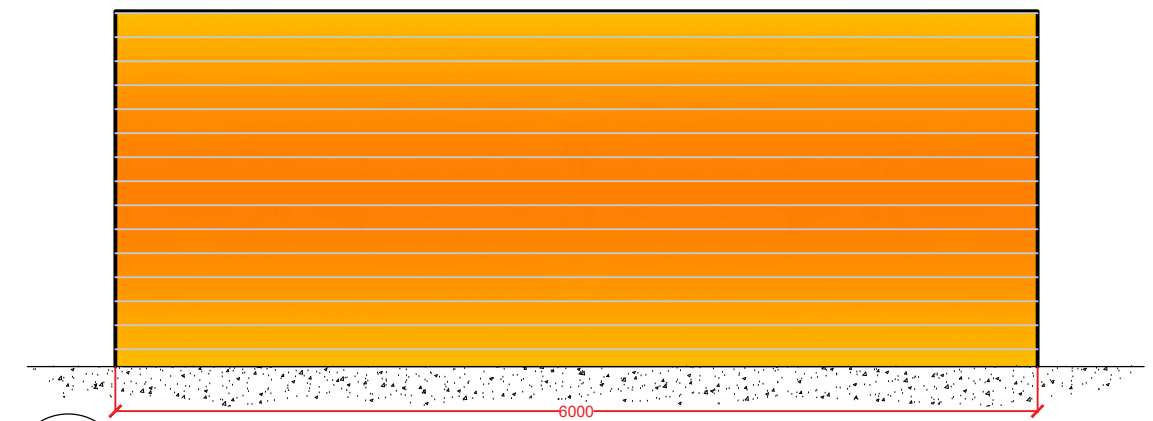

04 Side Elevation - As Proposed
3010 1:50 (at A3)

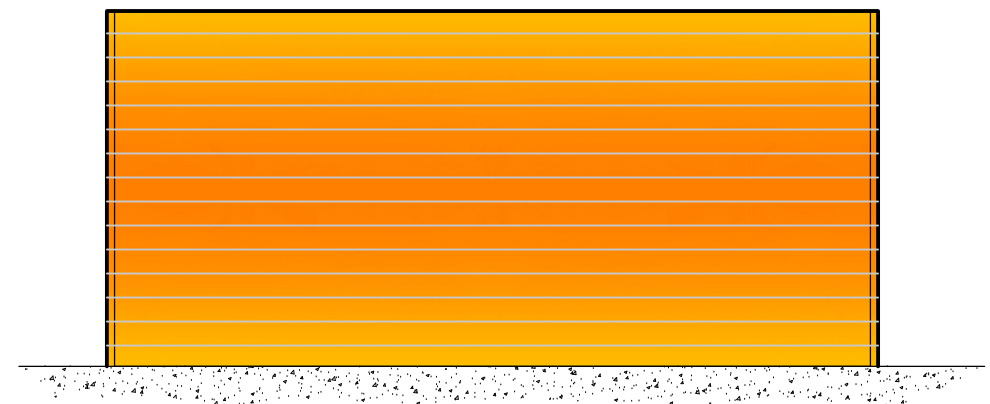

05 Rear Elevation - As Proposed
3010 1:50 (at A3)

Scale in Metres



for 1:50

Project: Erection of a Acoustic Enclosure at Waterlooville Health Centre, Dryden Close, Waterlooville, PO7 6AL		
Drawing Title: Proposed Floor Plans and Elevations		
Drawing Number: 3010	Date: 22/04/22	Revision: A
Scale: (at A3) 1:50		Status: Planning Permission
Client: NHS Property Services		