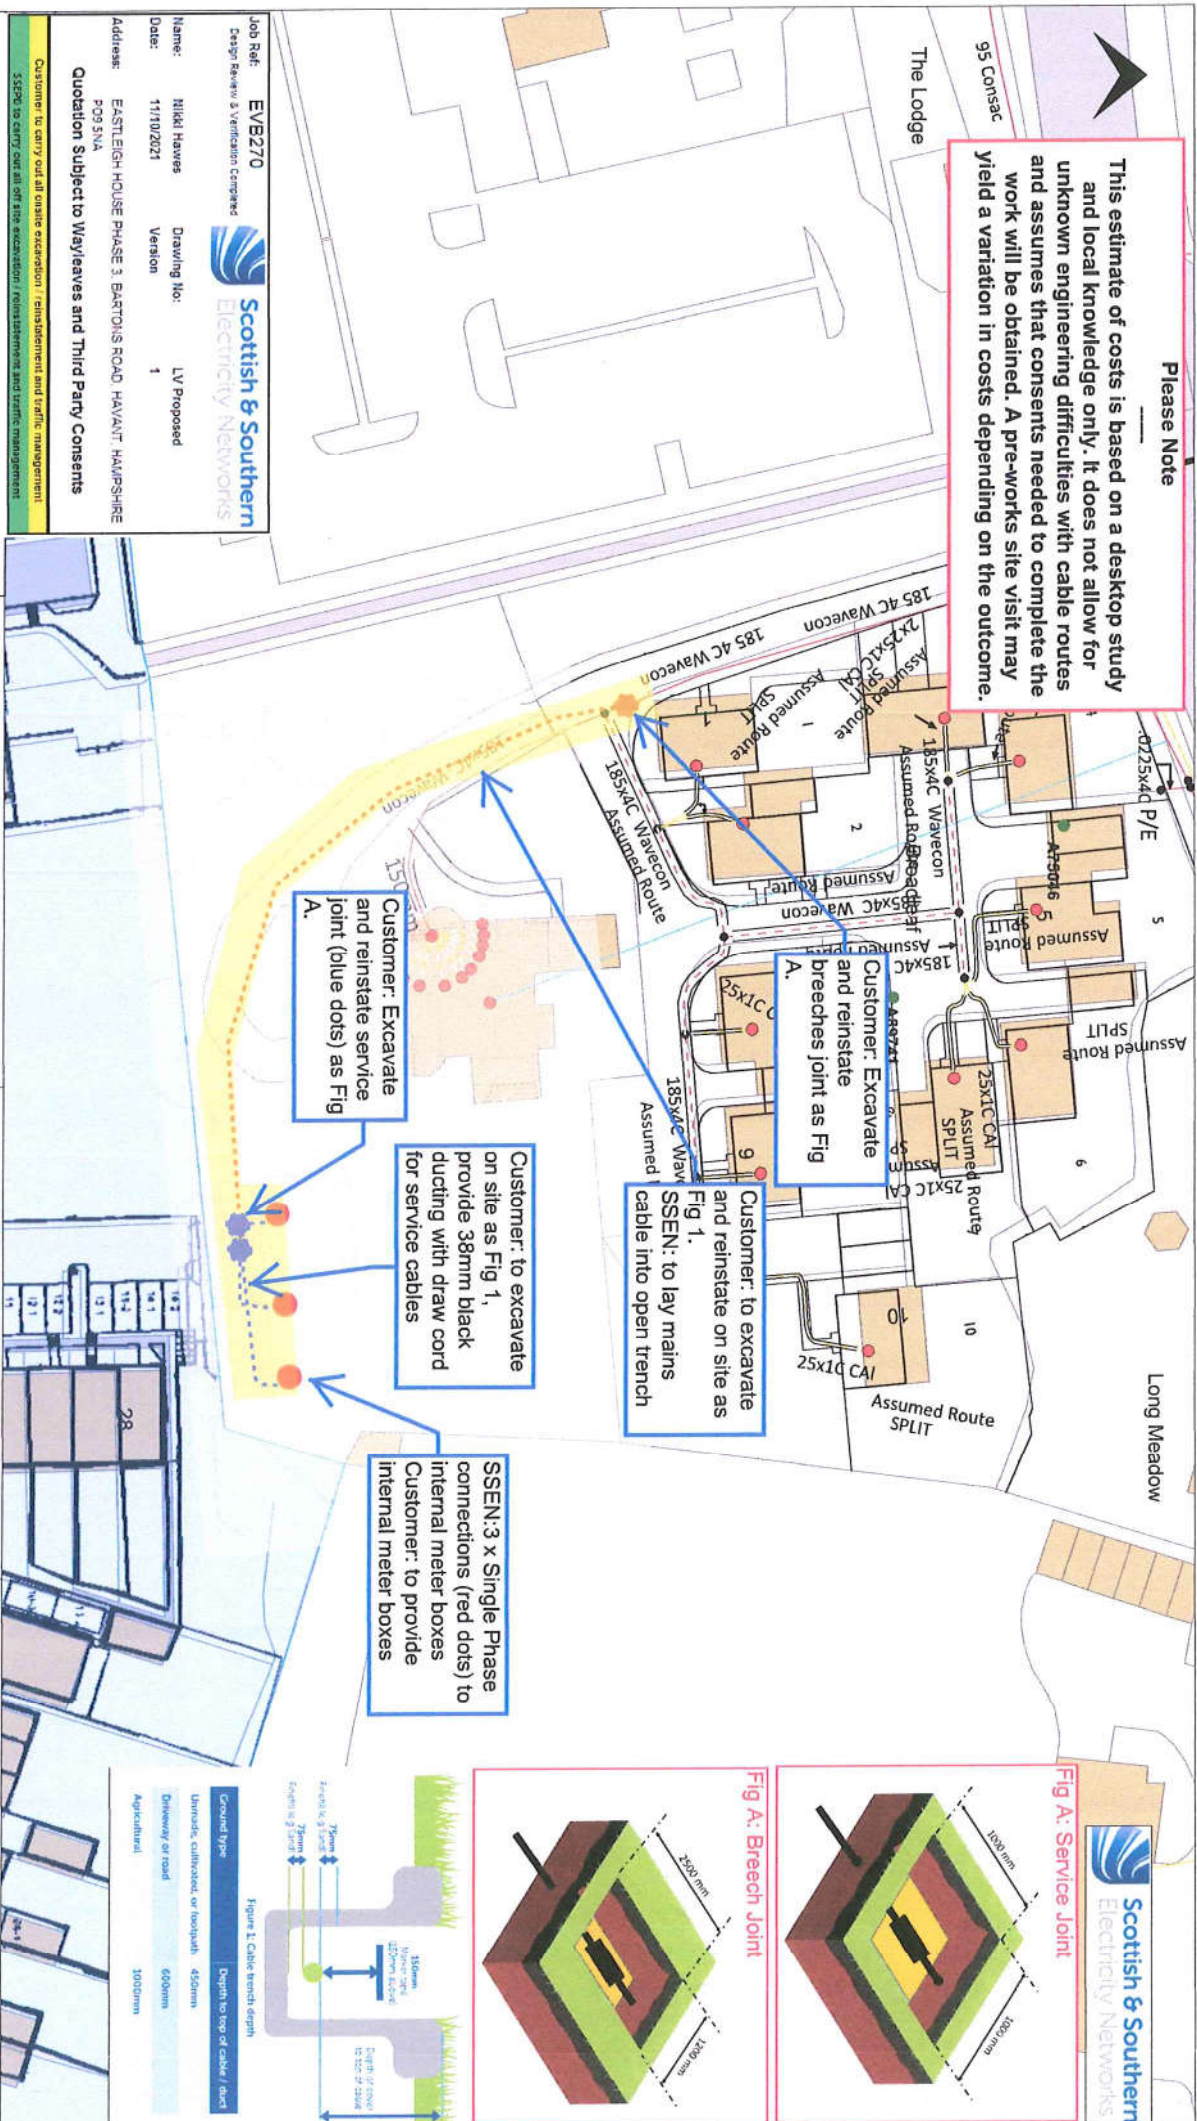


Condition.6.

Meter positions as required by SSE/Southern Water

This estimate of costs is based on a desktop study and local knowledge only. It does not allow for unknown engineering difficulties with cable routes and assumes that consents needed to complete the work will be obtained. A pre-works site visit may yield a variation in costs depending on the outcome.

[illegible]