

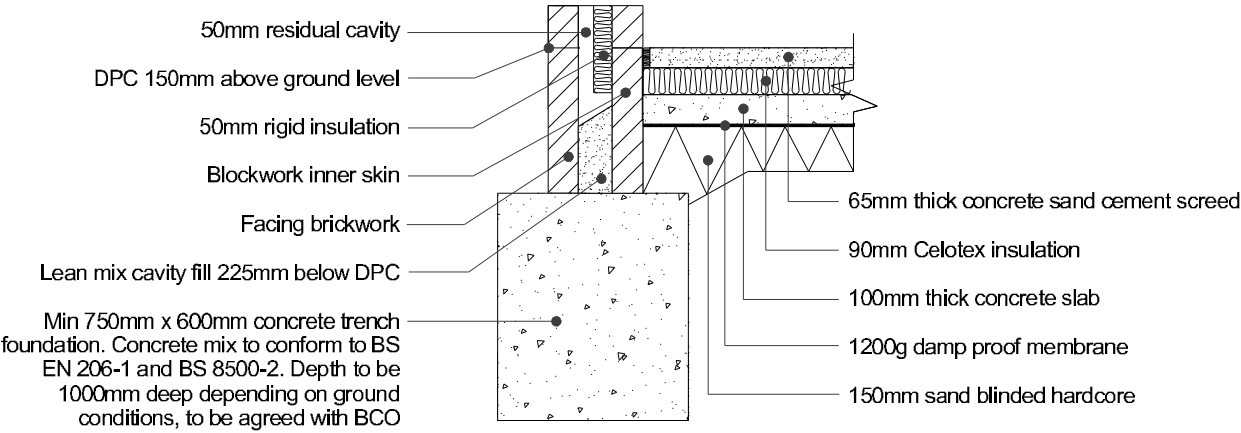


EXISTING STRUCTURE
Existing structure including foundations, beams, walls and lintels carrying new and altered loads are to be exposed and checked for adequacy prior to commencement of work and as required by the Building Control Officer.

FOUNDATION PLAN
1:50

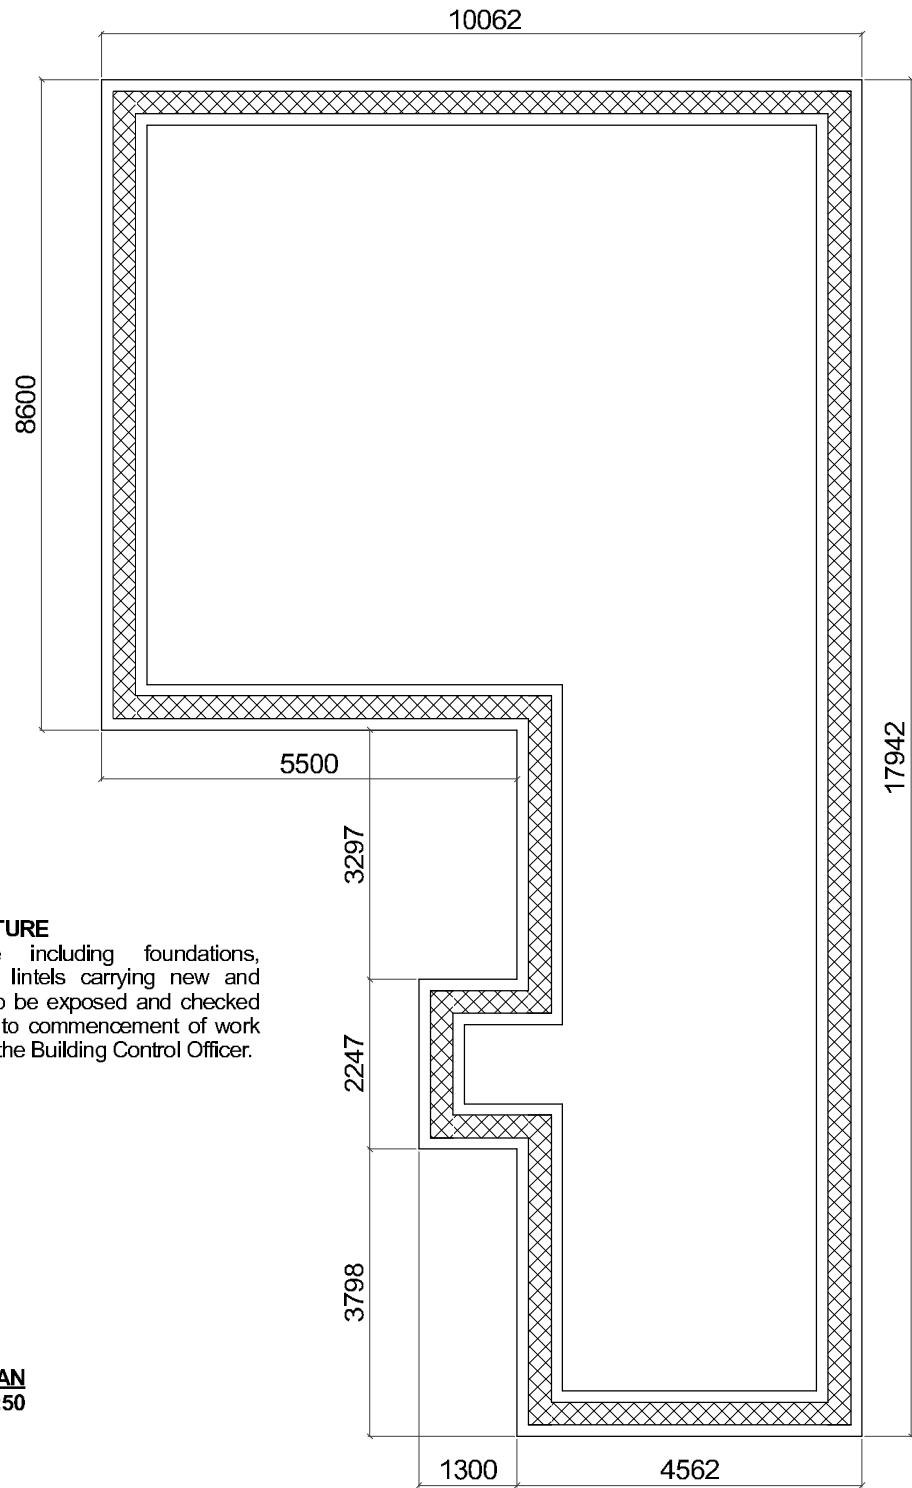


TRENCH FOUNDATION DETAIL
1:25

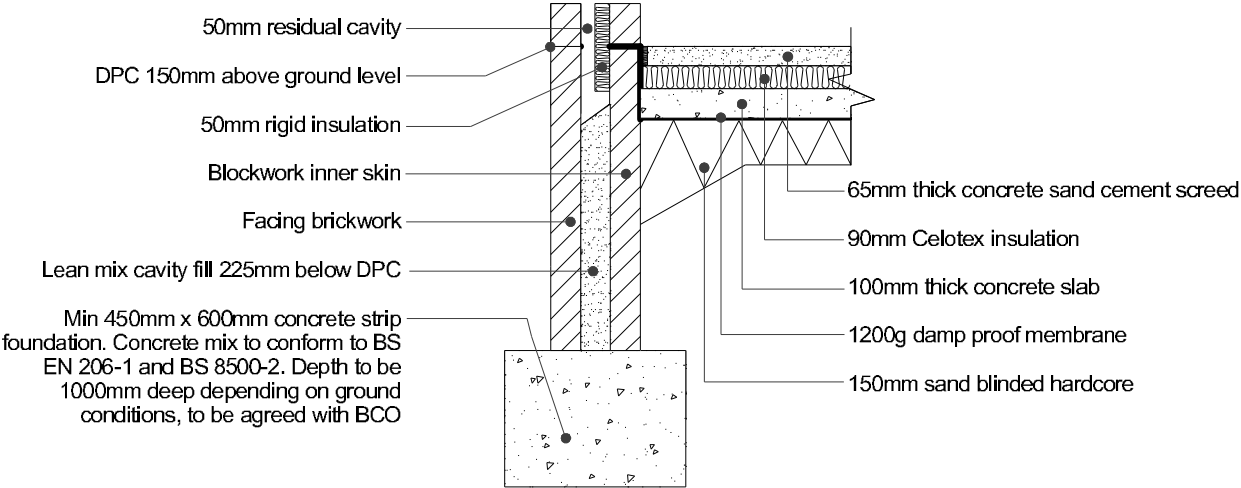

STRIP FOUNDATION DETAIL
1:25

FOUNDATIONS
Provide 750mm x 600mm trench fill foundations, or 450mm x 600mm for strip foundations, depending on site conditions. Concrete mix to conform to BS EN 206-1 and BS 8500-2. All foundations to be a minimum of 1000mm below ground level, exact depth to be agreed on site with Building Control Officer to suit site conditions. All constructed in accordance with 2004 Building Regulations A1/2 and BS 8004:1986 Code of Practice for Foundations. Ensure foundations are constructed below invert level of any adjacent drains. Base of foundations supporting internal walls to be min 600mm below ground level. Sulphate resistant cement to be used if required. Please note that should any adverse soil conditions or difference in soil type be found or any major tree roots in excavations, the Building Control Officer is to be contacted and the advice of a structural engineer should be sought.

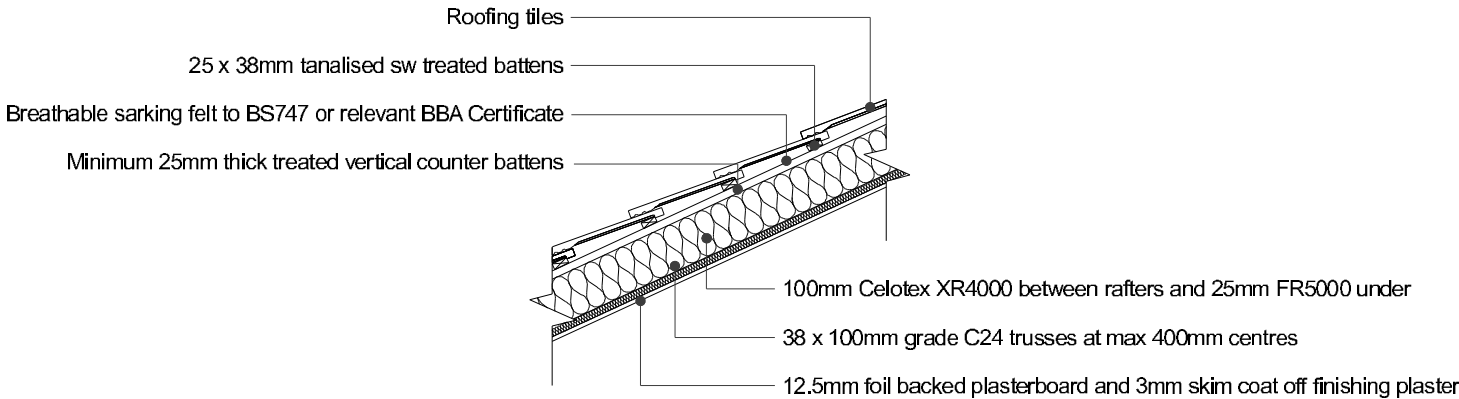

UNVENTED TRUSSED ROOF DETAIL
1:25

FOUNDATION AND ROOF DETAILS