
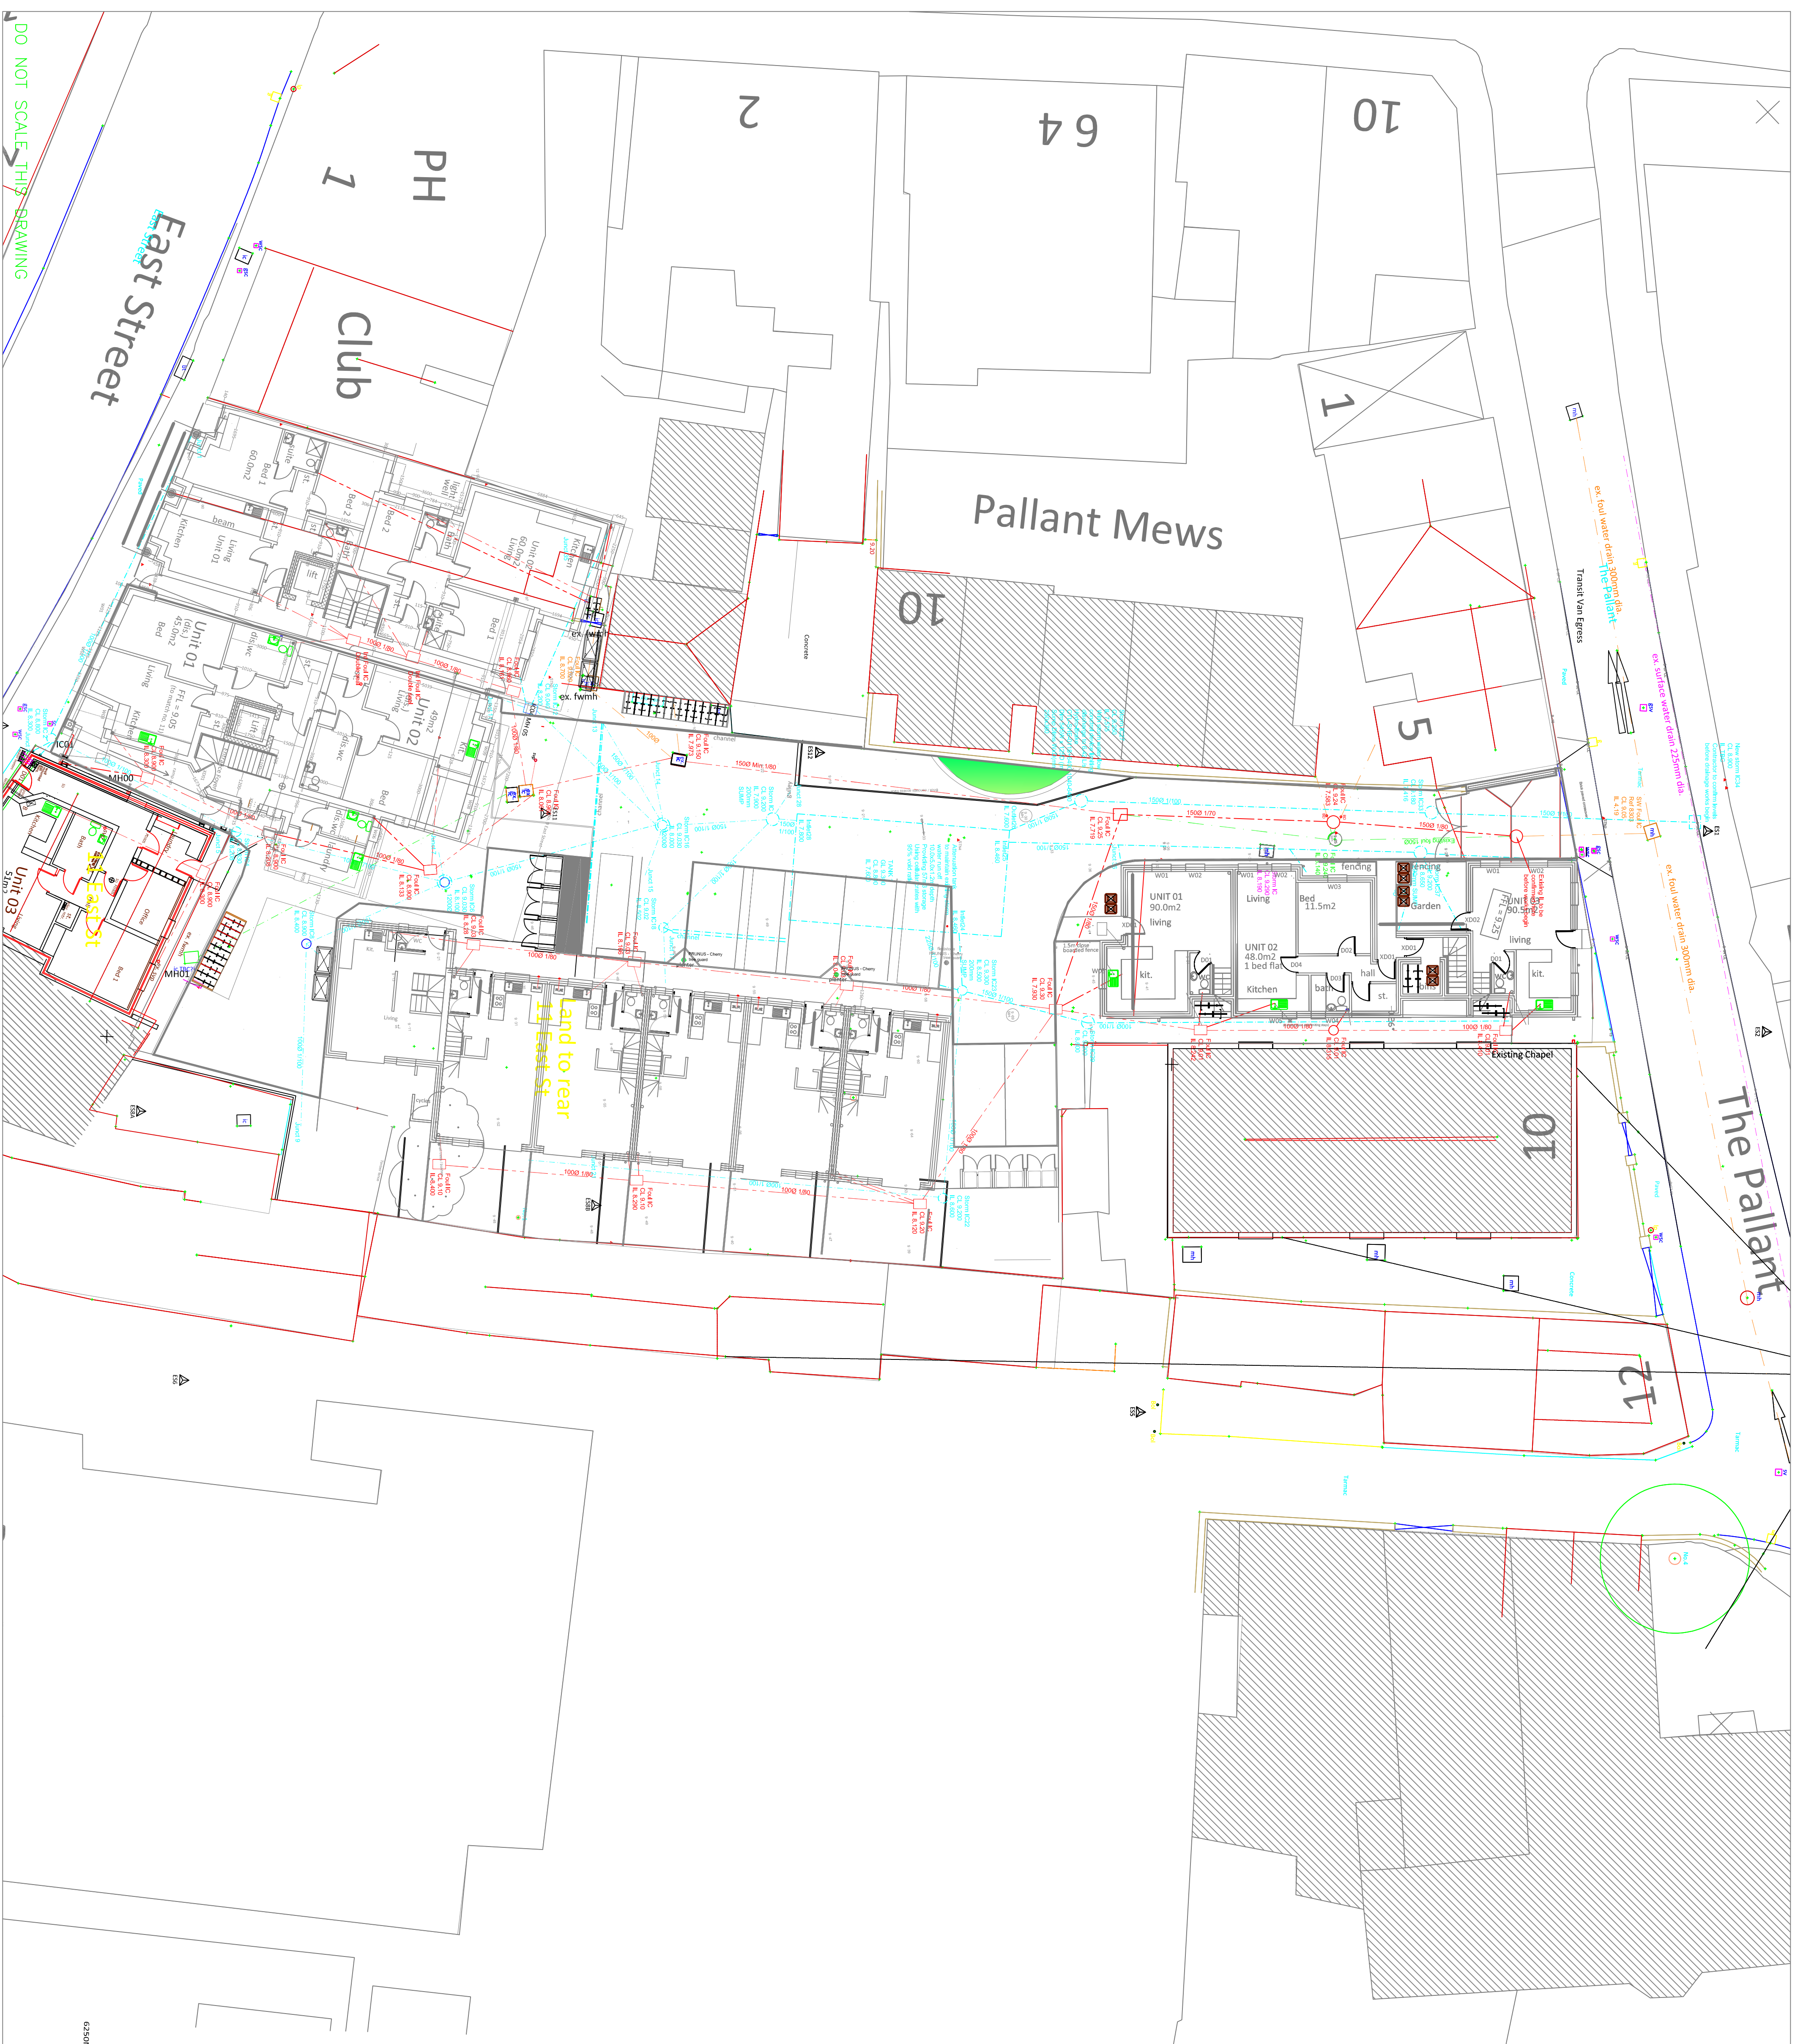




NOTES

1. This drawing is to be read in conjunction with all relevant Engineers and Architects drawings.
2. All dimensions are in millimetres unless noted otherwise. All levels are in Metres above an arbitrary datum and not to Ordnance Datum.
3. In accordance with CDM 2015 the Contractor is to:
 - Notify HSE of works.
 - Comply with the requirements of Health and Safety Plan(if applicable)
 - Provide risk assessments and method statements for all potential hazards relevant to this project.
4. The main contractor shall be responsible for the setting out and accuracy of all dimensions. He shall satisfy himself that the information given is correct and any discrepancies should be noted to the Engineer immediately.
5. DO NOT SCALE. If discrepancy or query arises on dimensions consult Engineer.
6. The Contractor is responsible for specifying product and codes and ordering of drainage materials.
7. All drainage to be installed to BS5955 Pt6 and in strict accordance with the manufacturers instructions.
8. All PVCu drainage products to conform to BS EN1401 & Kite mark certified in accordance with specification. If used for connection to public sewer must be able to withstand 4000psi.
9. All drainage pipes on this drwg to be 100mmØ unless shown otherwise. Min. falls 1/80 for foul and 1/100 for storm drainage.
10. Cover grades and gully gratings are in accordance with BS497 Pt 1
Cover Grades :- D400 – carriageways.
B125 – carriageways for slow traffic.
A15 – inaccessible to vehicles
11. Sewer runs and manholes to be adopted are to be in accordance with Sewers for Adoption, 7th Edition.
12. Any drainage laid less than 600mm below FDL to be covered with minimum 150mm Gen 3 grade concrete to half diameter.
13. No foul or storm water drainage sewer connection works to be undertaken until correct permission has been obtained by Contractor and granted by the Southern Water.
14. Provide 100x100 PCC inlet max spon 650mm where s/wp exits the building.
15. ACO channels installed and bedded to manufacturers requirements.
16. Externl backdrop connection to comply with backdrop detail within Sewers for adoption 7th edition.

[illegible][illegible]

 **Cowan**
Consultancy

DIRECTOR, CIVIL AND HIGHWAY CONSULTANTS

3, 4400, Peirry Road,
Whiteley, Wokingham,
Fareham
Hampshire
PO15 7PU

Also at:
Langford Manor
Langford Manor Road
Witchamere,
Isle of Wight
PO37 7AB

Tel: 01489 577488
Fax: 01489 579873
consultants@cowanconsult.co.uk
www.cowanconsult.co.uk

Client	JNP Developments
Project	East Street, Hovont Hampshire
Title	Drainage General Arrangement

Date	Oct 2020	Scale	1/150	Proj. No.	414601.10P3
Drawn	EG	Chk'd	QAD		