


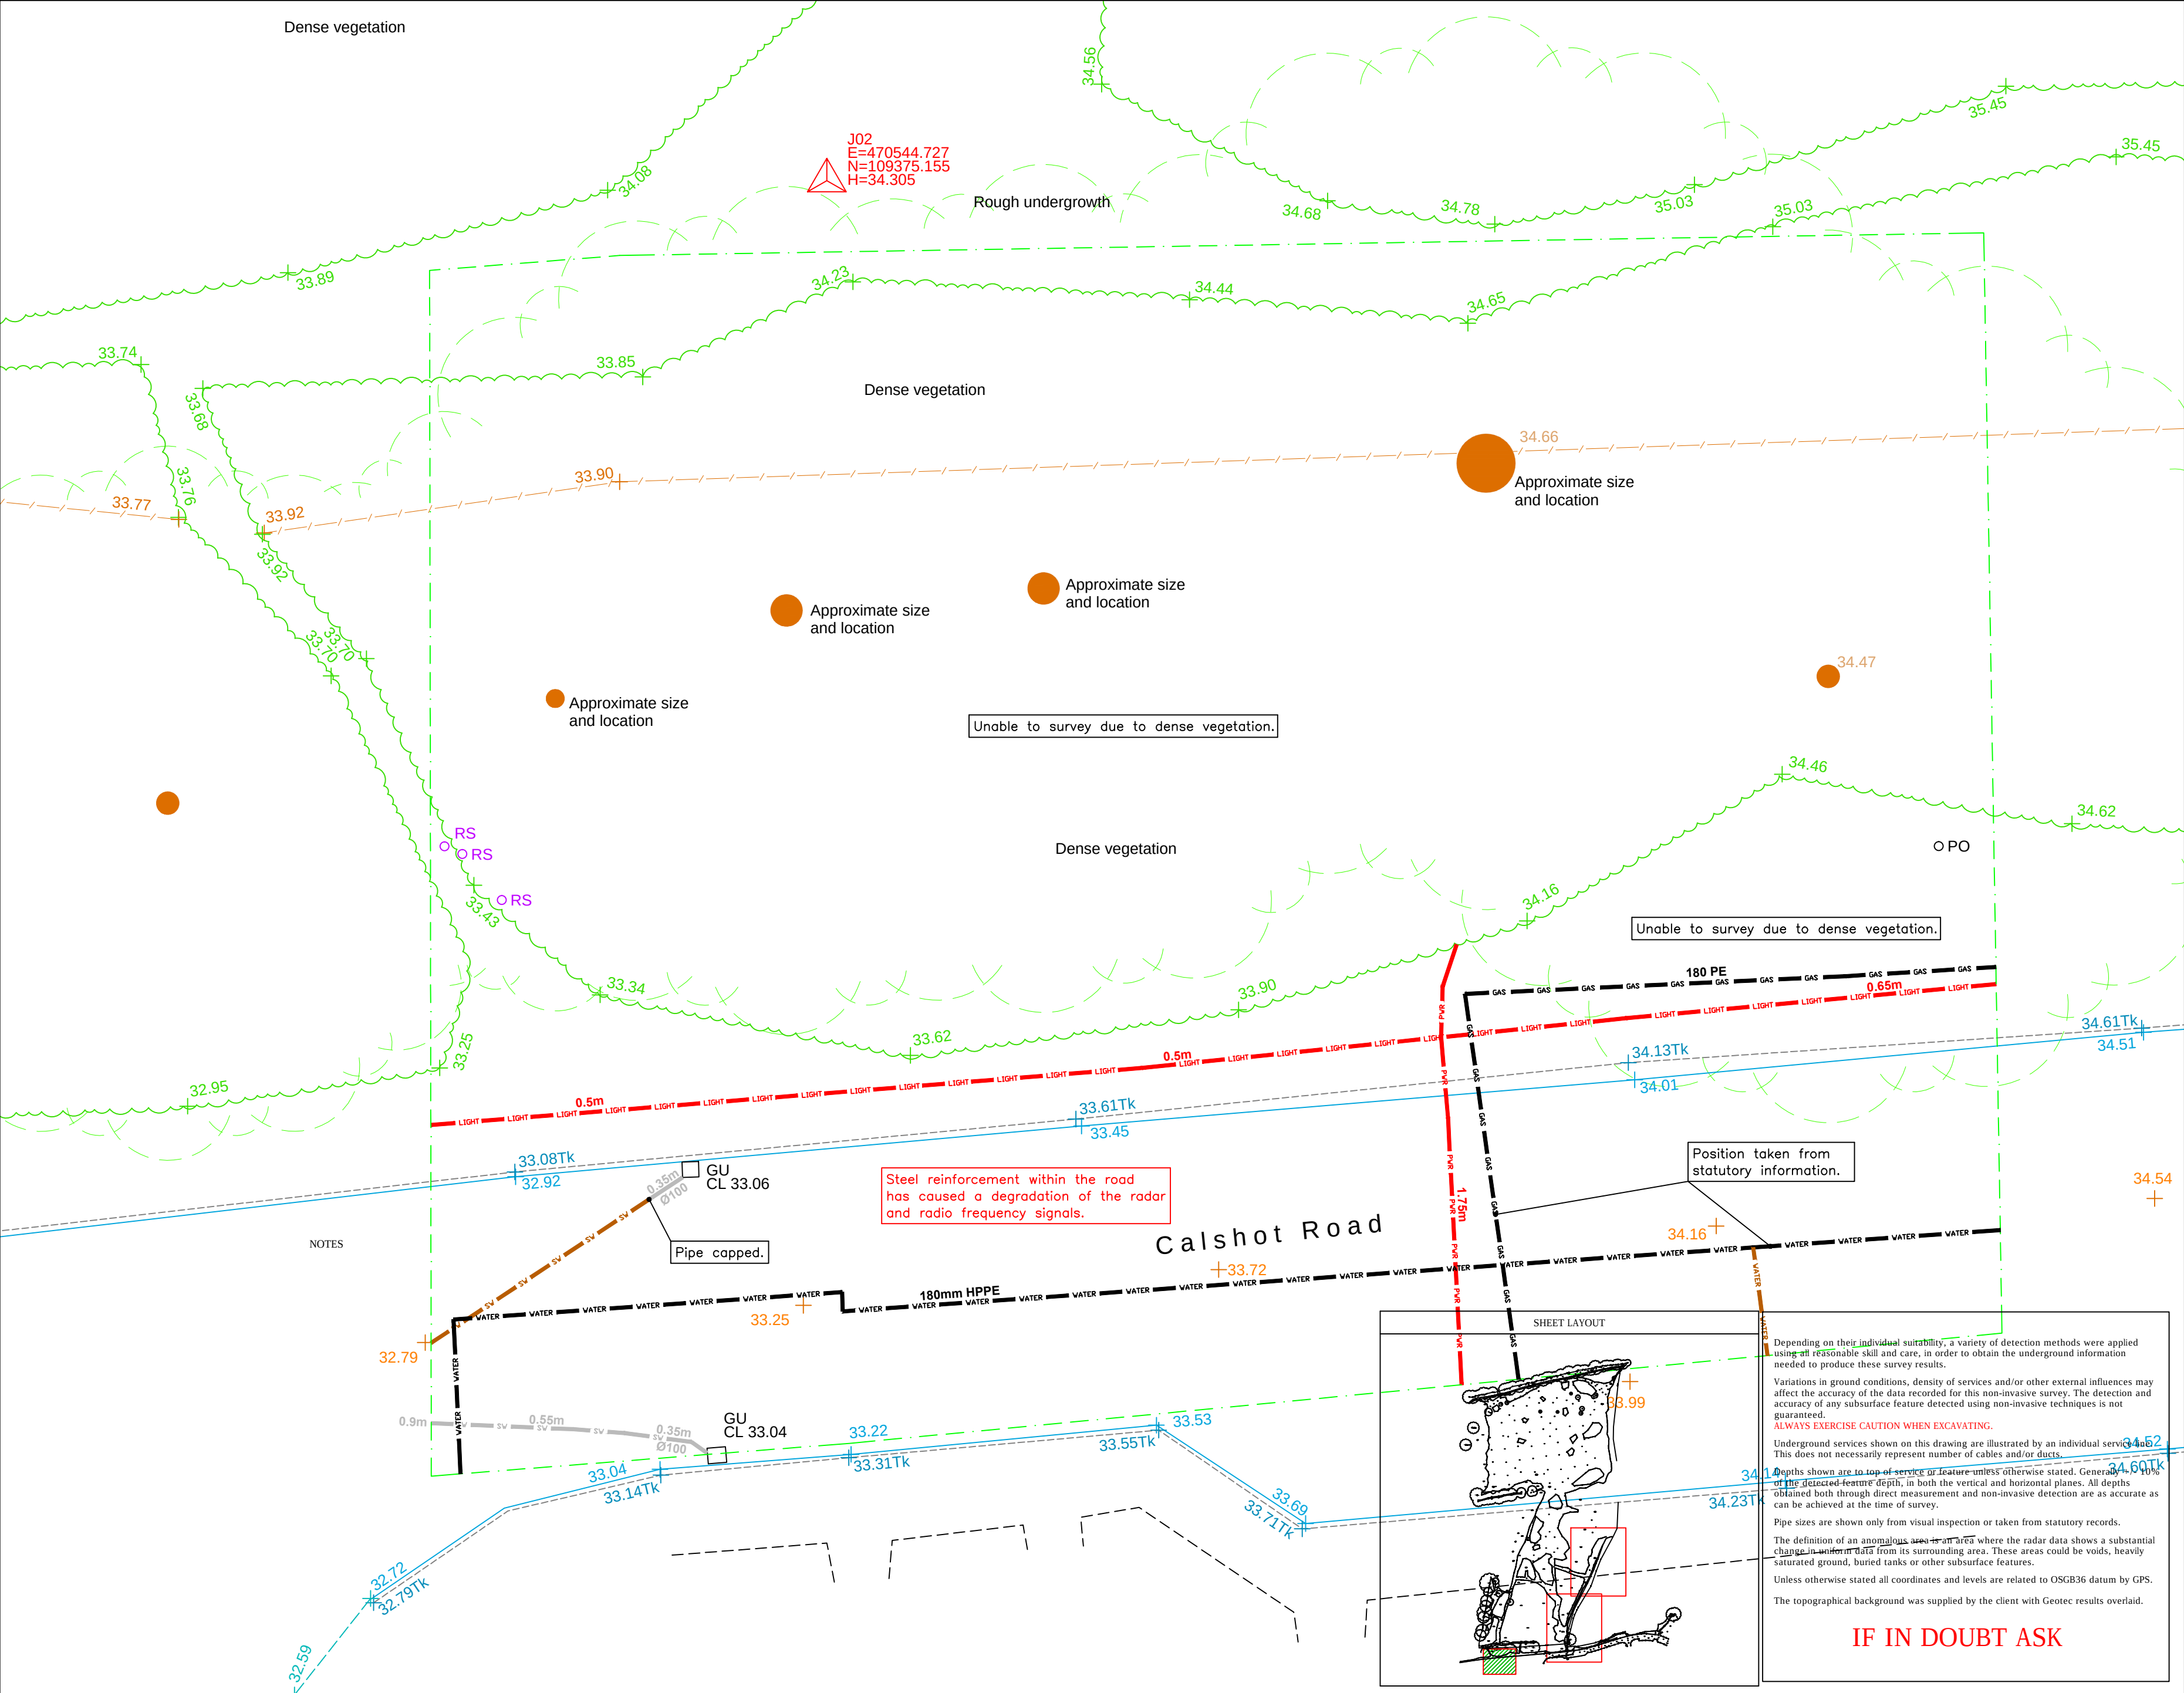

LEGEND

Scan Area	Radio Frequency Scan Area	Electricity Cable	Street Lighting	Power Carrying Feature	Telecommunication	Cable Television	Closed Circuit Television	Traffic Signalling	Alarm Cable	Telemetry	Fibre Optic	Energis	Unknown Cable	Empty Duct	Foul Water Sewer	Surface Water Drain	Combined Sewer	Culvert	Water Pipe	Fire Main	Gas Pipe	Oil Pipe	Fuel Main	Steam Pipe	Vent Pipe	Unknown Pipe	Earth Strap	Metallic Feature	Detected Linear Feature	Possible Linear Feature	
WATER	GAS	Light	PVR	TELCOM	CATV	CCTV	TCSU	ALARM	TELECOM	OPTICS	ENERGIS	CABLE	DUCT	FW	SW	COMB	CULVERT	WATER	FIRE	GAS	OIL	FUEL	STEAM	VENT	PIPE	EARTH	MET				
Taken from Statutory Information																															
Assumed																															
Anomalous Area																															
Area of Radio Frequency Disturbance																															
Area of Electrical Interference																															
Area of Reinforcing																															
Chamber																															
Unable to Survey																															

ABBREVIATIONS (where applicable)

AV	Air Valve	LP	Lamp Post
BB	Belisha Beacon	MH	Manhole
BC	Bottom of Chamber	MKR	Marker
BH	Borehole	P	Post
BOL	Bollard	RE	Rodding Eye
BT	British Telecom Cover	RG	Rain Gully
CAB	Cabinet	RS	Road Sign
CATV	Cable Television Cover	SP	Sign Post
CCTV	Closed Circuit TV	ST	Stop Tap
CL	Cover Level	STN	Survey Station
DIA	Diameter	SV	Sluice Valve
DP	Down Pipe	TC	Top of Chamber
EP	Electricity Pole	TCB	Telephone Call Box
ER	Earth Rod	TL	Traffic Light
FH	Fire Hydrant	TP	Telegraph Pole
GV	Gas Valve	UTL	Unable To Lift
IC	Inspection Cover	VP	Vent Pipe
IL	Invert Level	WM	Water Meter
IRS	Illuminated Road Sign	WO	Wash Out
JB	Junction Box		

GEOTEC
underground mapping

GEOTEC SURVEYS LIMITED
PO Box 99, Godalming, Surrey, GU7 2XT
TEL: 01428 686168 EMAIL: geotec@geotecsveys.com
FAX: 01428 686169 WEB: www.geotecsveys.com

Client: Portsmouth City Council Civic Offices Guildhall Square Portsmouth PO1 2AL		Site: Cabbagefield Row Svanmore Road Calshot Road, Havant Hampshire PO9 4EZ	
Project No: 2107s005		Date: July 2021	
Sheet No: 1 of 3		Scale: A2 Sheet @ 1:100	
Drawn by: FA		Approved by: JW	
Revision	Details	Initial	Date
Scale bar 0.0m 1.0m 2.0m 3.0m 4.0m 5.0m 6.0m			

Depending on their individual suitability, a variety of detection methods were applied using a reasonable skill and care, in order to obtain the underground information needed to produce these survey results.

Variations in ground conditions, density of services and/or other external influences may affect the accuracy of the data recorded for this non-invasive survey. The detection and accuracy of any subsurface feature detected using non-invasive techniques is not guaranteed.

ALWAYS EXERCISE CAUTION WHEN EXCAVATING.

Underground services shown on this drawing are illustrated by an individual service symbol. This does not necessarily represent number of cables and/or ducts.

Depths shown are to top of service or feature unless otherwise stated. Generally depths are shown as in situ from its surrounding area. These areas could be voids, heavily saturated ground, buried tanks or other subsurface features.

Pipe sizes are shown only from visual inspection or taken from statutory records.

The definition of an anomalous area is where the radar data shows a substantial change in impedance from its surrounding area. These areas could be voids, heavily saturated ground, buried tanks or other subsurface features.

Unless otherwise stated all coordinates and levels are related to OSGB36 datum by GPS.

The topographical background was supplied by the client with Geotec results overlaid.

IF IN DOUBT ASK