

Department of Planning and
Development
Havant Borough Council
Public Service Plaza
Civic Centre Road
Havant
Hampshire
PO9 2AX

Developer Services
Southern Water
Southern House
Sparrowgrove
Otterbourne
Hampshire
SO21 2SW

Tel: 0330 303 0119

Email: developerservices@southernwater.co.uk

Your Ref

APP/15/00772

Our Ref

PLAN-010695

Date

17/08/2015

Dear Sir

Proposal: Erection of a foodstore (Class A1) with associated parking, servicing, access and landscaping.

Site: Former BAE Systems, Elettra Avenue, Waterlooville, PO7 7XW.
APP/15/00772

Thank you for your letter of 29/07/2015

Please find attached a plan of the sewer records showing the approximate position of a public surface water sewer crossing the site. The exact position of the public sewers must be determined on site by the applicant before the layout of the proposed development is finalised.

Please note:

- No development or new tree planting should be located within 5 metres either side of the centreline of the public sewer and all existing infrastructure should be protected during the course of construction works.
- No new soakaways should be located within 5 metres of a public sewer.

In order to protect drainage apparatus, Southern Water requests that if consent is granted, a condition is attached to the planning permission. For example "The developer must advise the local authority (in consultation with Southern Water) of the measures which will be undertaken to protect the public surface water sewers, prior to the commencement of the development."

Due to changes in legislation that came in to force on 1st October 2011 regarding the future ownership of sewers it is possible that a sewer now deemed to be public could be crossing the above property. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its condition, the number of properties served, and potential means of access before

any further works commence on site. The applicant is advised to discuss the matter further with Southern Water, Sparrowgrove House, Sparrowgrove, Otterbourne, Hampshire SO21 2SW (Tel: 0330 303 0119) or www.southernwater.co.uk".

Southern Water requires a formal application for a connection to the public foul and surface water sewer to be made by the applicant or developer.


We request that should this application receive planning approval, the following informative is attached to the consent:

"A formal application for connection to the public sewerage system is required in order to service this development, Please contact Southern Water, Sparrowgrove House, Sparrowgrove, Otterbourne, Hampshire SO21 2SW (Tel: 0330 303 0119) or www.southernwater.co.uk".

The applicant should be advised that a wastewater grease trap should be provided on the kitchen waste pipe or drain installed and maintained by the owner or operator of the premises.

Land uses such as general hardstanding that may be subject to oil/petrol spillages should be drained by means of oil trap gullies or petrol/oil interceptors.


Yours sincerely



Developer Services

18 AUG 2015

Brambles Farm
Industrial Estate

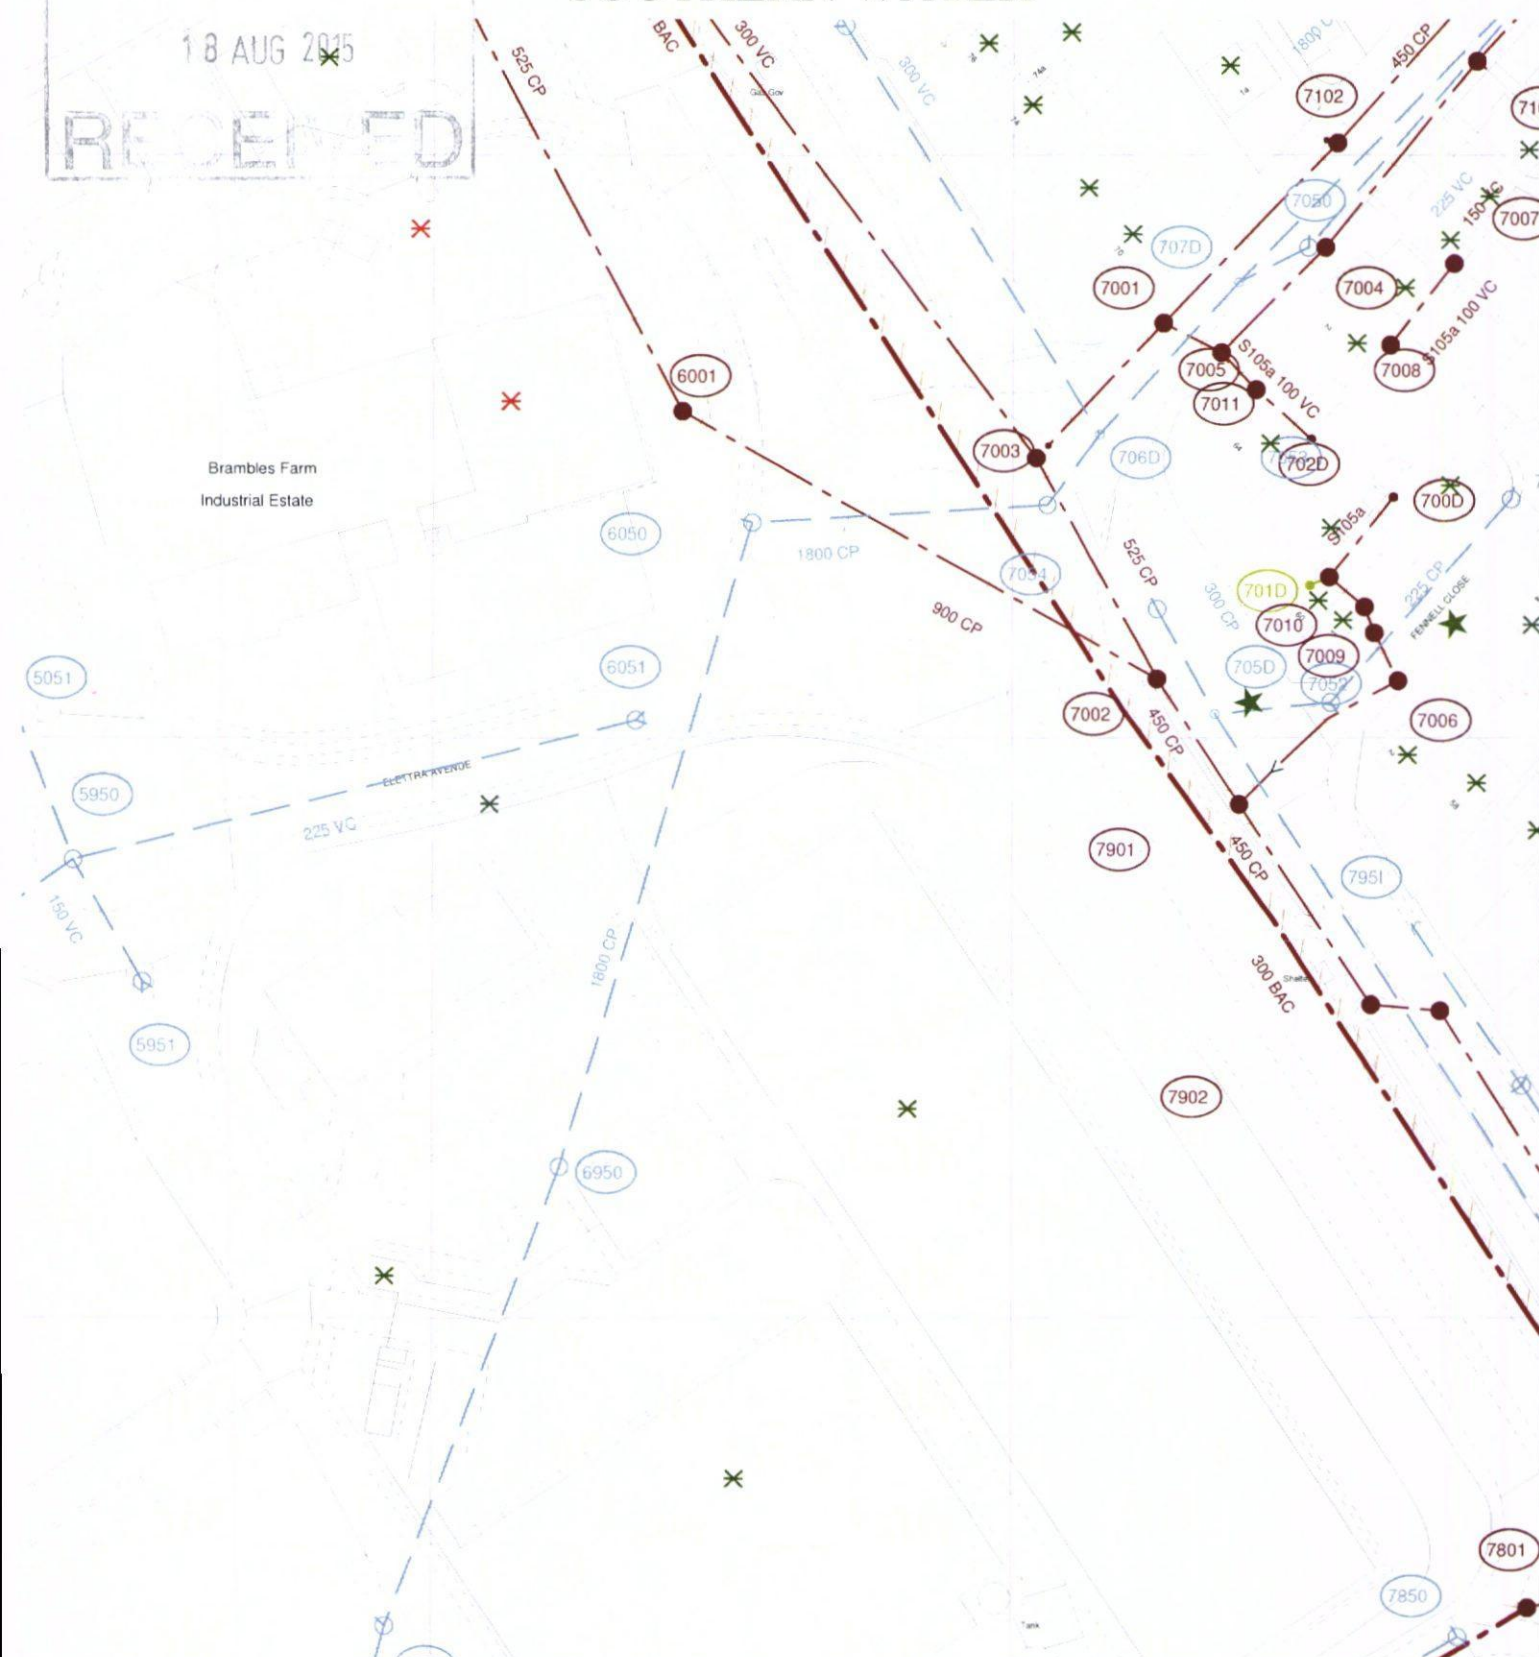

Requested By:

