


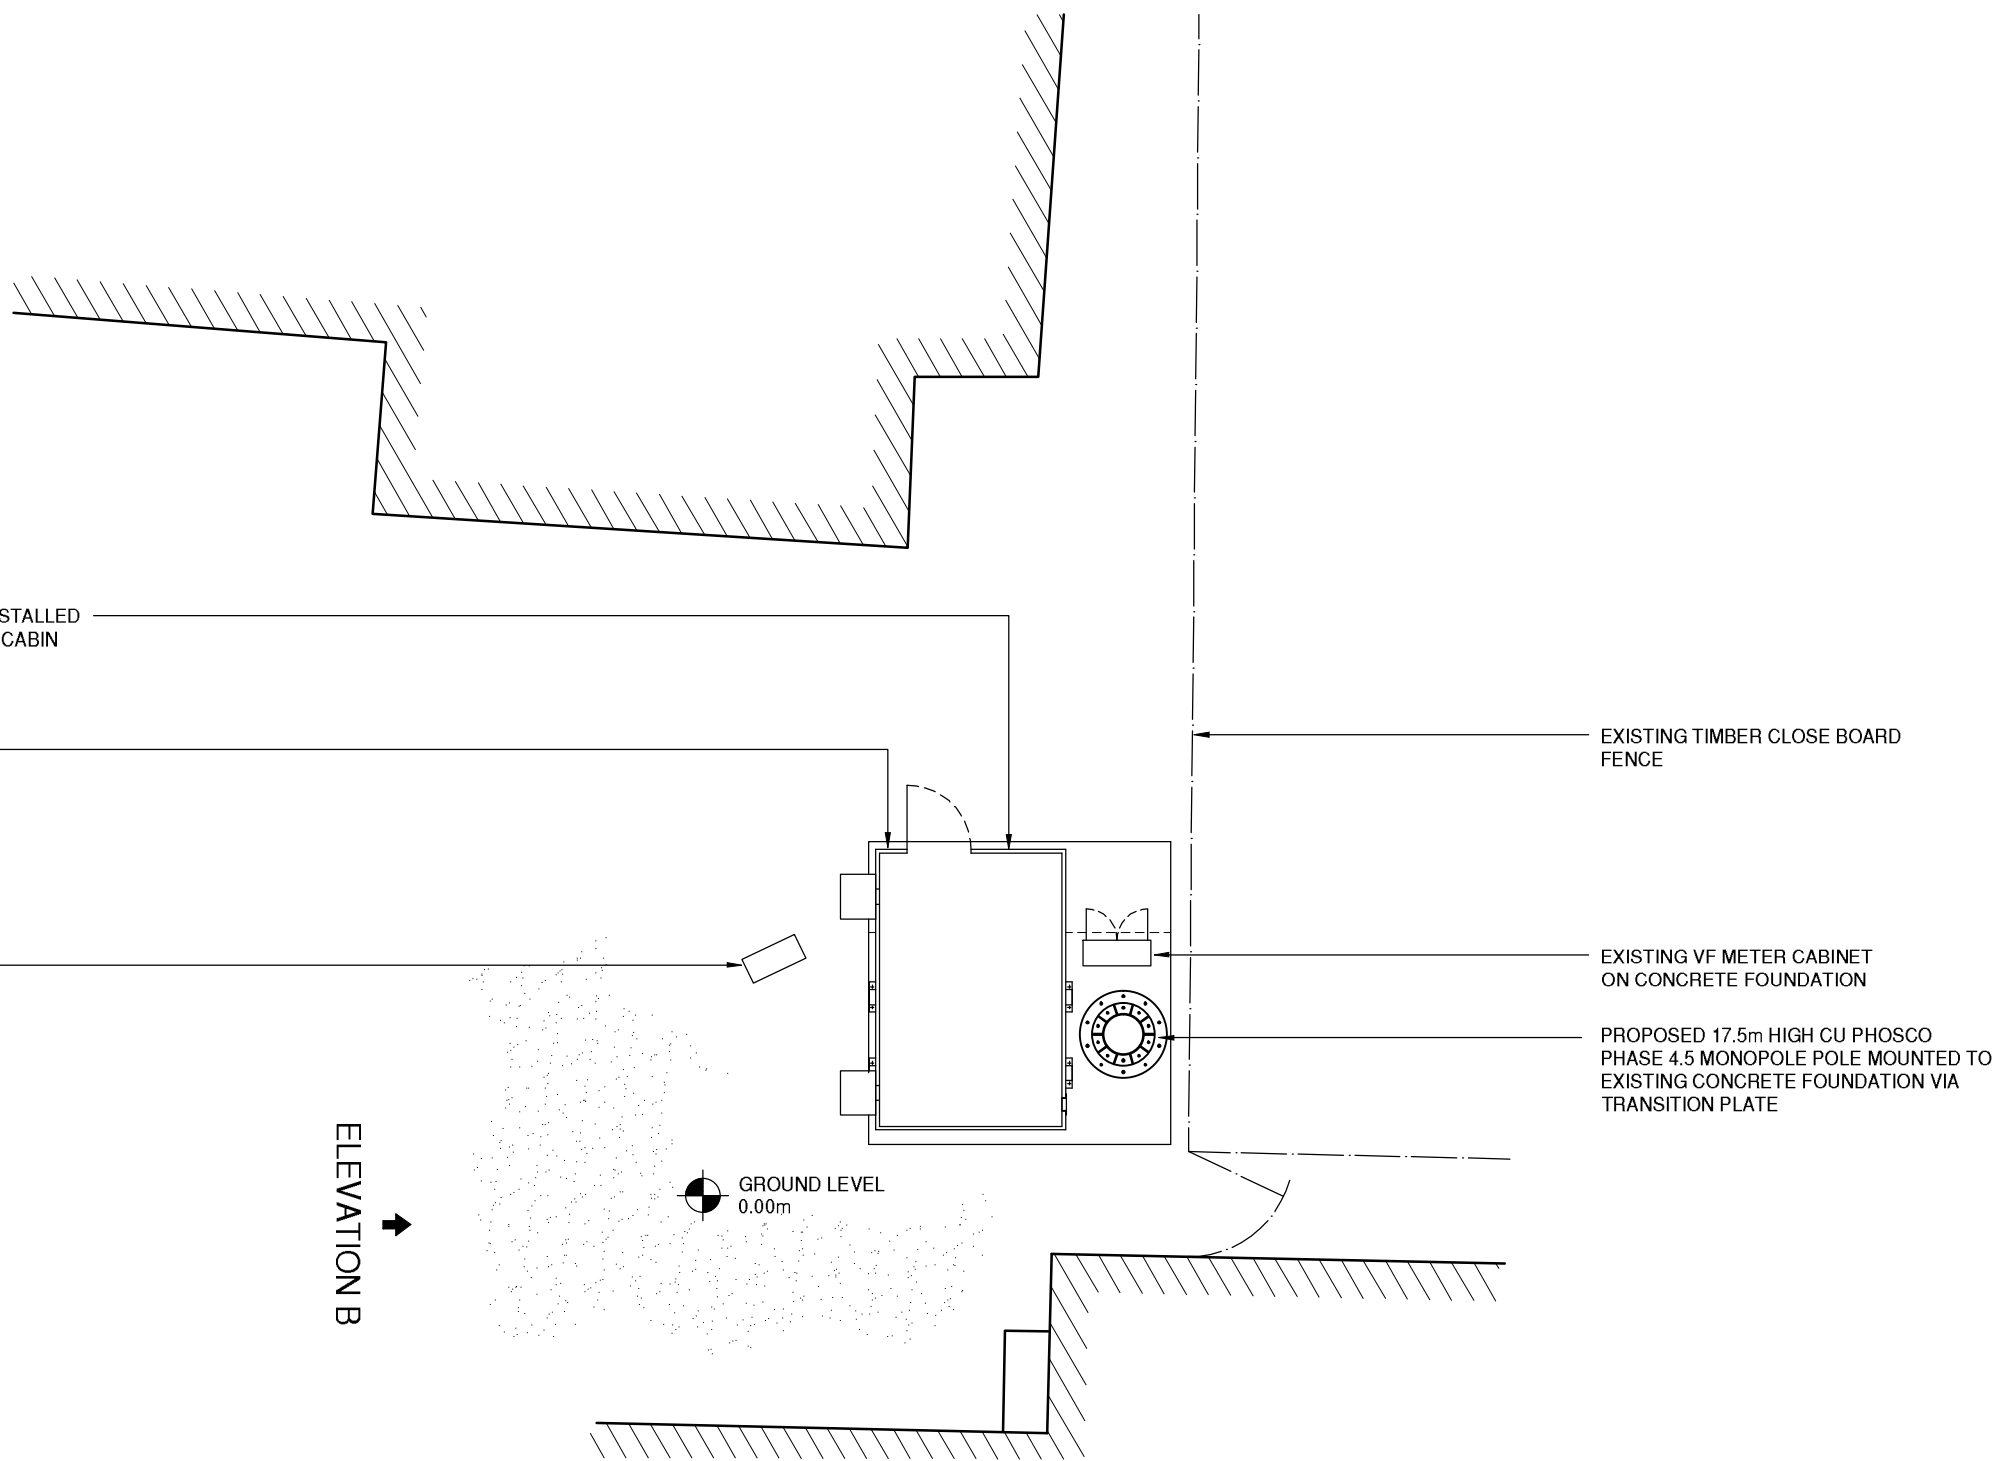

EXISTING BT COVERS

PROPOSED 17.5m HIGH CU PHOSCO
PHASE 4.5 MONOPOLE POLE MOUNTED TO
EXISTING CONCRETE FOUNDATION VIA
TRANSITION PLATE

↑
ELEVATION B

GROUND LEVEL
0.00m

PROPOSED SITE PLAN
SCALE 1:100

These drawings comply with Standard ICNIRP design guidelines.

Drawn: PL	Date: 16.03.15	Checked: AK	Date: 17.03.15	B
--------------	-------------------	----------------	-------------------	---