


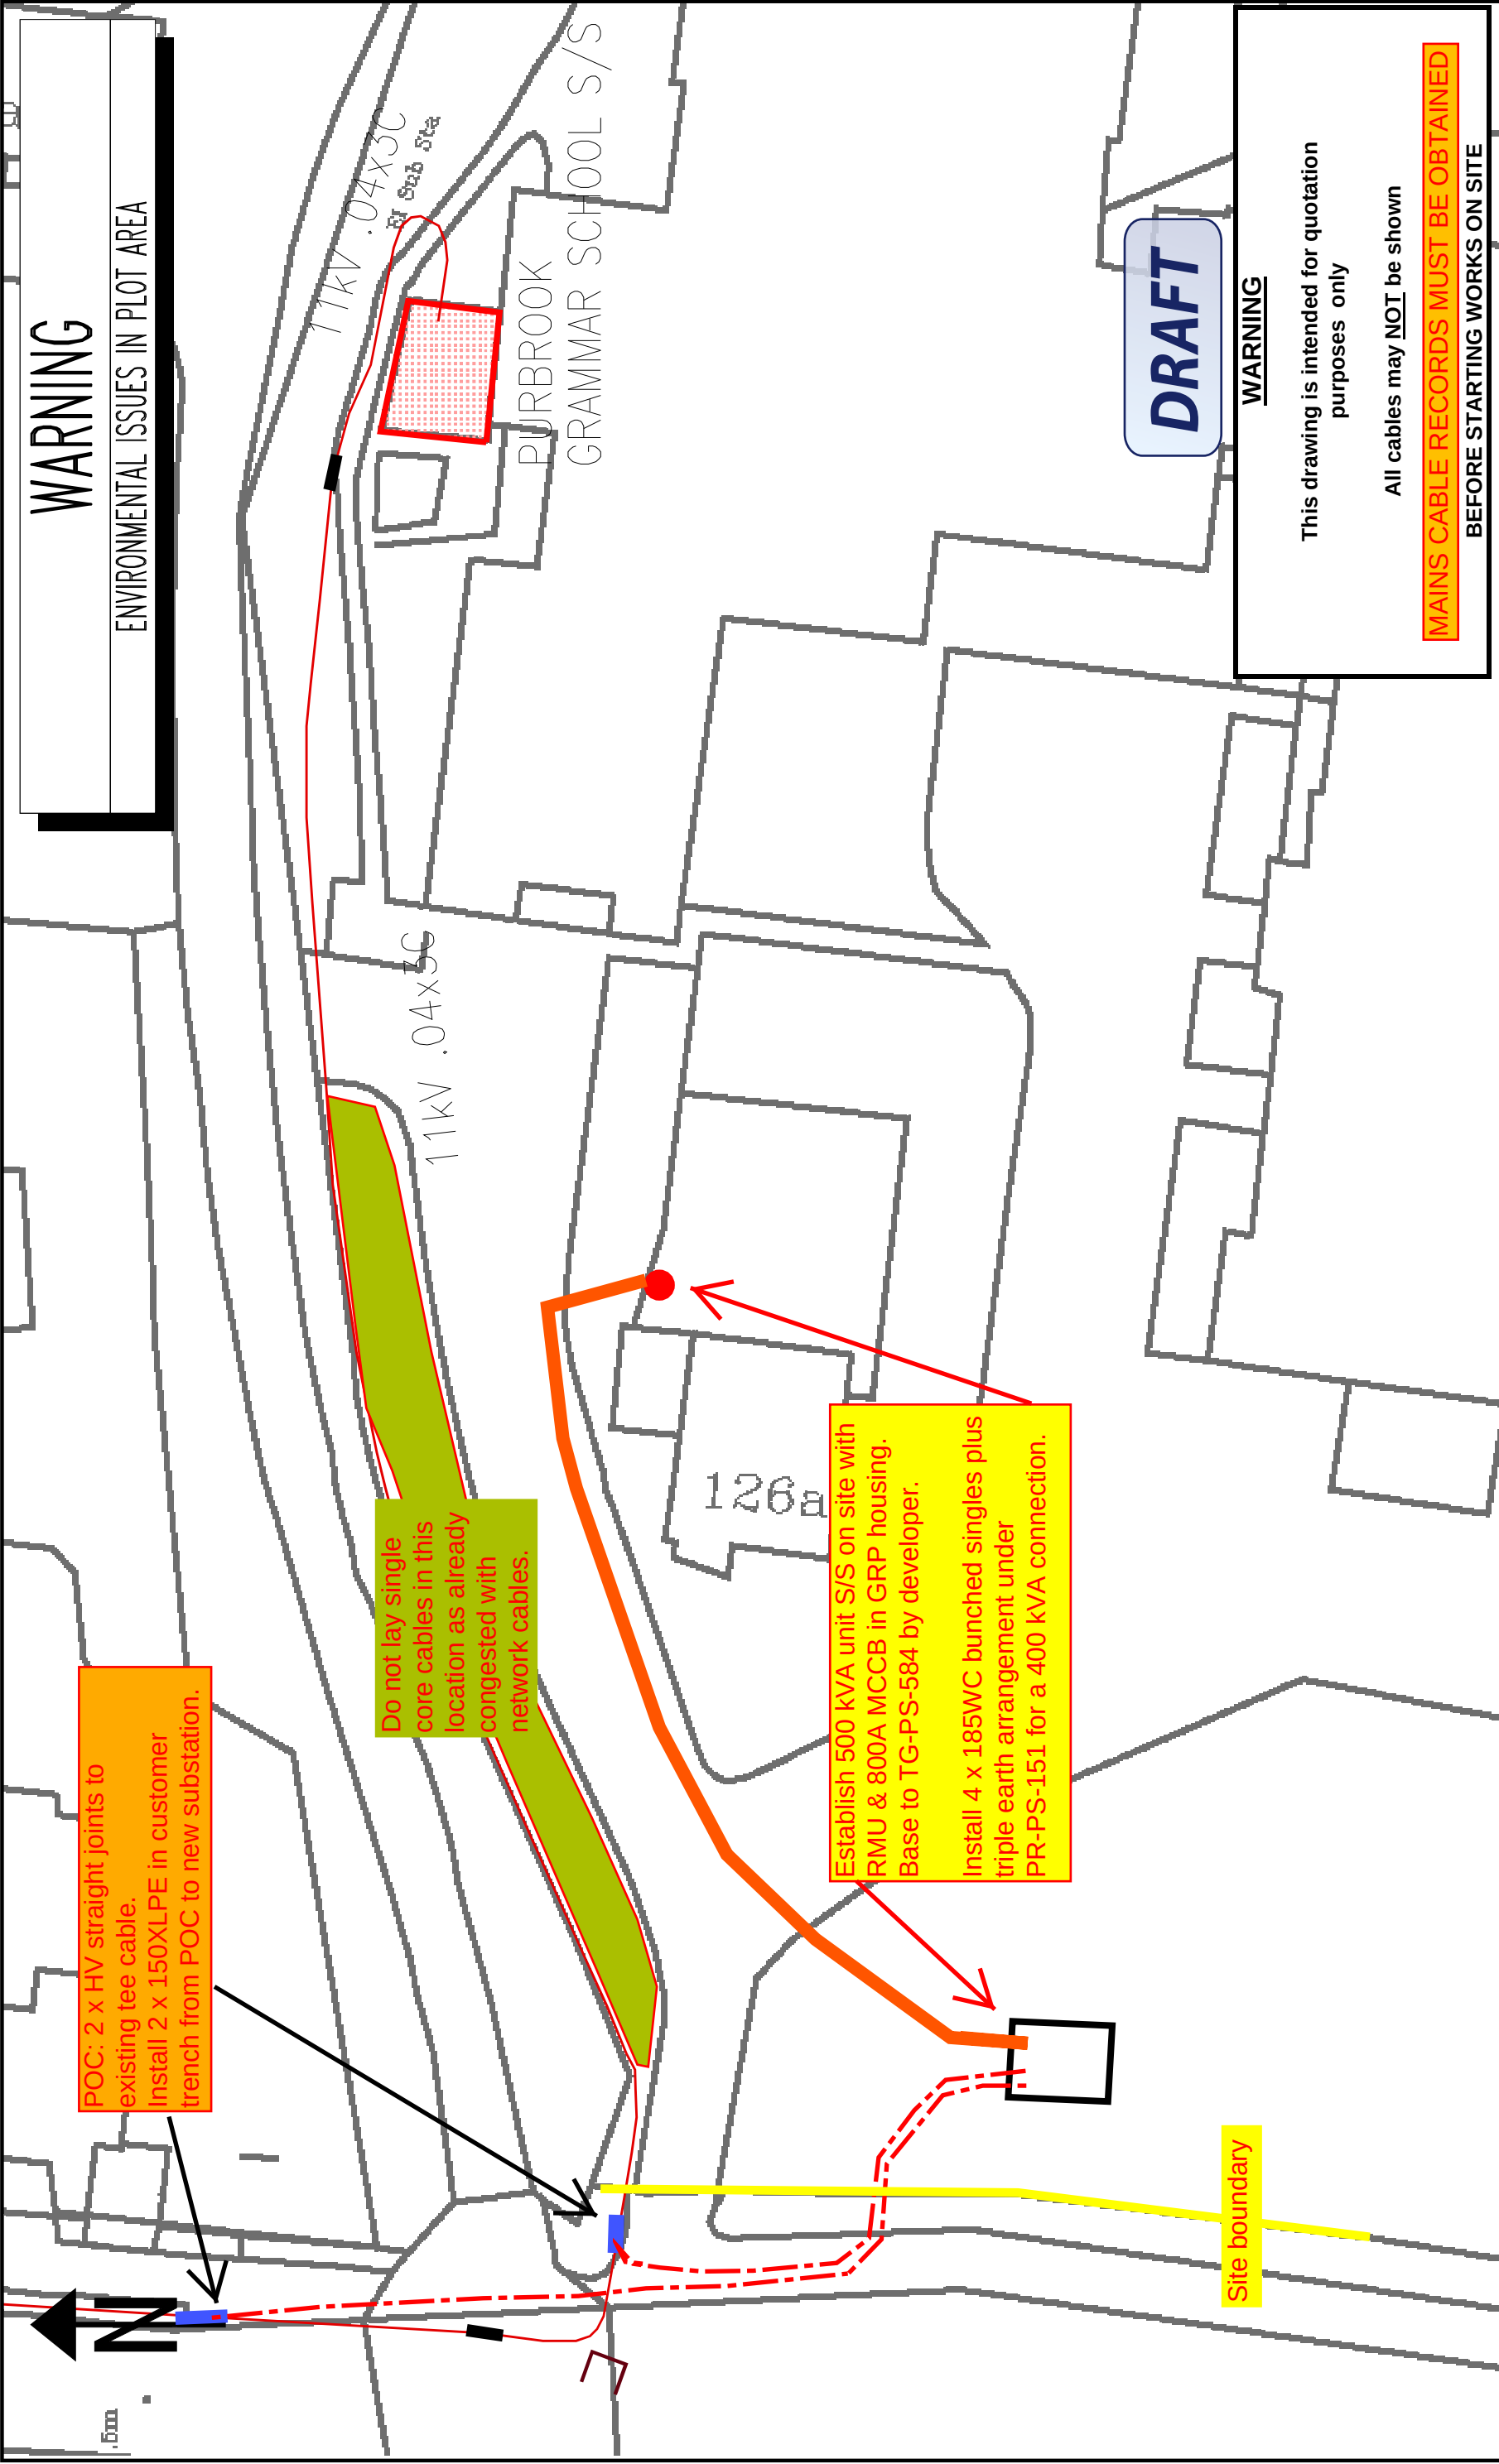

WARNING

ENVIRONMENTAL ISSUES IN PLOT AREA

DRAFT

WARNING

This drawing is intended for quotation purposes only

All cables may NOT be shown

MAINS CABLE RECORDS MUST BE OBTAINED

BEFORE STARTING WORKS ON SITE

Scottish and Southern Energy		H.V. MAINS RECORD	
Based upon the Ordnance Survey map with the sanction of the Controller of H.M. Stationary Office. Crown Copyright Reserved.		Grid Ref: SU67580720	
This copy has been made by or with the authority of Southern Electric plc. pursuant to section 47 of the Copyright, Designs and Patents Act 1988. No part of this copy may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without the prior permission of the copyright owner.		Scale: 1:250	
Scottish and Southern Energy plc Registered Office: Inverlorn Road 200 Dundee Road, Perth, PH1 3NQ.		Date: 24/11/2014	
UNCONTROLLED COPY Subject to Revision Master held at		PORTSMOUTH 023-9262-4200	
WARNING		Temptle SUS MS204 COL 43.pdf	
There may have been subsequent alterations to the surface levels. Field notes must be taken to determine position and depth of cables. BS (G) 47 Booklet from the Health and Safety Executive - Avoiding Danger from Buried Cables - should be consulted before commencing excavation work. (available from HNSO)		When working in the vicinity of overhead lines the Health and Safety Guidance Note GSN should be consulted. (available from HNSO)	
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID		FOOTPATH	
services	l.v.	h.v.	e.h.v.
	0.40m	0.45m	0.60m 0.75m
ROAD CROSSING	0.60m	0.60m	0.75m 0.90m
l.v./services	- up to 1000V.		
h.v.	- over 1000V. to 11.000V.		
e.h.v.	- 22.000V. to 132.000V.		