
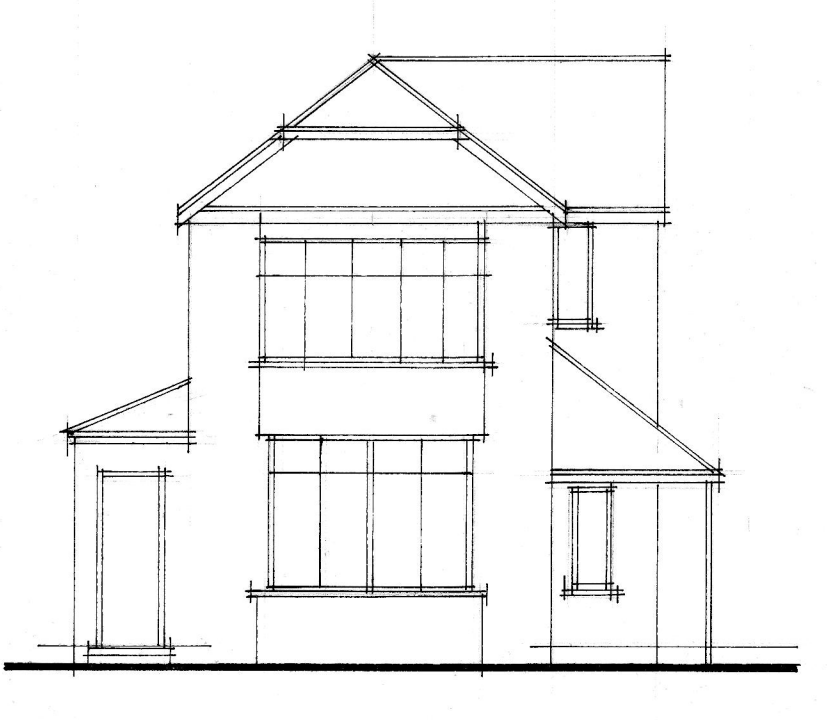
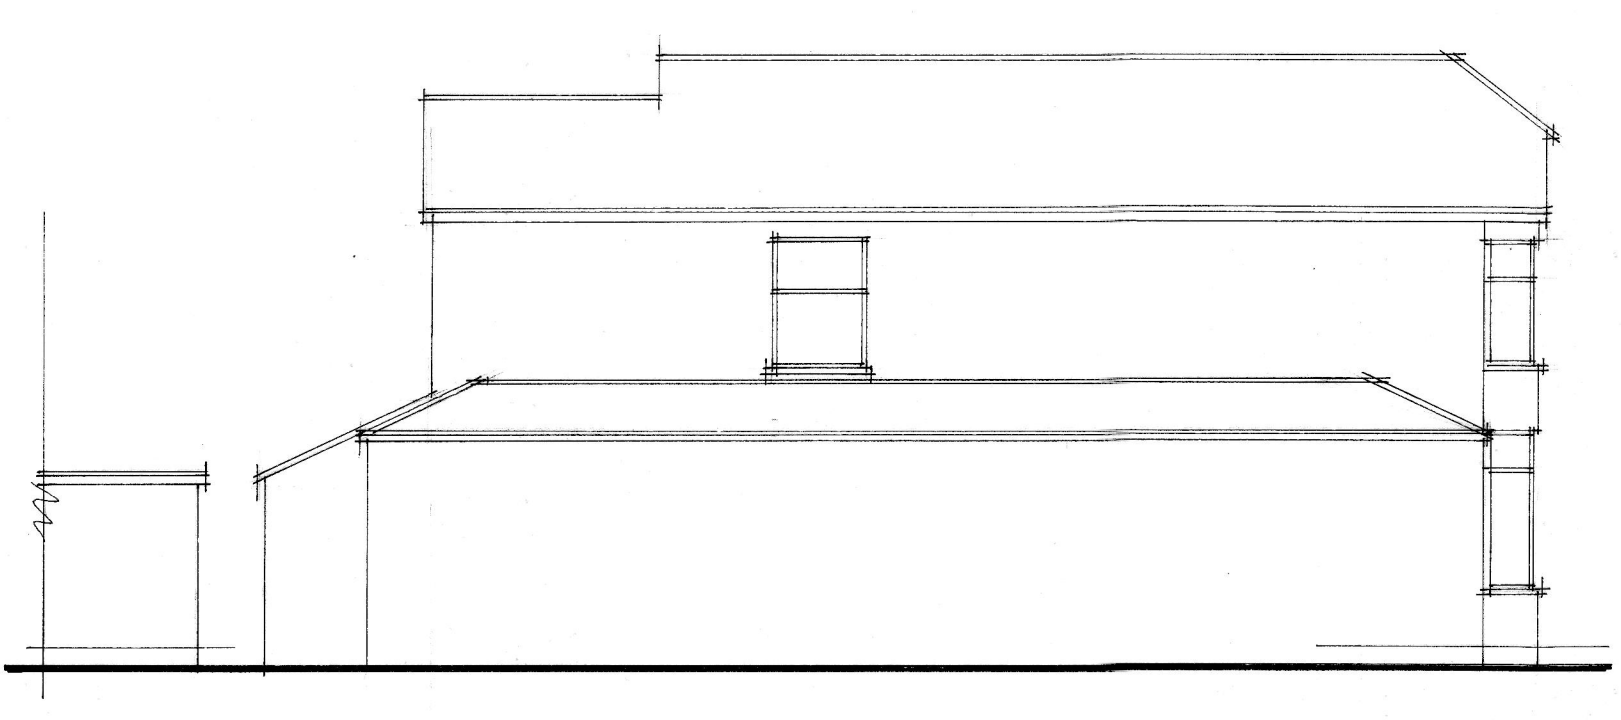
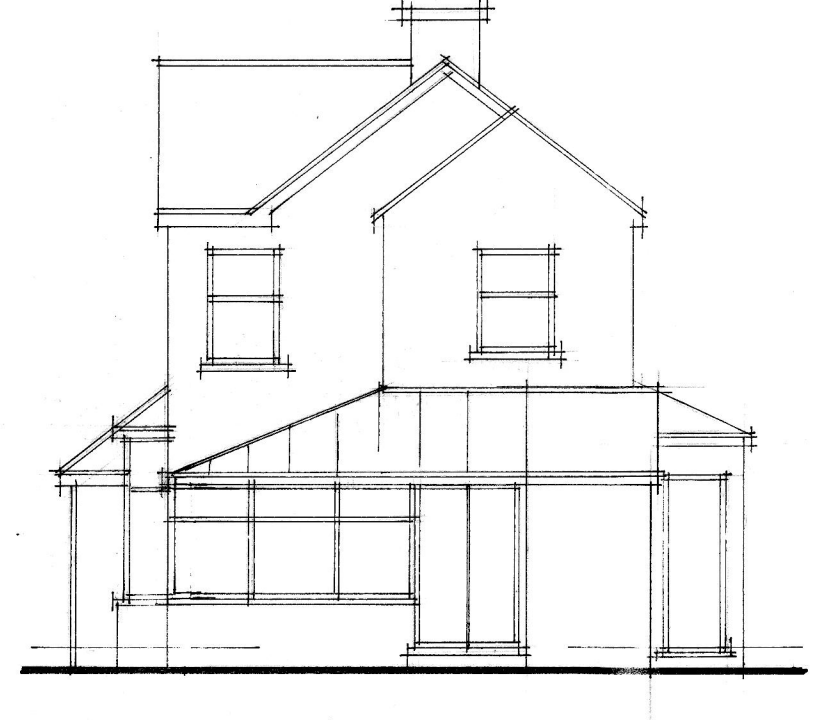
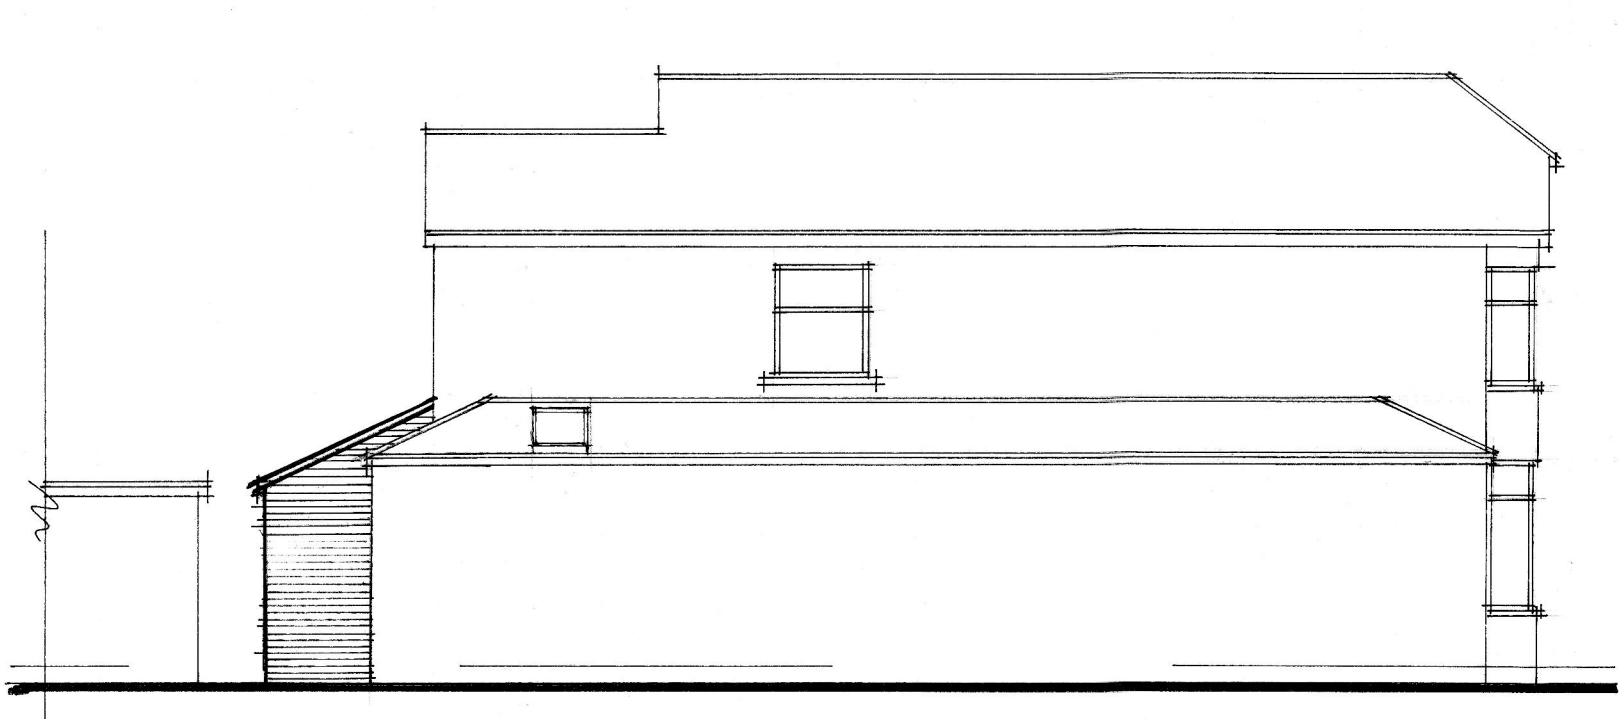
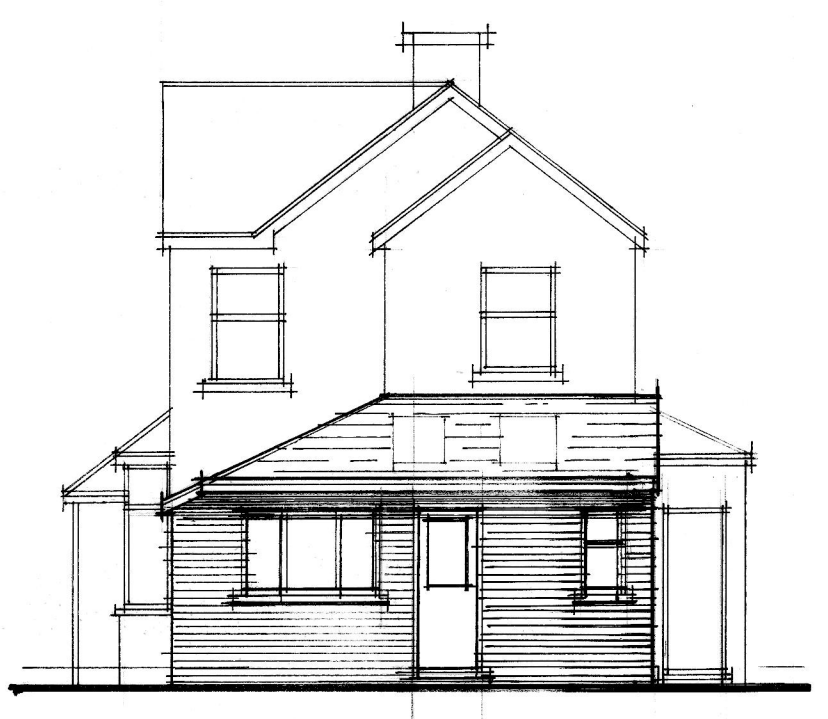
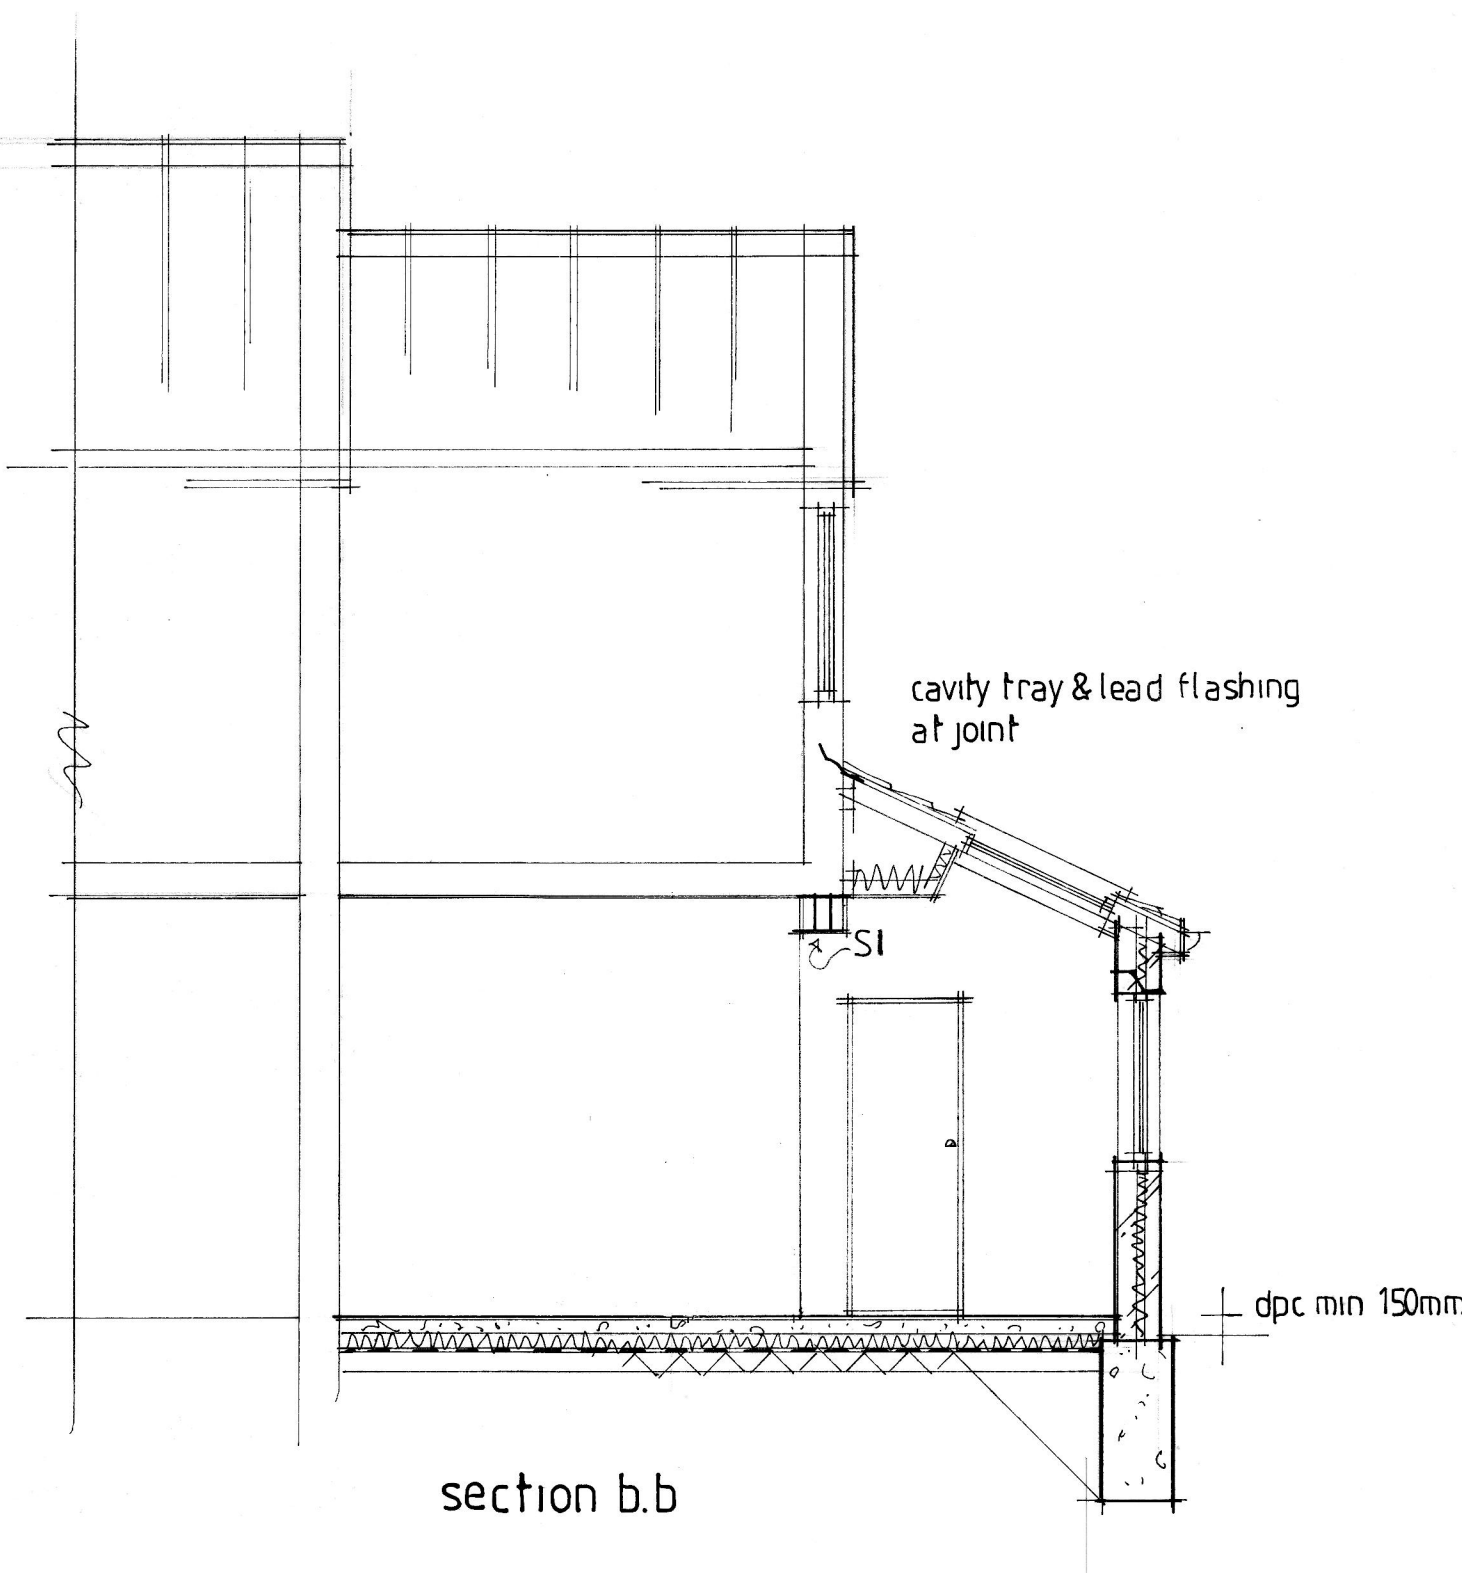


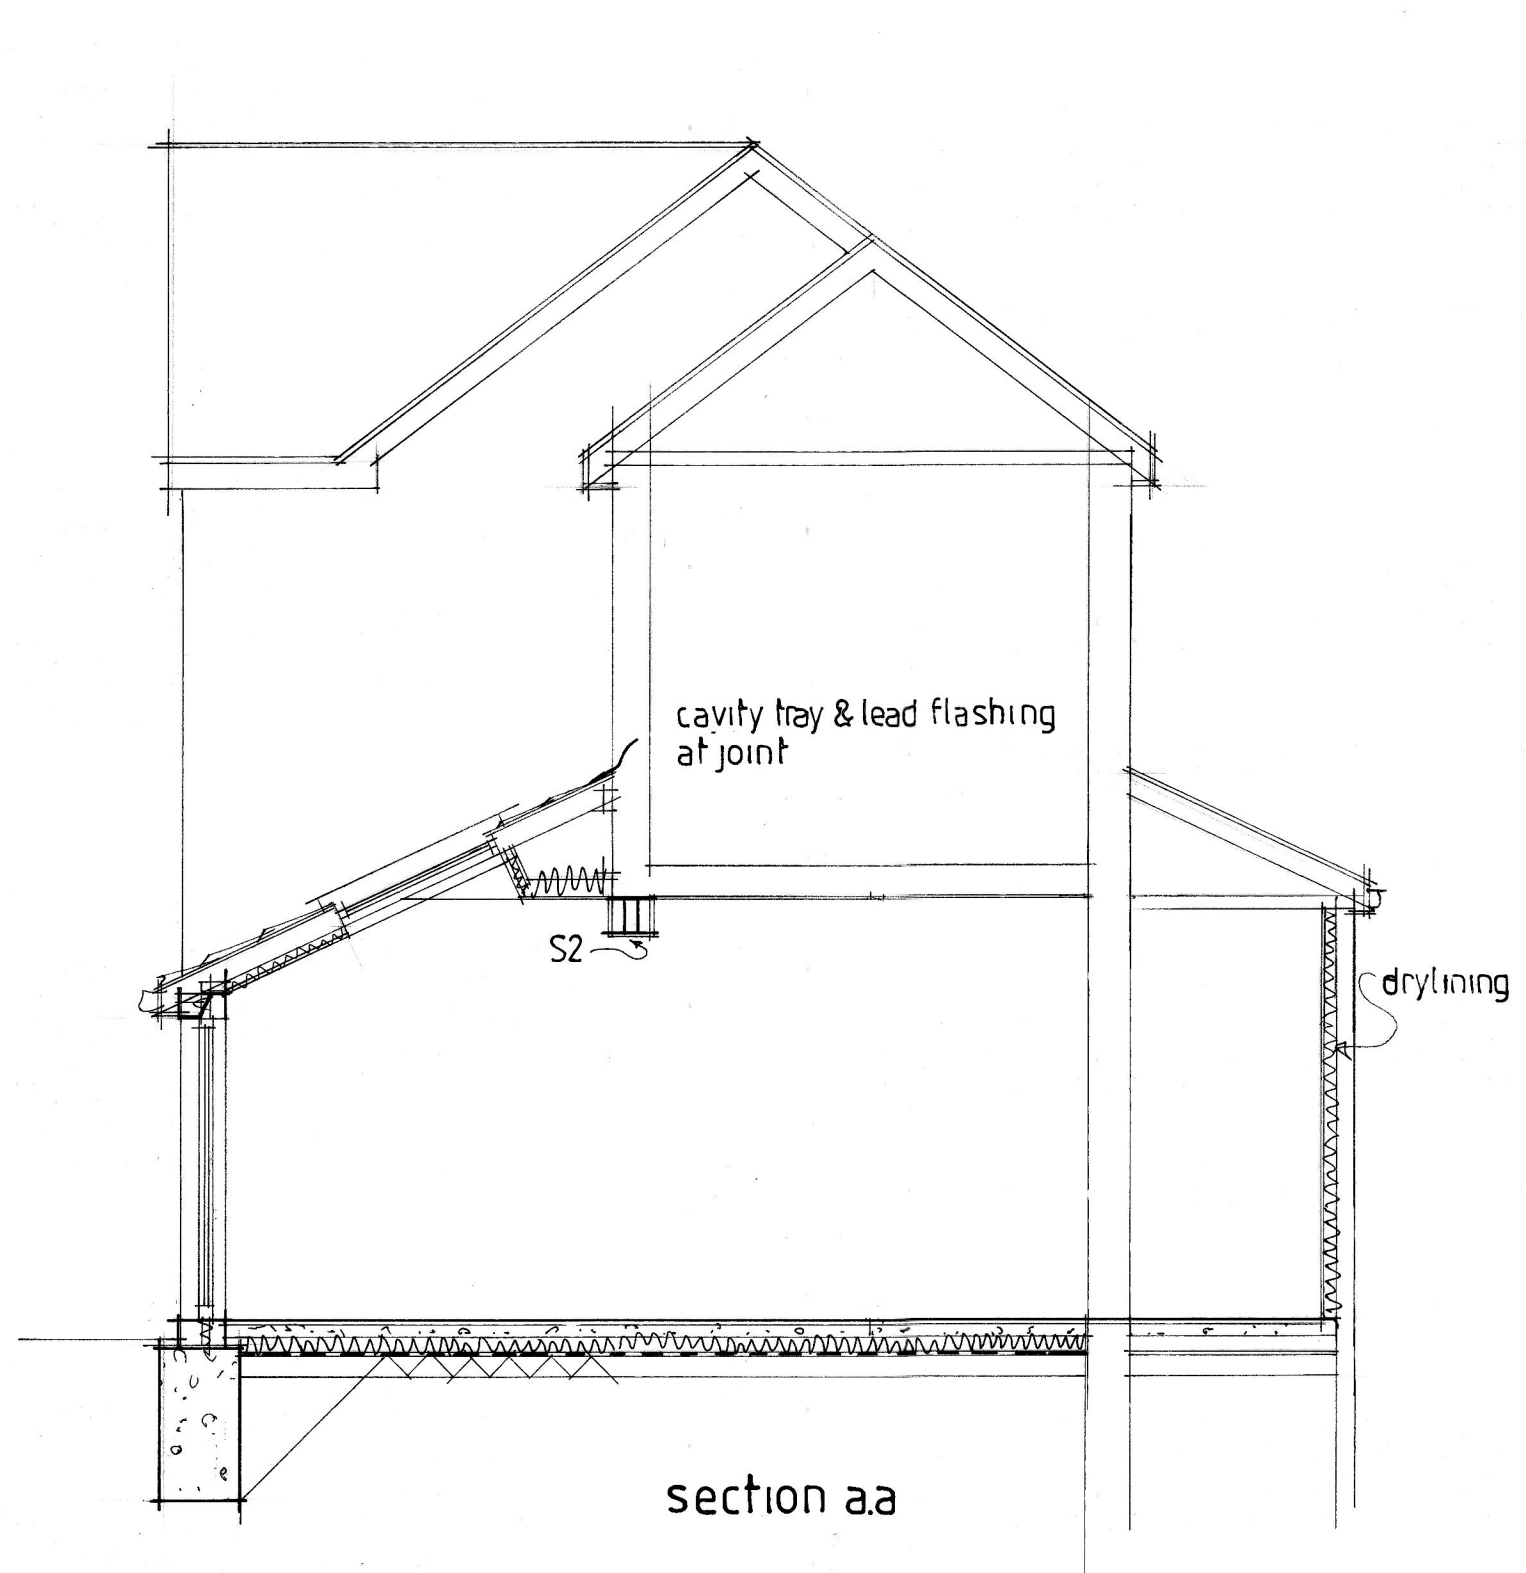

Opening window areas to be minimum 1/20th of enclosed floor areas. All new windows to be fitted with minimum 800sqmm trickle vents per room. Maximum area of double glazed window not to exceed 20% of floor areas

New windows: new double glazed windows to have minimum U value of 1.6w/m²k. Doors to have a min U value of 1.80w/msq.k. Toughened glass in glazed doors and windows in critical locations i.e. alongside doors. Seal around window-wall joint with mastic sealant. Double rafters as roof light trimmers if applicable.

Fit mechanical extract fans to any new wc and bathroom areas rated at min 15lit/sec

Duct mechanical extract from internal wc/bathroom rated to give min 3ach with up to 15minute overrun. Wired to light switch. Min 12mm air gap under door.

Fit mechanical extract fan from kitchen rated at min 60lit/sec. If cooker hood installed, to be rated at 45lit/sec. Utility room if applicable to be rated at 30lit/sec.

Steelwork: see structural calcs for sizes. Minimum bearing 100mm on concrete padstones, prestressed concrete lintels or metal bearing plates. Encase in minimum two layers 12.5mm plasterboard for half hour fire resistance when fitted at floor levels. Lengths of steels to be site measured to include bearings.

Inner partition: 12.5mm plasterboard each side of minimum 75 x 50mm studwork. Fit 25mm sound insulation quilt between held in place with battens.

Foundation: concrete trench fill, 450mm wide to min depth of 1 metre or to suit local ground conditions. (in clay soils min depth 1.2 metres) or to below invert level

Floor: 50mm screed on 100mm concrete slab on Celotex G44070 insulation batts on 1,2006 damp proof membrane continuous with new and existing damp proof course, on minimum 100mm well consolidated hardcore with 50mm sand blinding. fit 100mm diam pvc ducts under slab terminating in 225x75mm airbricks to vent existing timber subfloors when required.

External walls: 112mm facing bricks to match existing as closely as possible, 100mm 'rockwool' batt filled cavity on 100mm lightweight concrete block (Celcon Solar, Thermalite Turbo, or similar rated) inner skin with render and set finish. (overall cavity 90mm) Insulated catnic lintels over new openings. Close cavities at eaves with non-combustible material. Tooth into existing walls and maintain all cavities. Wall ties to be at 750mm ctrs horizontally and 450mm ctrs vertically and staggered. 'Catic' or similar vertical cavity thermal closers at openings. External perimeter of door and window openings to be sealed with a suitable airtight sealant.

Dry lining to consist of 12.5mm foilback plasterboard and set on 65mm celotex PL4000 (joints taped as VCL) board on timber battens on roofing felt and 3 layers of synthapurf to exposed brickwork

Flat roof: 13mm spar chippings on 3 layer high performance torch on felt to BS747 cp144 part 3 1977 on Celotex TD4126 insulated roof decking on firings on 50mm x 125mm roof joists at 400mm centres. 12.5mm foil back plaster board ceiling. Strap down new roof with 1000 x 32mm galvanised mild steel straps at 1200mm centres. Ensure that wall insulation is taken up to meet underside of Celotex to ensure warm roof construction.

Main roof: concrete tiles on battens on breathable felt on 50mm x 125mm rafters at 400mm centres. Strap down with 1.00m x 32mm galv. ms straps at max 1.20m ctrs. Around perimeter.

Fit proprietary dry ridge vent system, or high level tile vents equivalent to 5mm continuous gap, fit eaves vents front, rear and dormers (if applicable) equivalent to 25mm continuous gap.

Roof insulation: roof to be insulated with two layers of 150mm Fibreglass insulation quilt. One layer laid between ceiling joist and one layer laid over in opposite direction. Maintain roof ventilation with 25mm continuous air to eaves and vent tiles to apex as shown.

Drainage: all drainage to BS EN752 plus approved doc H 100mm diam. PVC drain ware minimum fall 1-40 in 150mm concrete surround to new or existing inspection chamber on existing run. Bridge with concrete lintels over where passing beneath new walls and flexible packing surround. Exact position, invert and direction of all existing drains to be determined and agreed on site PRIOR to commencement of works.

New inspection chamber sizes to suit invert of drains minimum sizes 600 x 450mm internal with 103mm semi engineering brickwork sides 215mm where invert exceeds 1000mm, built up from 150mm concrete slab base and fitted medium duty cover and frame.

New and existing drains where passing beneath building encased in 150mm minimum of concrete.

Plumbing: all to BS EN 2056 plus approved doc H 38mm diam. wastes from sink, bath and shower. 32mm diam. Waste from wash hand basins, all with rodding access on changes of direction and with deep seal traps. Run to existing/new 100mm diam pvc svp terminating min 900mm above nearest window head and with rodding access at the base.

Run to 100mm diam stub stack terminating above appliance flood level with durgio autovent.

Rain water goods: run new 100mm diam pvc rain water guttering and 70mm diam downpipes to existing drainage system.

All new electrical works to be designed, installed, inspected and tested in accordance with BS7671 (IEE17th Ed) the works are to be undertaken by an installer registered under a suitable self certification scheme or by a suitably qualified person with a certificate of compliance produced to building control upon completion of the works.

Lighting: Fit high efficacy light fittings minimum one per four new fittings. Any recessed ceiling lights to be 30minute fire resisting.

All new radiators to be fitted with TRVs

Fabrication details to be provided if required by building control.

ALL DIMENSIONS TO BE CHECKED ON SITE. ANY DISCREPANCIES ARE TO BE MADE KNOWN TO THE SURVEYOR AS SOON AS POSSIBLE.

SEE STRUCTURAL CALCULATIONS FOR STEEL OR TIMBER DETAILS. THE CONTRACTOR IS TO SITE MEASURE ALL STRUCTURAL MEMBERS AND/OR STAIRCASE, BEFORE ORDERING.

THE PROPERTY OWNERS ARE TO ENSURE THAT ANY/ALL REQUIREMENTS OF THE PARTY WALL ACT ARE COMPLIED WITH. ADVICE CAN BE OBTAINED FROM THE SURVEYOR.

EXISTING LINTOLS AND FOUNDATIONS TO LOABEARING WALLS TO BE EXPOSED FOR LOCAL AUTHORITY INSPECTION AND APPROVAL AS REQUIRED. NORMALLY AT THE START OF WORKS WHEN DRAINAGE RUNS ARE CHECKED.

CONTRACTOR IS TO CONFIRM THAT ALL NECESSARY LOCAL AUTHORITY APPROVALS HAVE BEEN OBTAINED BEFORE COMMENCING WORKS. COMMENCEMENT OF ANY WORKS PRIOR TO THIS IS ENTIRELY AT THE CLIENTS OR CONTRACTORS RISK. CHANGES TO THE SCHEME CARRIED OUT WITHOUT THE SURVEYORS APPROVAL MAY INVALIDATE THEIR LIABILITY.

C. MAY 2015 CLIENT AMENDMENTS.		
B. MAY 2015 CLIENT AMENDMENTS.		
A. APR 2015 BREGS DRAWINGS.		
Date	Revision	

© copyright

THORNS-YOUNG
ARCHITECTURAL

THORNS-YOUNG LTD
CHARTERED BUILDING CONSULTANTS
232 London Road, North End, Portsmouth PO2 9JQ
Tel: (023) 9267 2883 Fax: (023) 9266 3457
Website: www.thornsyong.co.uk

Client

Ms K Pratt

Job Title

22 Winifred Road
Waterlooville

Drawing Title

rear extension

Scale 1:100

Date APRIL 2015 Drawn by RN

Org. No. 8068-15-2 Rev.