


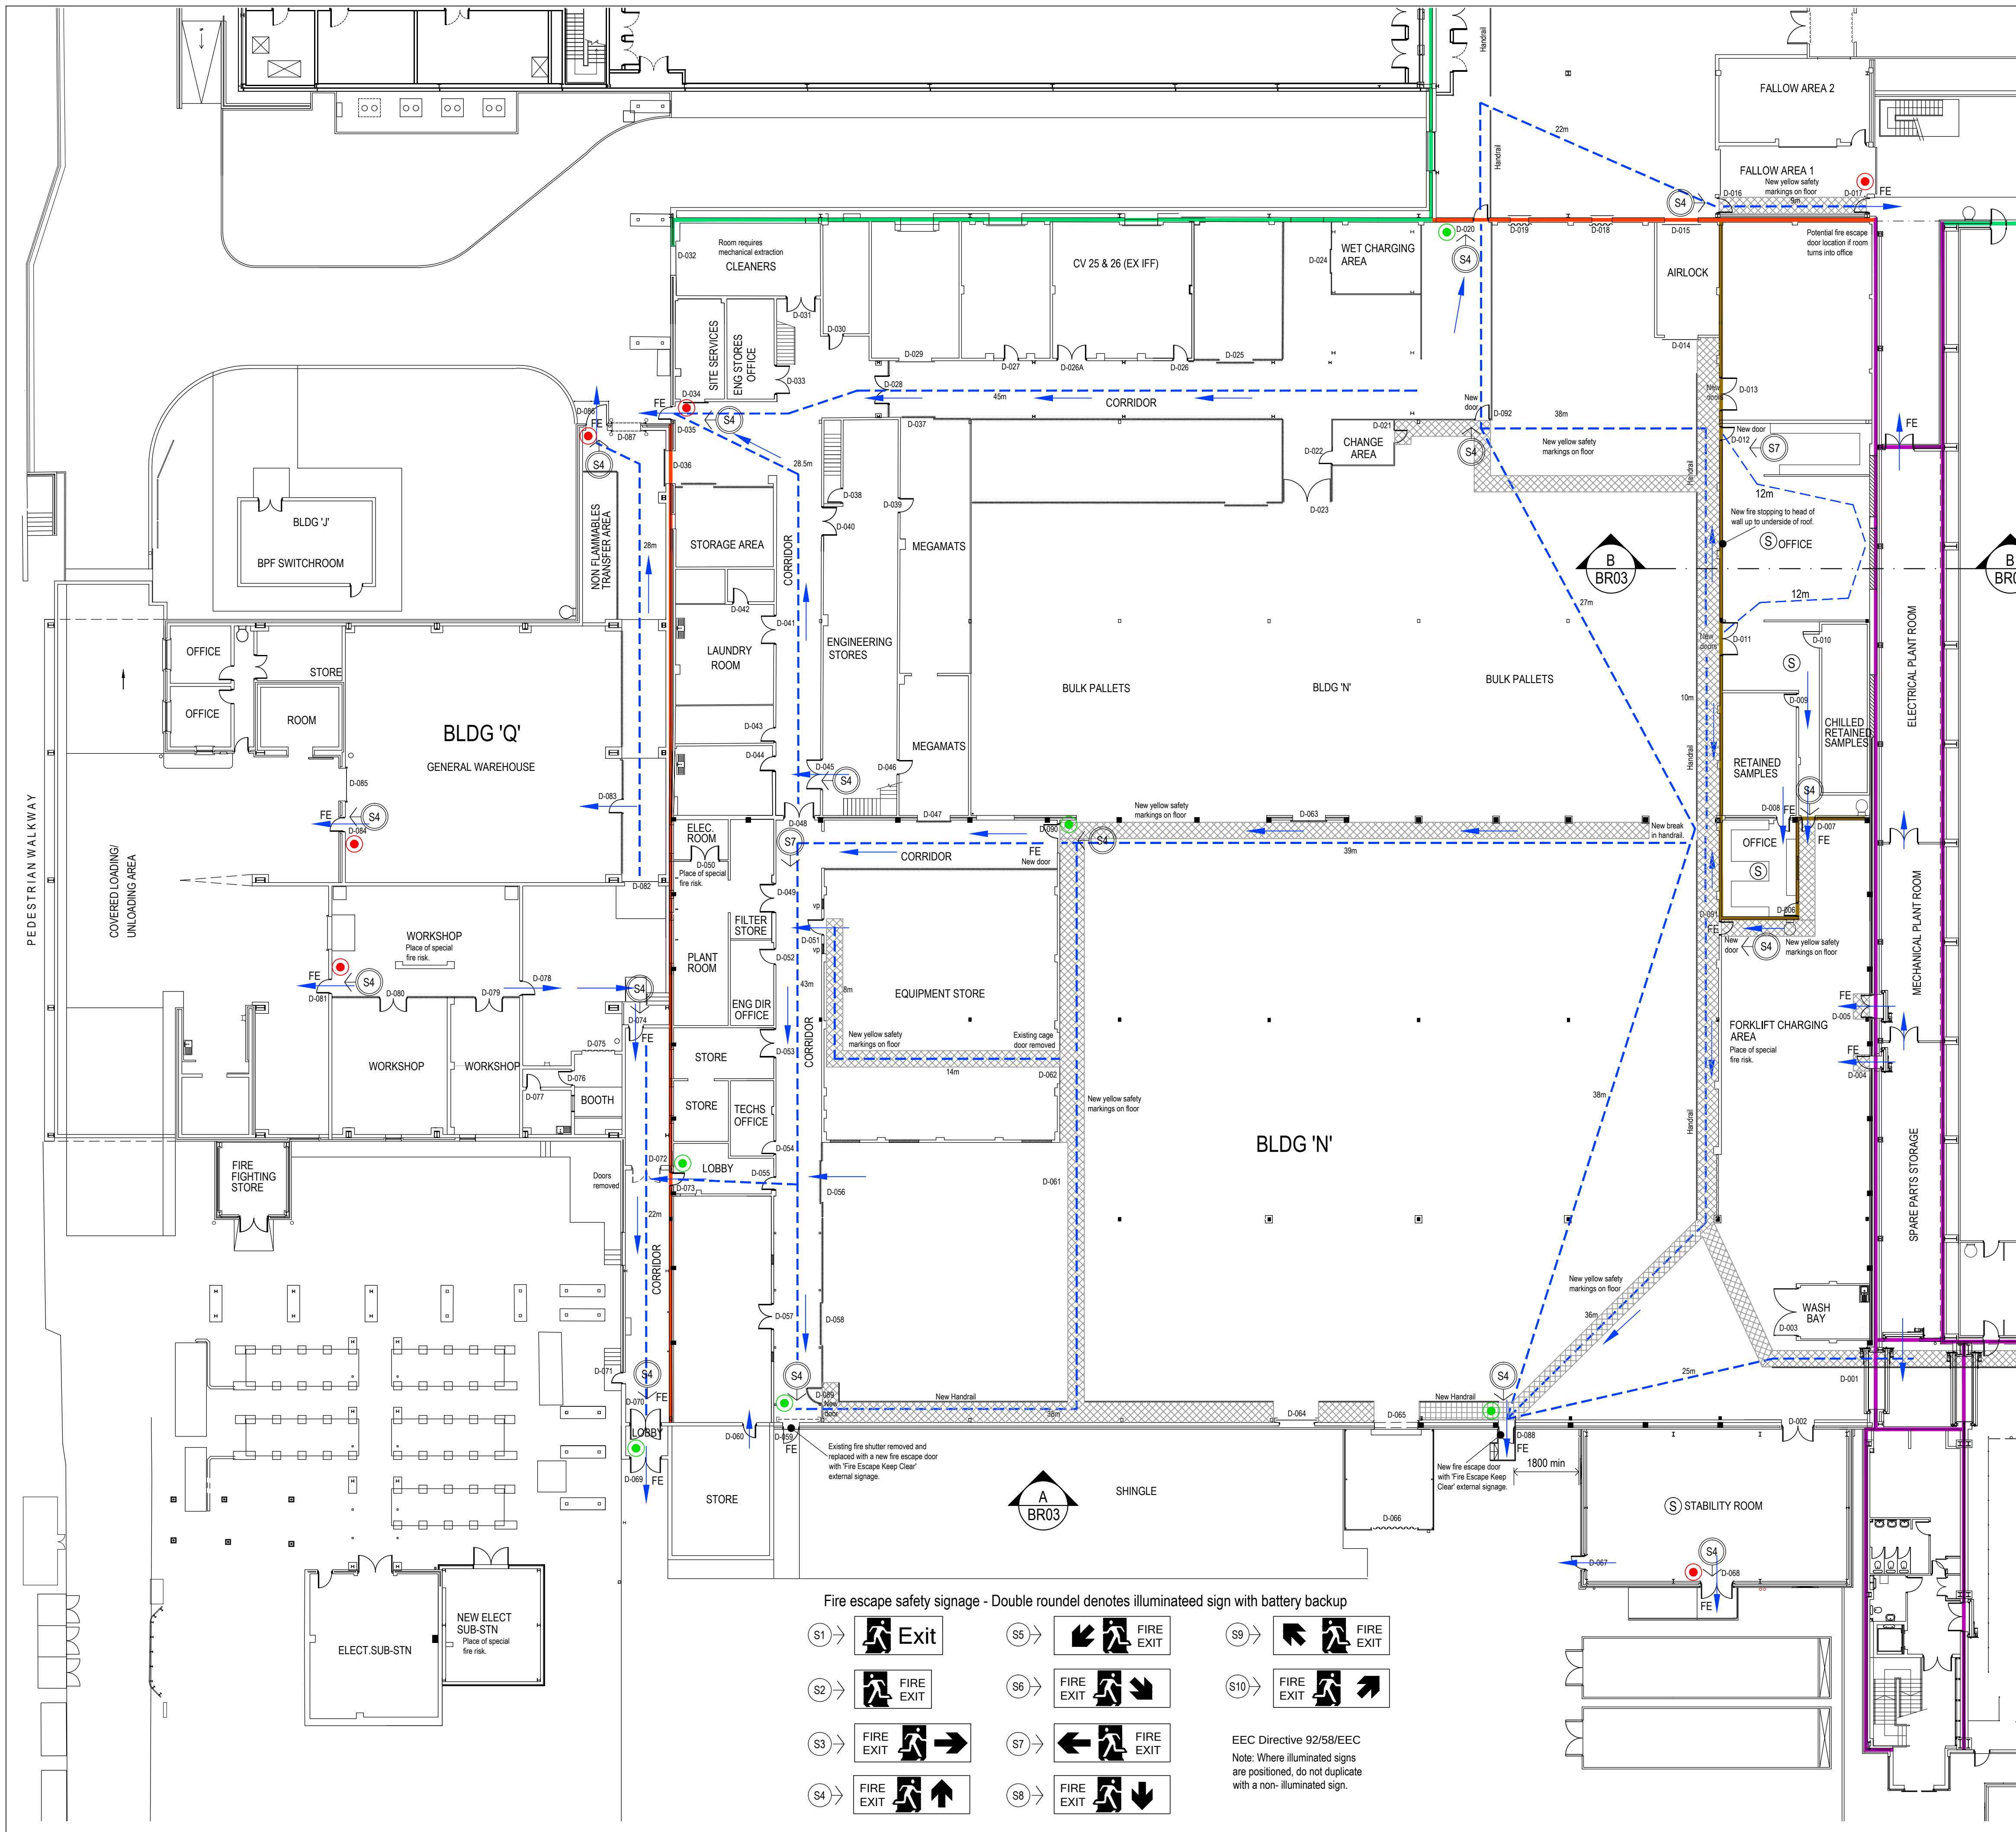

Door Ref	Clear Opening Existing	Clear Opening Proposed	Fire Resistance Rating	Vision Panel	Existing Escape Furniture / Notes	Proposed Escape Furniture / Notes
D-001	3500		4hr	-	Roller Shutter	
D-002	1875		-	-	Thumblum	
D-003	2700		4hr	-	Thumblum	
D-004	870		4hr	-	Thumblum	
D-005	1290		4hr	-	Thumblum	
D-006	765		30mins	Yes	Thumblum	
D-007	770		30mins	Yes	Thumblum	
D-008	800		30mins	Yes	Thumblum	
D-009	755		30mins	-	Thumblum	
D-010			-	-	Coldstore door	
D-011*		1750	30mins	Yes		Access control + break glass
D-012*		850	30mins	Yes		Access control + break glass
D-013*		1750	30mins	Yes		Access control + break glass
D-014	-	-	-	-	Rapid Roller	
D-015	-	-	-	-	Thumblum	
D-016	890		30mins	Yes	Emergency Door Release	
D-017	750		-	Yes	Thumblum	
D-018	-		2hr	-	Roller Shutter	
D-019	-		2hr	-	Roller Shutter	
D-020	850		2hr	Yes	Pass card	Break Glass
D-021	880		-	Yes	Lever furniture - no locks	
D-022	870		-	Yes	Lever furniture - no locks	
D-023	2700		-	Yes	Padlocked	
D-024	1395		-	Yes	Thumblum	
D-025	1395		-	Yes	Thumblum	
D-026	790		-	-	Break glass bolt	
D-026A	1650		-	-	Break glass bolt	
D-027	790		-	-	Break glass bolt	
D-028	1900		-	-	Break glass bolt	
D-029	1995		-	-	Thumblum	
D-030	790		-	Yes	Thumblum	
D-031	1650		-	-	Thumblum	
D-032	-		3hrs	-	Filled in	
D-033	1615		-	Yes	-	
D-034	1500		-	Yes	-	
D-035	770		-	Yes	Thumblum	
D-036	2000		2hr	-	Roller Shutter	
D-037	2000		-	-	Thumblum	
D-038	785		-	-	Thumblum	
D-039	785		-	-	Thumblum	
D-040	1600		-	Yes	Push button release	Alarm activated door closer
D-041	1550		-	Yes	Thumblum	
D-042	-		-	-	-	
D-043	777		-	Yes	Thumblum	
D-044	817		-	Yes	Thumblum	
D-045	1610		-	Yes	Push bar	
D-046	785		-	-	-	Alarm activated door closer
D-047	2000		-	Yes	-	
D-048*	1705	1705	30mins	-	-	New doors with vision panels
D-049	1550		-	Yes	Thumblum	
D-050	1610		-	Yes	Unable to open	Thumblum
D-051	770		-	-	-	
D-052	750		-	Yes	Thumblum	
D-053	1600		-	Yes	Thumblum	
D-054	750		-	Yes	Thumblum	
D-055	760		-	Yes	Thumblum	
D-056	2400		-	Yes	Padlocked	Break glass bolt / unlocked
D-057	-	1400	-	Yes	Existing doors relocated	Thumblum
D-058	2500		-	Yes	Padlocked	
D-059	-		-	Yes	Roller Shutter - clad over	
D-060	720		-	Yes	Thumblum	
D-061	1750		-	Yes	-	door removed
D-062	3140		-	Yes	-	door removed
D-063	-		-	-	Kept shut	
D-064	-		-	-	Roller Shutter - clad over	
D-065	2650		-	-	Roller Shutter	
D-066	-		-	-	Strip curtain	
D-067	760		-	-	Thumblum	
D-068	1880		-	-	Push button release	Push bar / Thumblum
D-069	1750		-	Yes	Thumblum	
D-070	1760		-	Yes	-	
D-071	880		-	Yes	Locked	Remove exit signage
D-072	1690		-	-	-	door removed
D-073*	690	690	2hr	Yes	Thumblum	New Fire door + vision panel
D-074*	760	760	30mins	-	Thumblum	New Fire door + vision panel
D-075	-		-	-	Strip curtain	
D-076	-		-	-	-	
D-077	-		-	-	-	
D-078*	760	760	30mins	-	Thumblum	New Door with vision panel
D-079	-		-	-	-	
D-080	-		-	-	-	
D-081	760		30mins	-	Thumblum	
D-082	2050		2hr	-	Roller Shutter	
D-083	775		-	Yes	Break glass bolt	
D-084	-		-	-	Thumblum	
D-085	-		-	-	Roller Shutter	
D-086	1140		-	-	Push bar	
D-087	-		-	-	Roller Shutter	
D-088*	-	850 min.	-	-	-	Push bar
D-089*	-	850 min.	-	-	-	Break glass bolt
D-090*	-	850 min.	-	-	-	Emergency Door Release
D-091*	-	850 min.	-	-	-	Thumblum / keep unlocked
D-092*	-	850 min.	-	-	-	Break glass bolt

Site MFL Philosophy

- 4hr Compartment Wall
- 3hr Compartment Wall
- 2hr Compartment Wall
- 30mins fire resistance
- Travel distance (under Part B1 Build Regs)
max 45m where travel is possible in more than one direction
max 25m where travel is possible in one direction only
- 1m wide unobstructed pedestrian escape

Existing Fire Alarm Call Point
Proposed Fire Alarm Call Point
Direction of Escape
Smoke detector location to new room

Note: All fire doors to be self closing in accordance with Part M of the Building Regulations. Fire safety signage such as 'Fire Door Keep Shut' to be applied to all self closing fire doors.

Rev Description Drawn Date Chk'd App'd

The Old Post Office
Station Road
Wickham PO17 5JA
T: 01329 832405
F: 01329 835175
e: admin@axisfire.co.uk
w: www.axisfire.co.uk

Axis
FIRE STRATEGY PRACTISE

Dimensions, areas and levels where given are only approximate and subject to site survey. All dimensions are to be checked on site. Any discrepancies are to be reported to the architect before work commences. Figured dimensions only are to be taken from this drawing. This drawing is to be read in conjunction with all relevant consultants and/or specialists drawings/documents and any discrepancies or variations are to be notified to the architect before the affected work commences. This drawing is copyright and remains the property of the Architect.

Fire Strategy
Block N
for Pfizer, New Lane, Havant
Proposed
Fire Strategy Floor Plan

Scale
metres

Scale @ A1 Drawn Checked Date
1:200 PSA Mar' 14

Job Number & Drawing Number Revision
14-006-PL02