


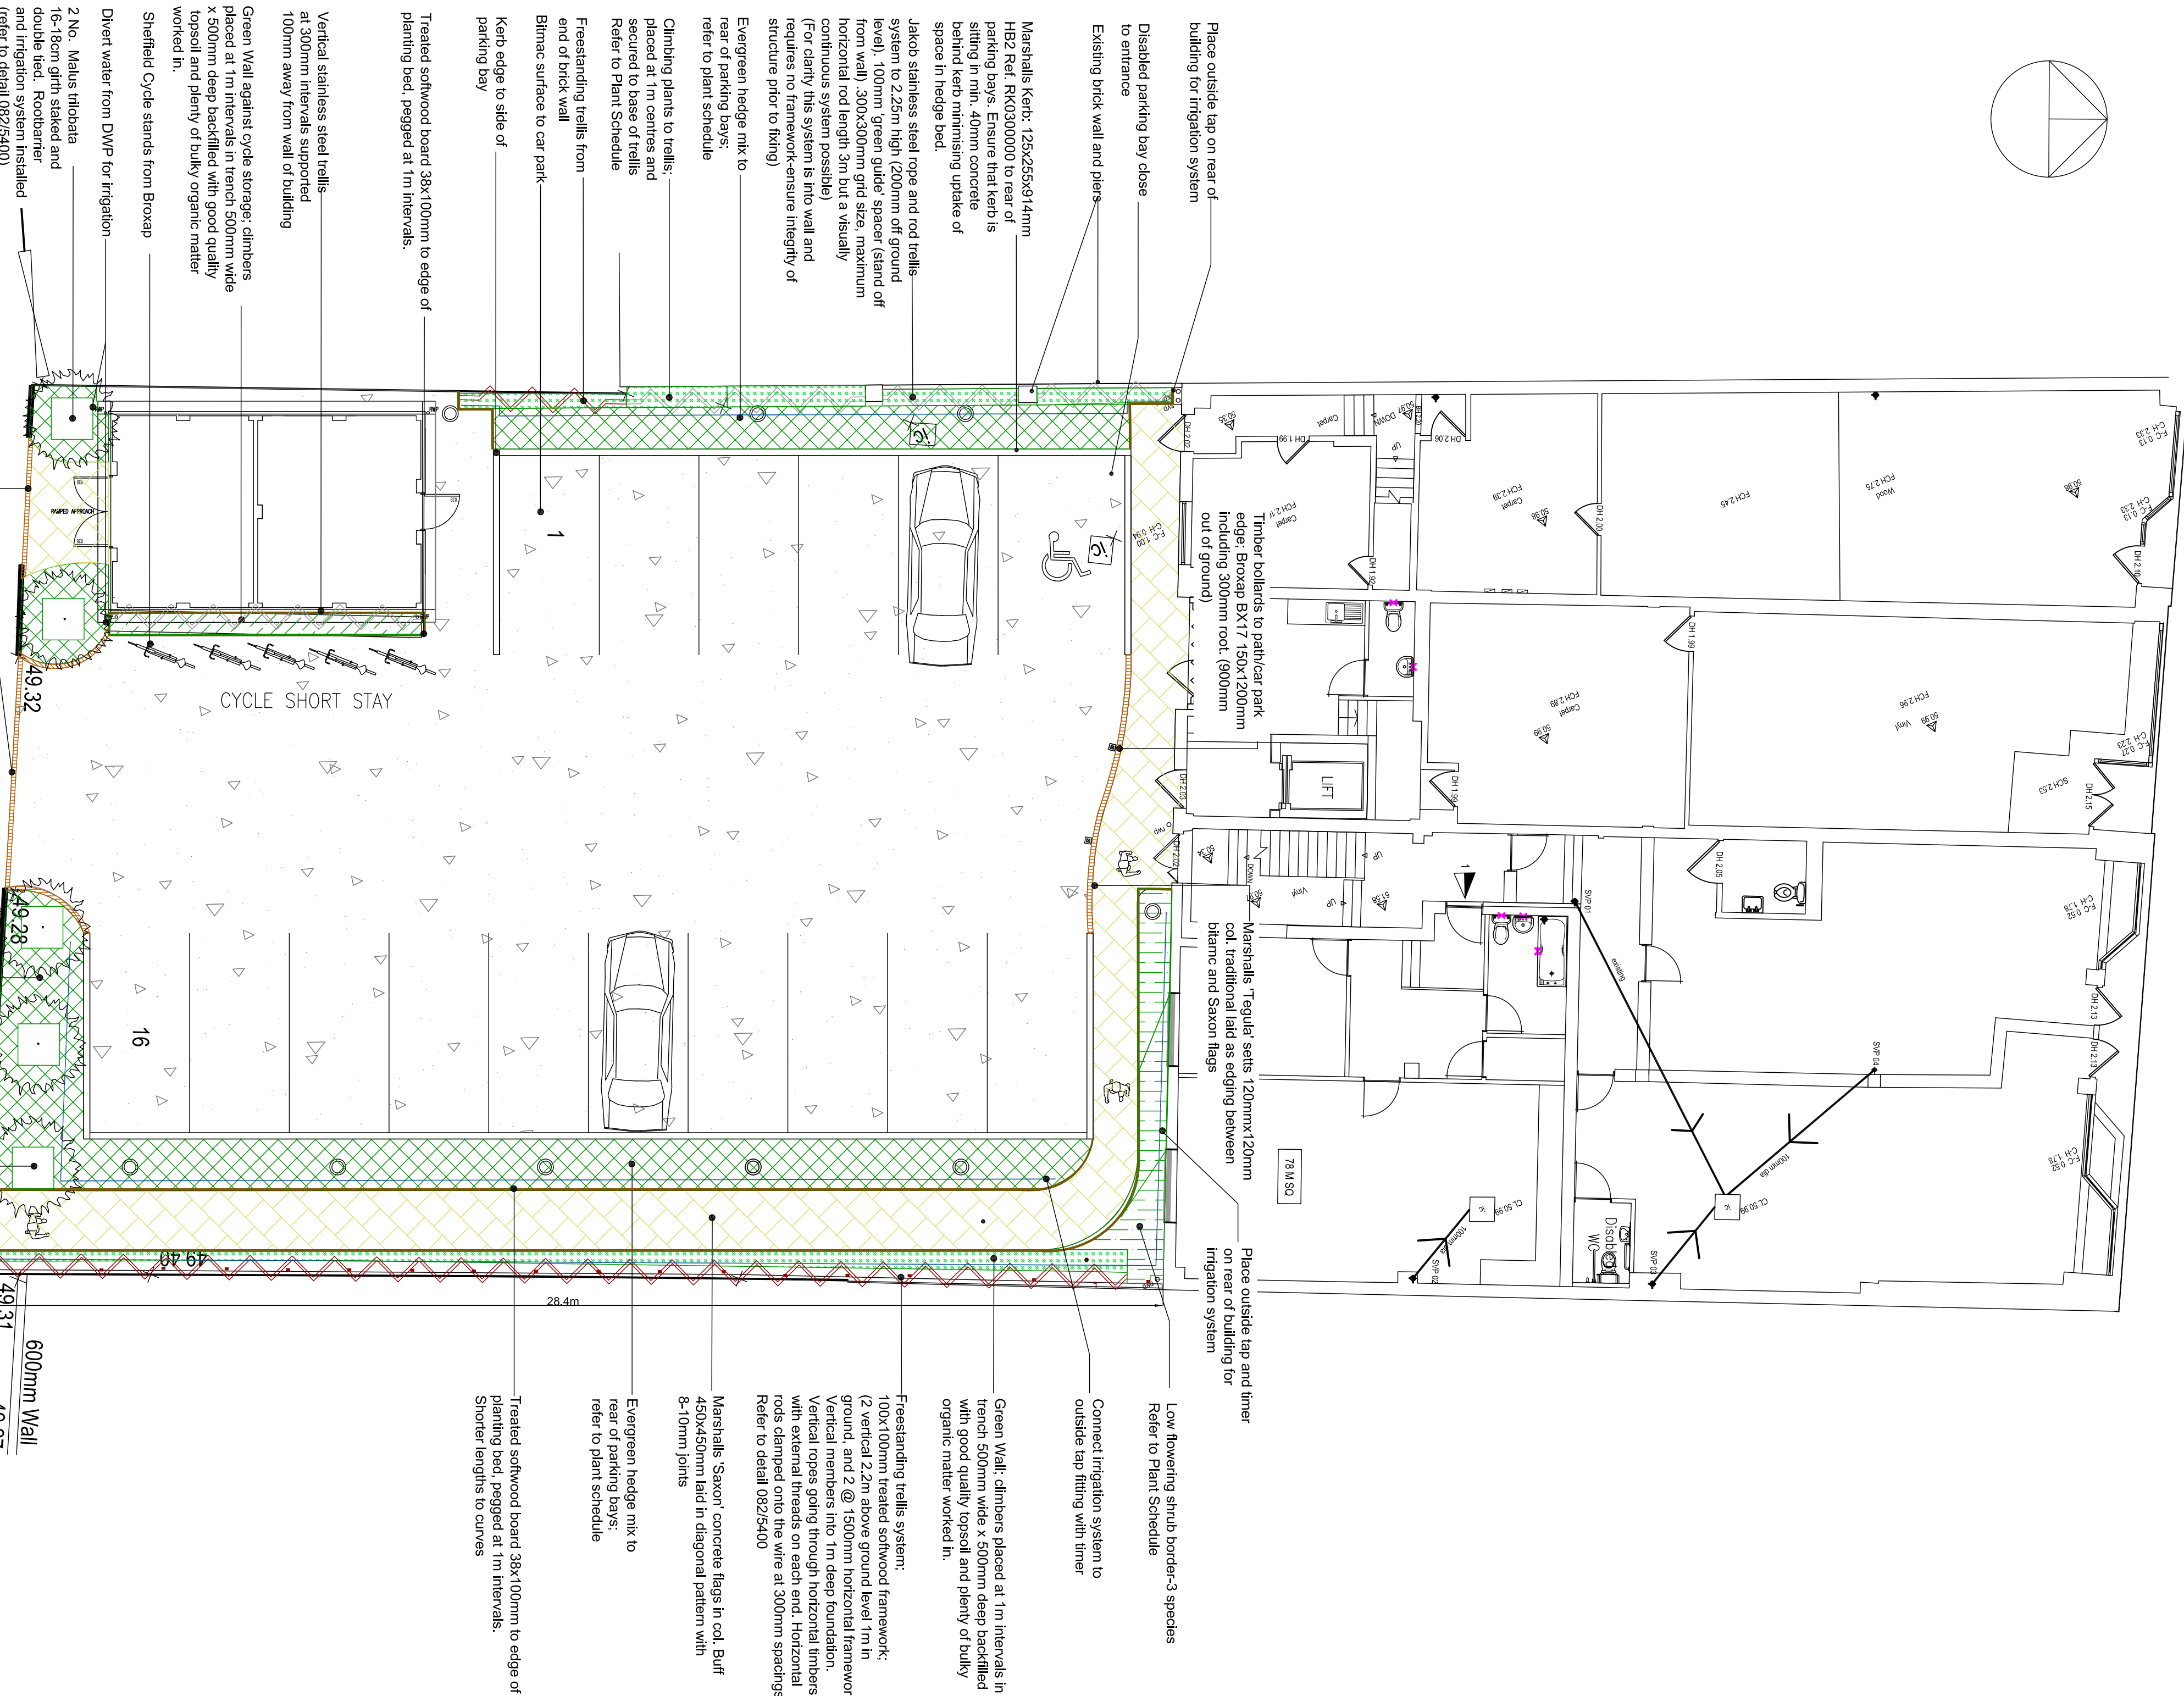

SPECIFICATION NOTES
1. Generally, refer to Plant Schedule and good horticultural practices

SPECIFICATION NOTES
1. Generally, refer to Plant Schedule and good horticultural practices

- ## 6. Soil handling and Planting Depths

- ## 7. Plant Handling and Establishment Plants in accordance with JCU and

- Setting out of planting to be approved by LA before planting commences. All

- ## 10. Tree Planting

- Trees to be double staked and tied with cross bar or underground guyed, supplied Water to tied capacity following planting and much with 50mm of bark mulch.

- Where planting around trees leave a metre square unplanted over surface of

- Water to field capacity following planting

- Check trees and shrub and hedge growth/condition on a regular basis, removing

- Trees; either connect into leaky pipe system or water with hose/bowser

Key

1001

Jakob rope and rod trellis system to brick boundary wall

Timber bollard from Broxap
BX17 150mmx1200mm
(900mm out of ground)

Adult sized Sheffield Cycle Stands from Broxap

Lighting (Refer to Architect's drawing)

Irrigation pipes

Evergreen hedging

Climbing Plants

Shrub planting

Proposed tree planting