

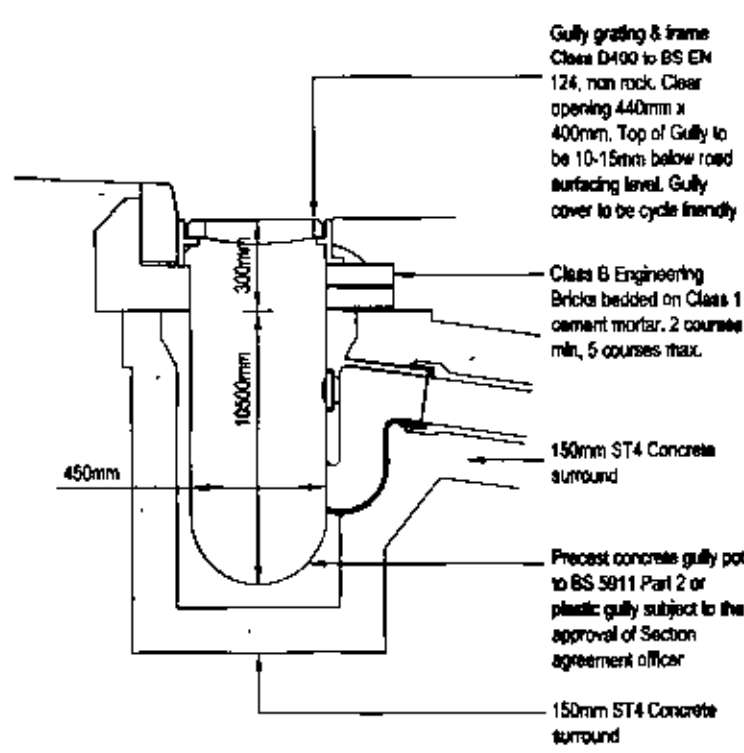
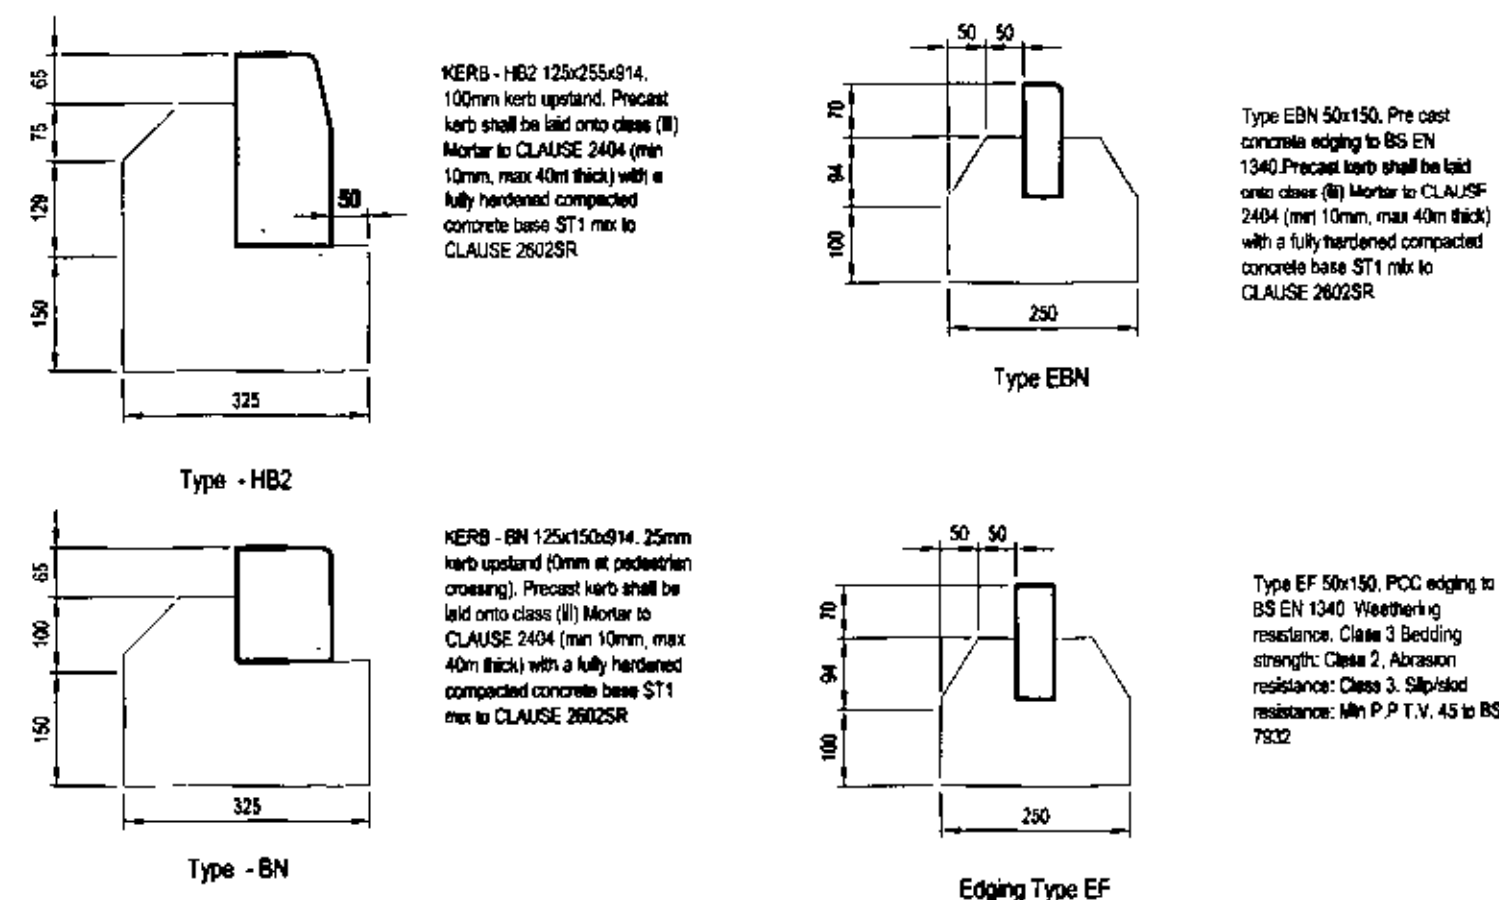
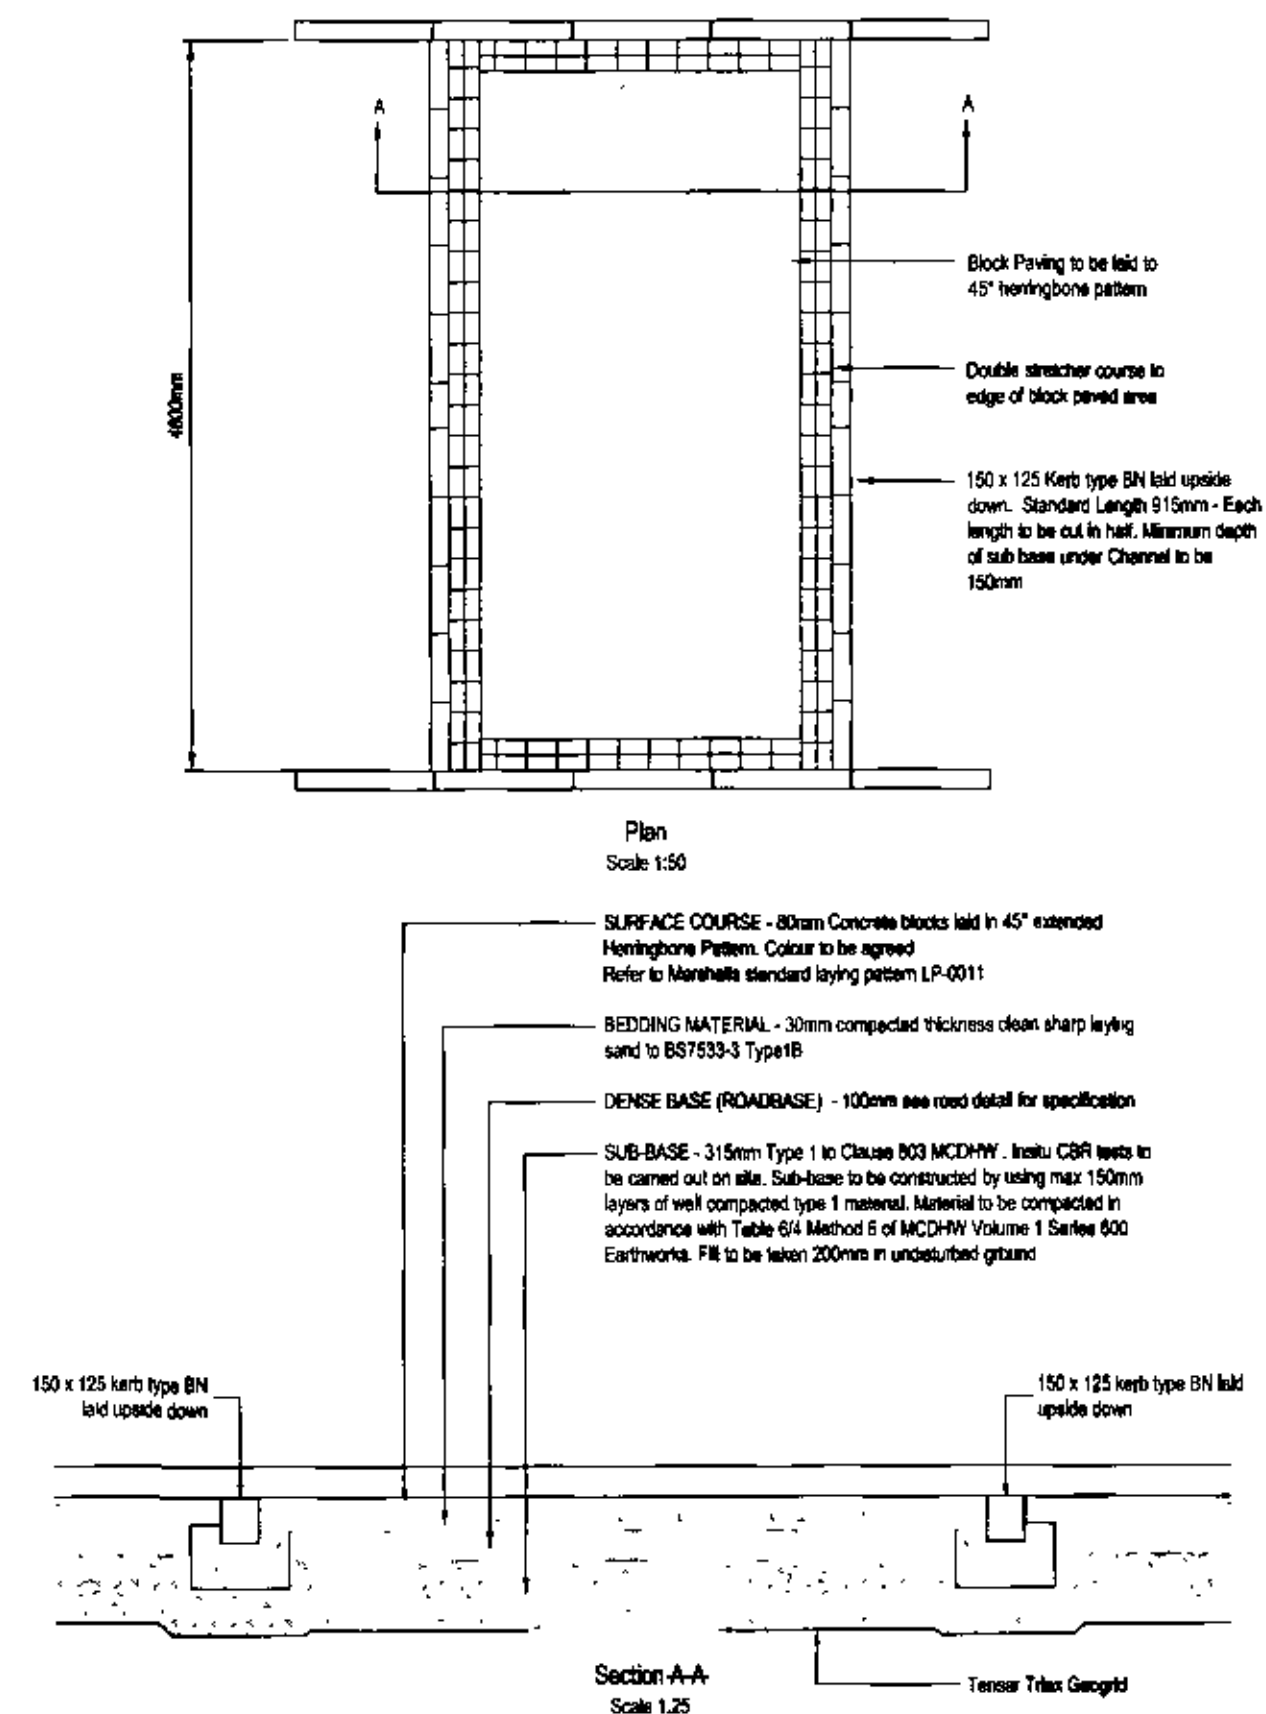


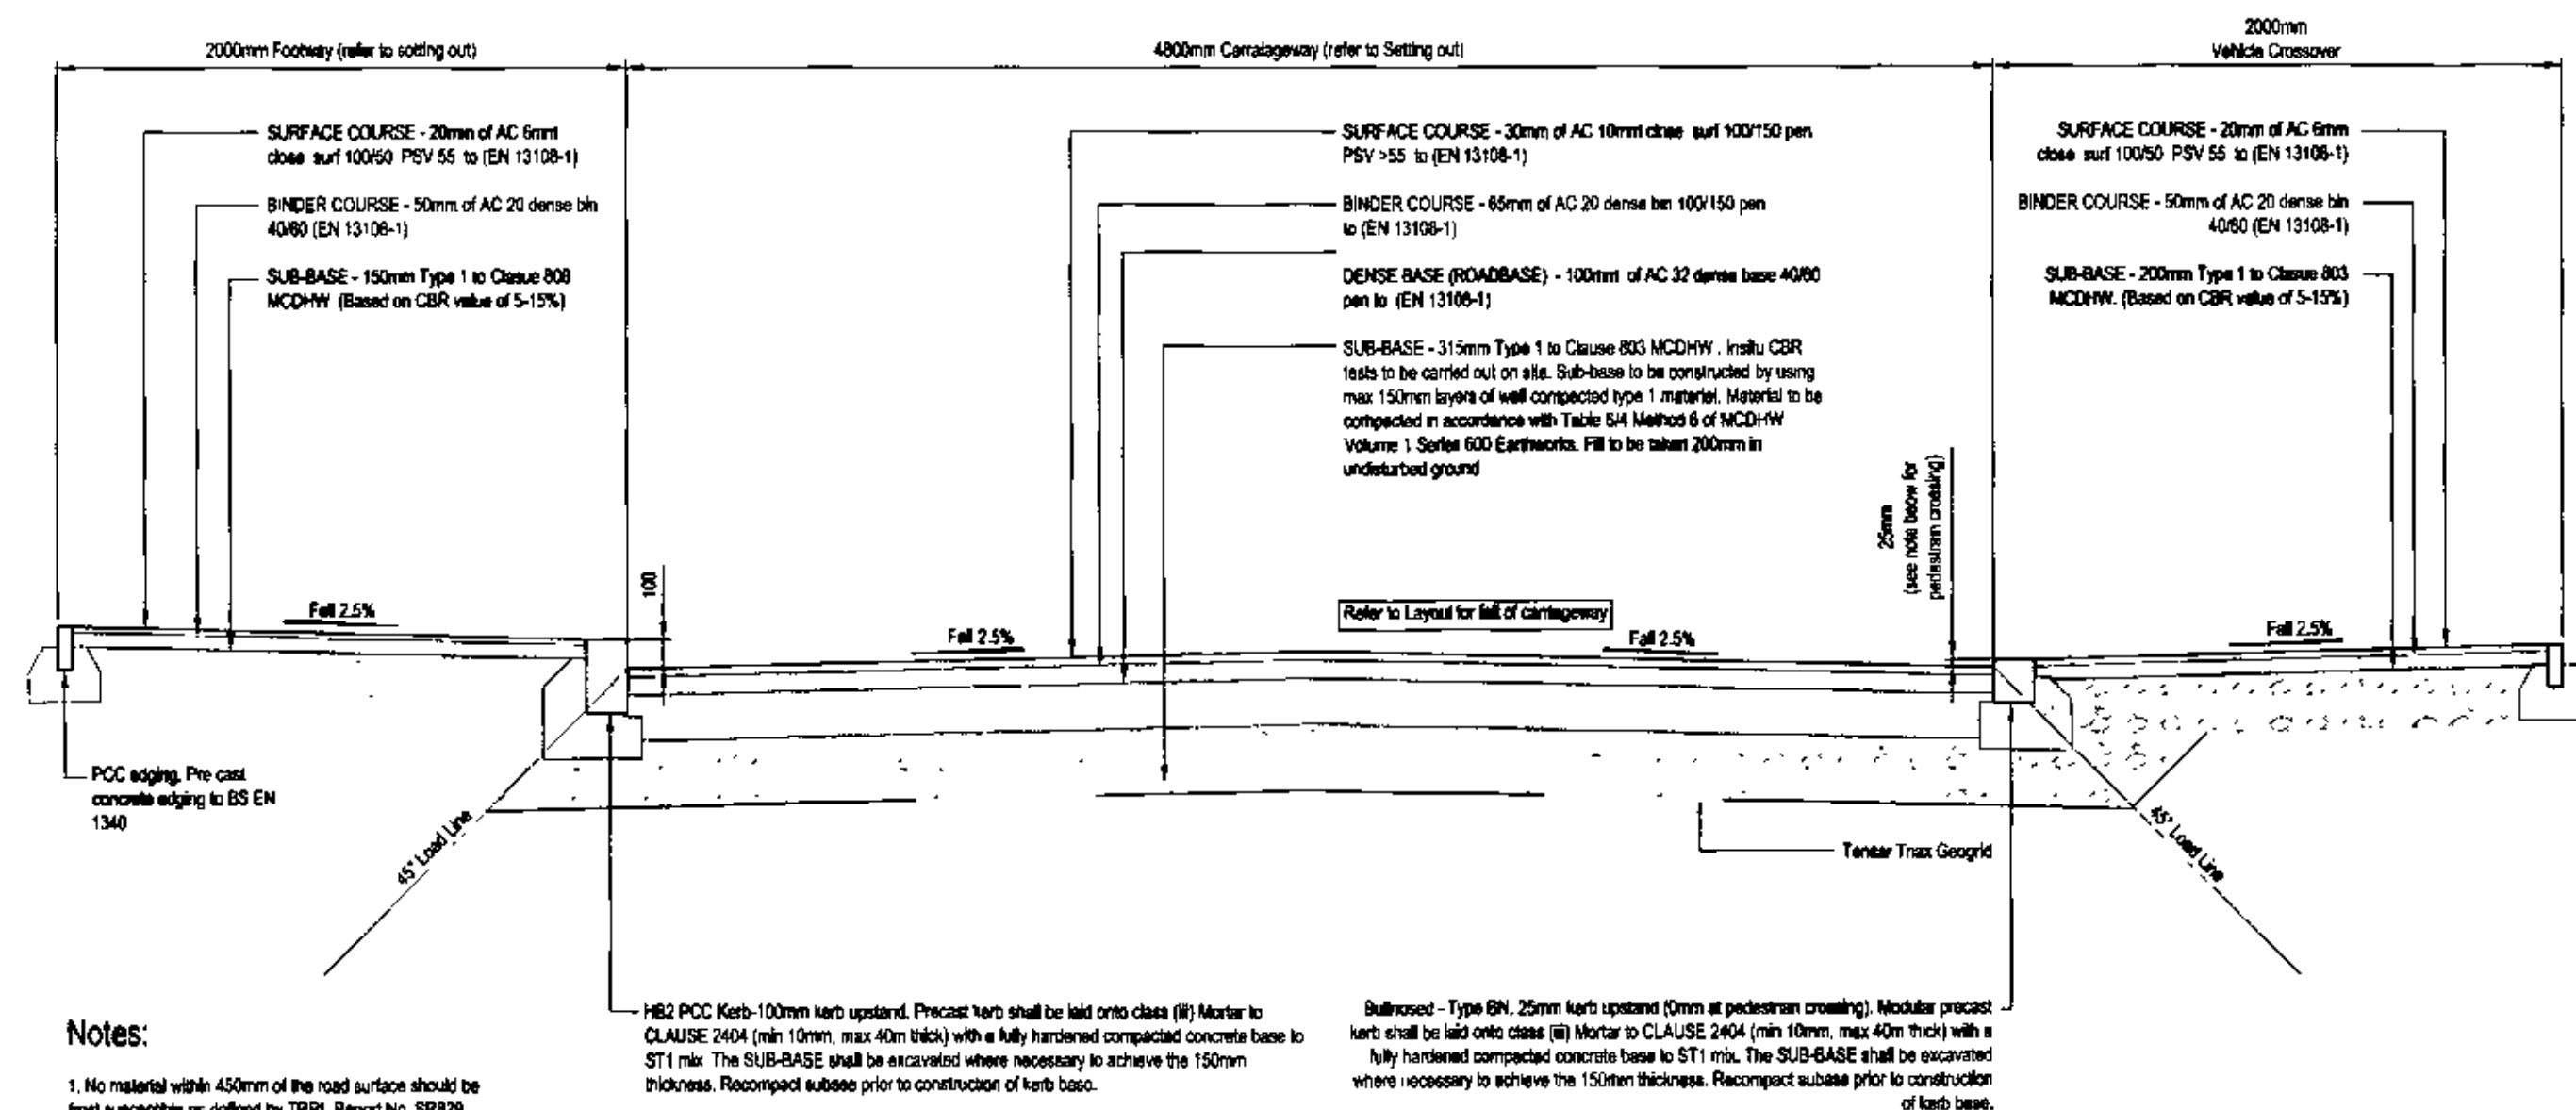

- All dimensions are in millimetres.
- Outlet pipe under carriageways or in verges less than 2m from edges of carriageways, are to have a minimum cover of 600mm and class CS bedding. Outlets greater than 2m from carriageway edges under verges are to have a minimum cover of 450mm.
- Gratings to be fall hand hinged when viewed facing the kerb. The hinged end being nearest to on coming traffic. The grating shall be captive within the frame.
- All works to be carried out in accordance with Local Authority requirements.

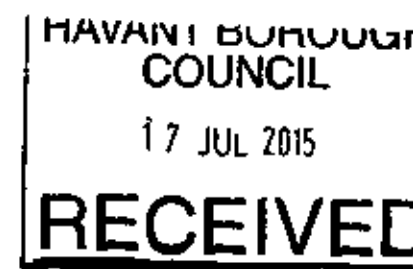

| Rev | Date     | Details                                                                        | Initials |
|-----|----------|--------------------------------------------------------------------------------|----------|
| C   | 08.01.15 | Tensar Triax Geogrid added to Adoptable Road Construction Section              | LJC      |
| B   | 16.06.14 | BASE thickness to road deck increased in thickness. SURFACE and BINDER amended | KAM      |
| A   | 29.08.14 | Initial issue                                                                  | KAM      |

Drawing Status  
**PRELIMINARY**

Project  
**Barncroft Way  
Havant**

Client  
**Bellway Homes**

**ESCHER SILVERMAN**  
Civil & Structural Consulting Engineers  
The Station, Lion Ramp Station, Stratford-upon-Avon, Warwickshire, CV34 0BE.  
Tel: 01794 522113 Fax: 01794 522115 email: escher@escher-silverman.co.uk  
www.escher-silverman.co.uk

| Drawn   | Checked     | Scale        | Paper Size | Date  |
|---------|-------------|--------------|------------|-------|
| KAM     | KHN         | As indicated | A2         | 08.14 |
| Job No. | Drawing No. | Revision     |            |       |
| ES1423  | 1423-501-01 | C            |            |       |