



Department of Planning and
Development
Havant Borough Council
Public Service Plaza
Civic Centre Road
Havant
Hampshire
PO9 2AX

Developer Services
Southern Water
Southern House
Sparrowgrove
Otterbourne
Hampshire
SO21 2SW

Tel: 0330 303 0119

Email: developerservices@southernwater.co.uk

Your Ref
APP/14/00035
Our Ref
PLAN-005273
Date
03/02/2014

Dear Sir

**Proposal: Two storey extension to existing end of terrace house to create 1No.
2 bed dwelling utilising existing vehicular access to Winchfield Crescent.
Site: 1 Winchfield Crescent, Havant, PO9 3SP.
APP/14/00035**

Thank you for your letter of 24/01/2014.

Please find attached a plan of the sewer records showing the approximate position of public sewers crossing the site. The exact position of the public sewers must be determined on site by the applicant before the layout of the proposed development is finalised. Furthermore, the sewer running from North-West corner is now deemed as public sewer, due to changes in legislation that came in to force on 1st October 2011. If planning permission were to be granted, Southern Water (as the statutory sewerage undertaker) would request that the Council (as the Building Control Authority) refuse Building Regulations approval on the grounds that building over the public sewer cannot be permitted.

In order to progress the proposed development on the site, the sewers will have to be diverted away from the line of the proposed dwelling or amend the plans so that the sewers are not constructed over.

It might be possible to divert the public sewers, so long as this would result in no unacceptable loss of hydraulic capacity, and the work was carried out at the developer's expense to the satisfaction of Southern Water under the relevant statutory provisions.

Should the applicant wish to divert apparatus:

1. The sewers requires a clearance of 3 metres either side of the sewer to protect it from construction works and allow for future access for maintenance.
2. No development or new tree planting should be located within 3 metres either side of the centreline of the public sewer
3. No new soakaways should be located within 5 metres of a public sewer.
4. All other existing infrastructure should be protected during the course of construction works.

Alternatively, the applicant may wish to amend the site layout, or combine a diversion with amendment of the site layout. If the applicant would prefer to advance these options, items (1) – (4) above also apply.

In order to protect drainage apparatus, Southern Water requests that if consent is granted, a condition is attached to the planning permission. For example "The developer must advise the local authority (in consultation with Southern Water) of the measures which will be undertaken to divert the public sewers, prior to the commencement of the development."

The applicant is advised to discuss the matter further with Southern Water, Southern House, Sparrowgrove, Otterbourne, Hampshire SO21 2SW (Tel: 0330 303 0119) or www.southernwater.co.uk".

Southern Water requires a formal application for any new connection to the public foul and surface water sewer to be made by the applicant or developer.

We request that should this application receive planning approval, the following informative is attached to the consent:

"A formal application for connection to the public sewerage system is required in order to service this development, Please contact Southern Water, Southern House, Sparrowgrove, Otterbourne, Hampshire SO21 2SW (Tel: 0330 303 0119) or www.southernwater.co.uk".


Yours faithfully



Developer Services

SOUTHERN WATER

HAVANT BOROUGH COUNCIL
- 5 FEB 2014
RECEIVED

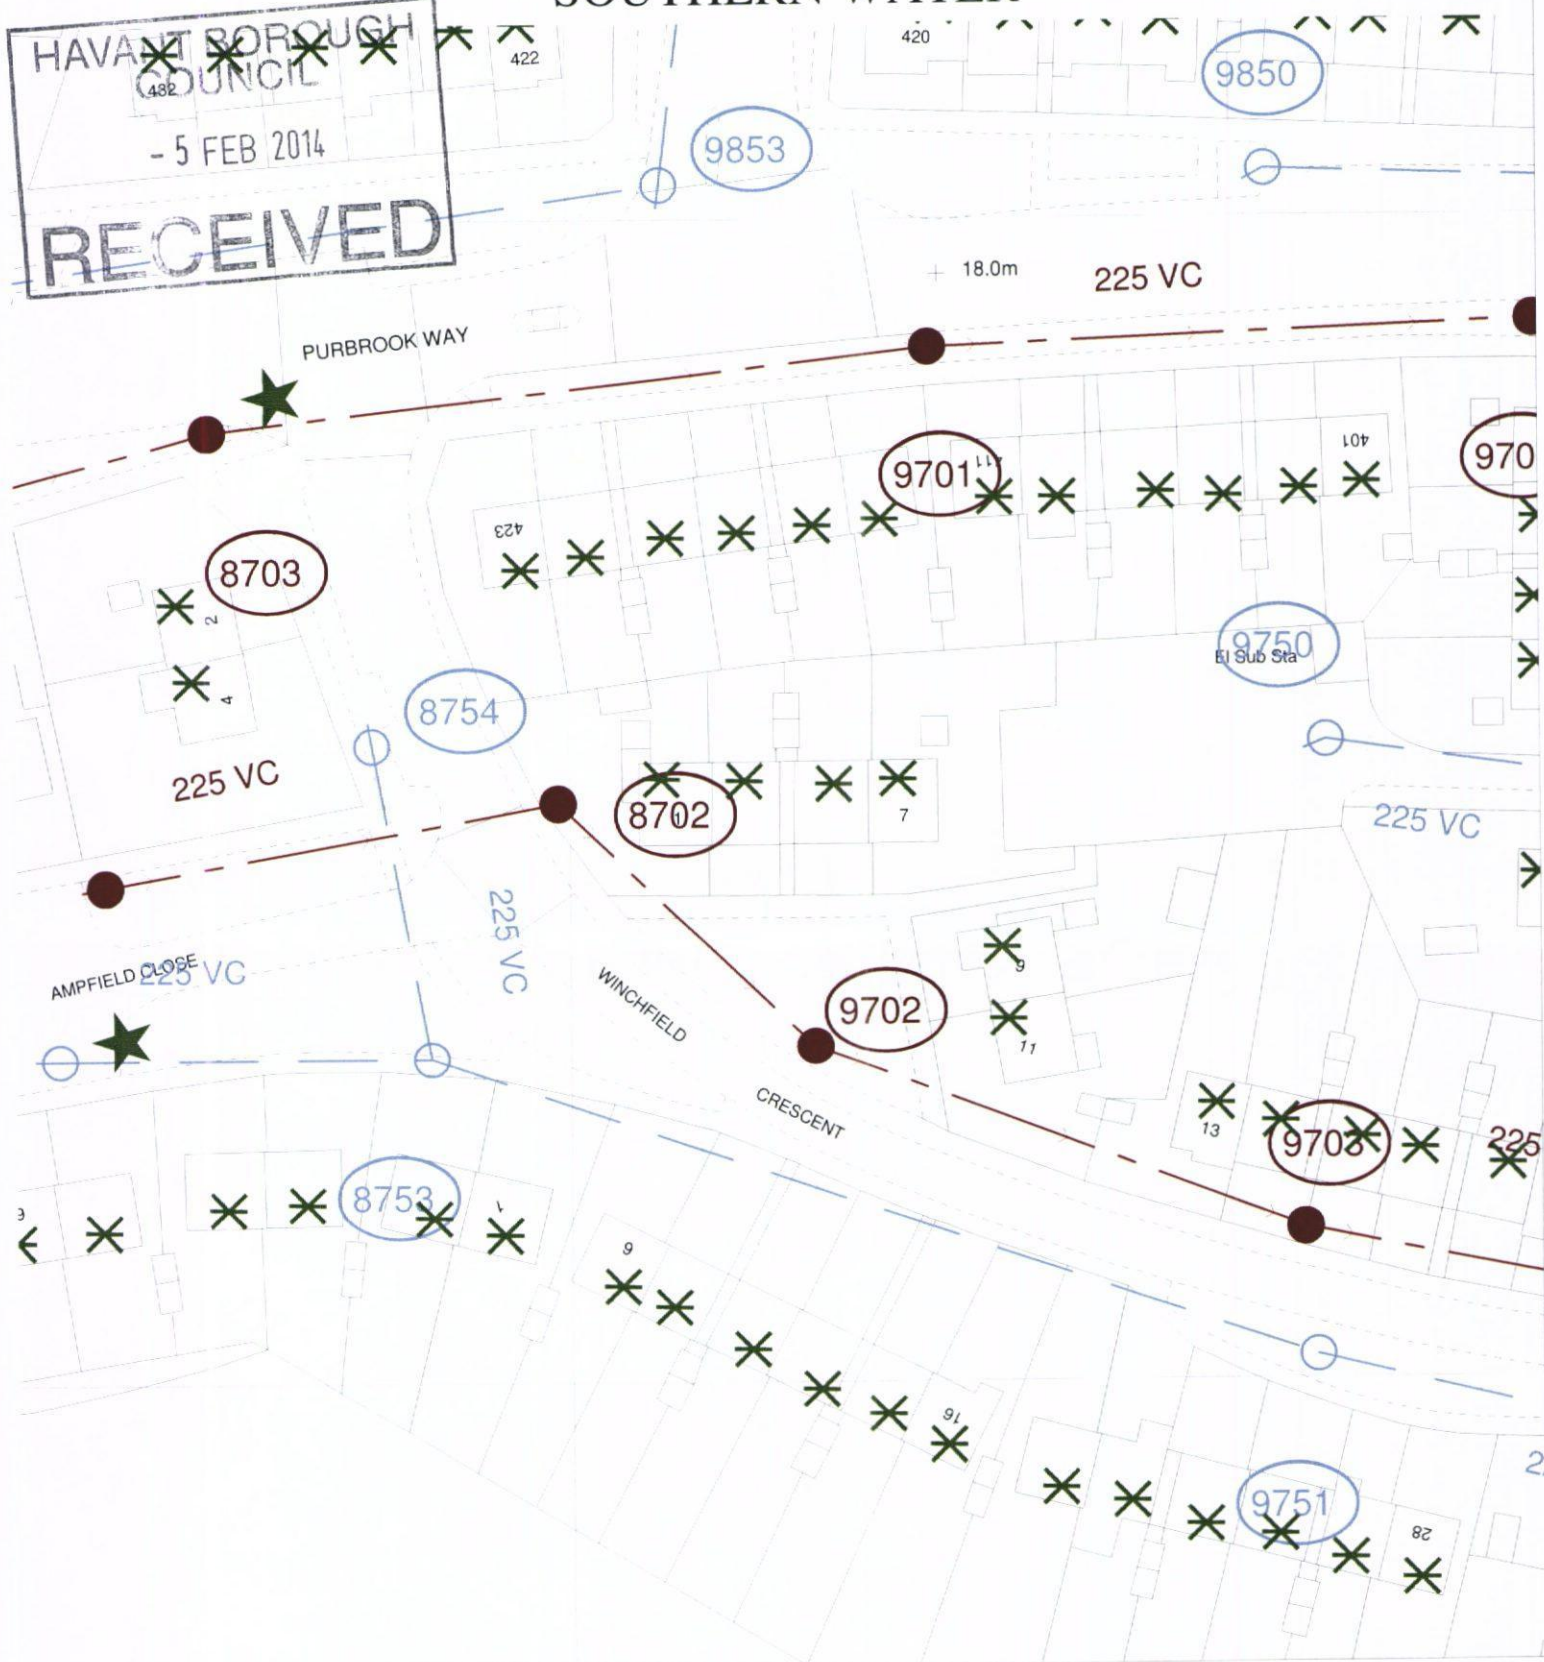

The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU6907NE

Scale: 1:625

Screen Print

WARNING: BAC pipes are constructed of Bonded Asbestos Cement
WARNING: Unknown (UNK) materials may include Bonded Asbestos Cement



Printed By: reddyma

Date: 31-1-2014

Southern Water MapGuide Browser

Requested By: