

PROPOSED TWO STOREY REAR ADDITION & ALTERATIONS. 4, SPINDLE WARREN. DENVILLES, HAVANT, HANTS. FOR MR & MRS A. JONES.

NOTE CHECK ALL MEASUREMENTS ON SITE PRIOR TO THE COMMENCEMENT OF WORK.

WALLS FULLY BONDED AND CAVITIES MAINTAINED CONTINUOUS, CLOSE ALL REVEALS WITH VERTICAL DPC AND INSULATED CAVITY CLOSERS.

PROVIDE SMOKE DETECTORS TO BOTH FLOORS MAINS OPERATED AND INTERLINKED WITH BATTERY BACKUP.

FIRST FLOOR 175MMX50MM JOISTS AT 400MM CENTRES WITH WATER RESISTANT T&G CHIPBOARD SOLID BLOCK MID SPAN STRUTTING AND 12.5MM PLASTERBOARD AND SET CEILING INSERT INTO FLOOR GLASS WOOL BATTS MIN DENSITY KG/M3.

FOUNDATIONS TO BE MINIMUM 1 M. DEEP TO LOCAL AUTHORITY APPROVAL TO SUIT SITE CONDITIONS. USE ONLY CLASS A CONCRETE BLOCKS BELOW GROUND LEVEL. FOUNDATIONS ALSO TO COMPLY WITH NHBC PRACTICE NOTE WITH REGARD TO ANY TREES.
NOTE TRENCH FILL FOUNDATIONS


GROUND FLOOR MIN. 100 MM CONCRETE ON MIN. 100MM. HARDCORE 1200 GAUGE POLYTHENE D.P.M., 80MM CELOTEX GA 3000 UNDER SLAB 50MM SAND/CEMENT SCREED FINISH NOTE ANY AIRBRICKS BLOCKED TO BE DUCTED TO THE EXTERNAL AIR.

RAINWATER DISPOSAL VIA 100MM DIAMETER GUTTERS AND DOWNPIPE TO NEW SOAKAWAYS MIN 5M FROM ANY BUILDING AND MIN 1M/3
ANY NEW RADIATORS TO BE FITTED WITH TRV VALVES.

PROVIDE MECHANICAL VENTILATION TO KITCHEN AND UTILITY ALSO SHOWER ROOM DUCTED TO THE EXTERNAL AIR MINIMUM CAPACITY 60 LITRES/SEC

DRAINS TO BE 100MM DIAMETER APPROVED PLASTIC LAID 1.40 BEDDED AND SURROUNDED IN 150MM PEASHINGLE HAUNCH IN 150MM CONCRETE UNDER BUILDING PROTECT WITH LINTELS THROUGH FOUNDATIONS

STRIP OF EX GARAGE ROOF AND PITCH NEW LEAN TO ROOF WITH FELT BATTENS AND TILES TO MATCH ON 125X50MM RAFTERS AND 150X50MM RAFTERS AT 400MM CENTRES STRAP AS BEFORE AND ADJUST PLATE HEIGHT TO SUIT, BUILD UP GABLES TO LA APPROVAL.

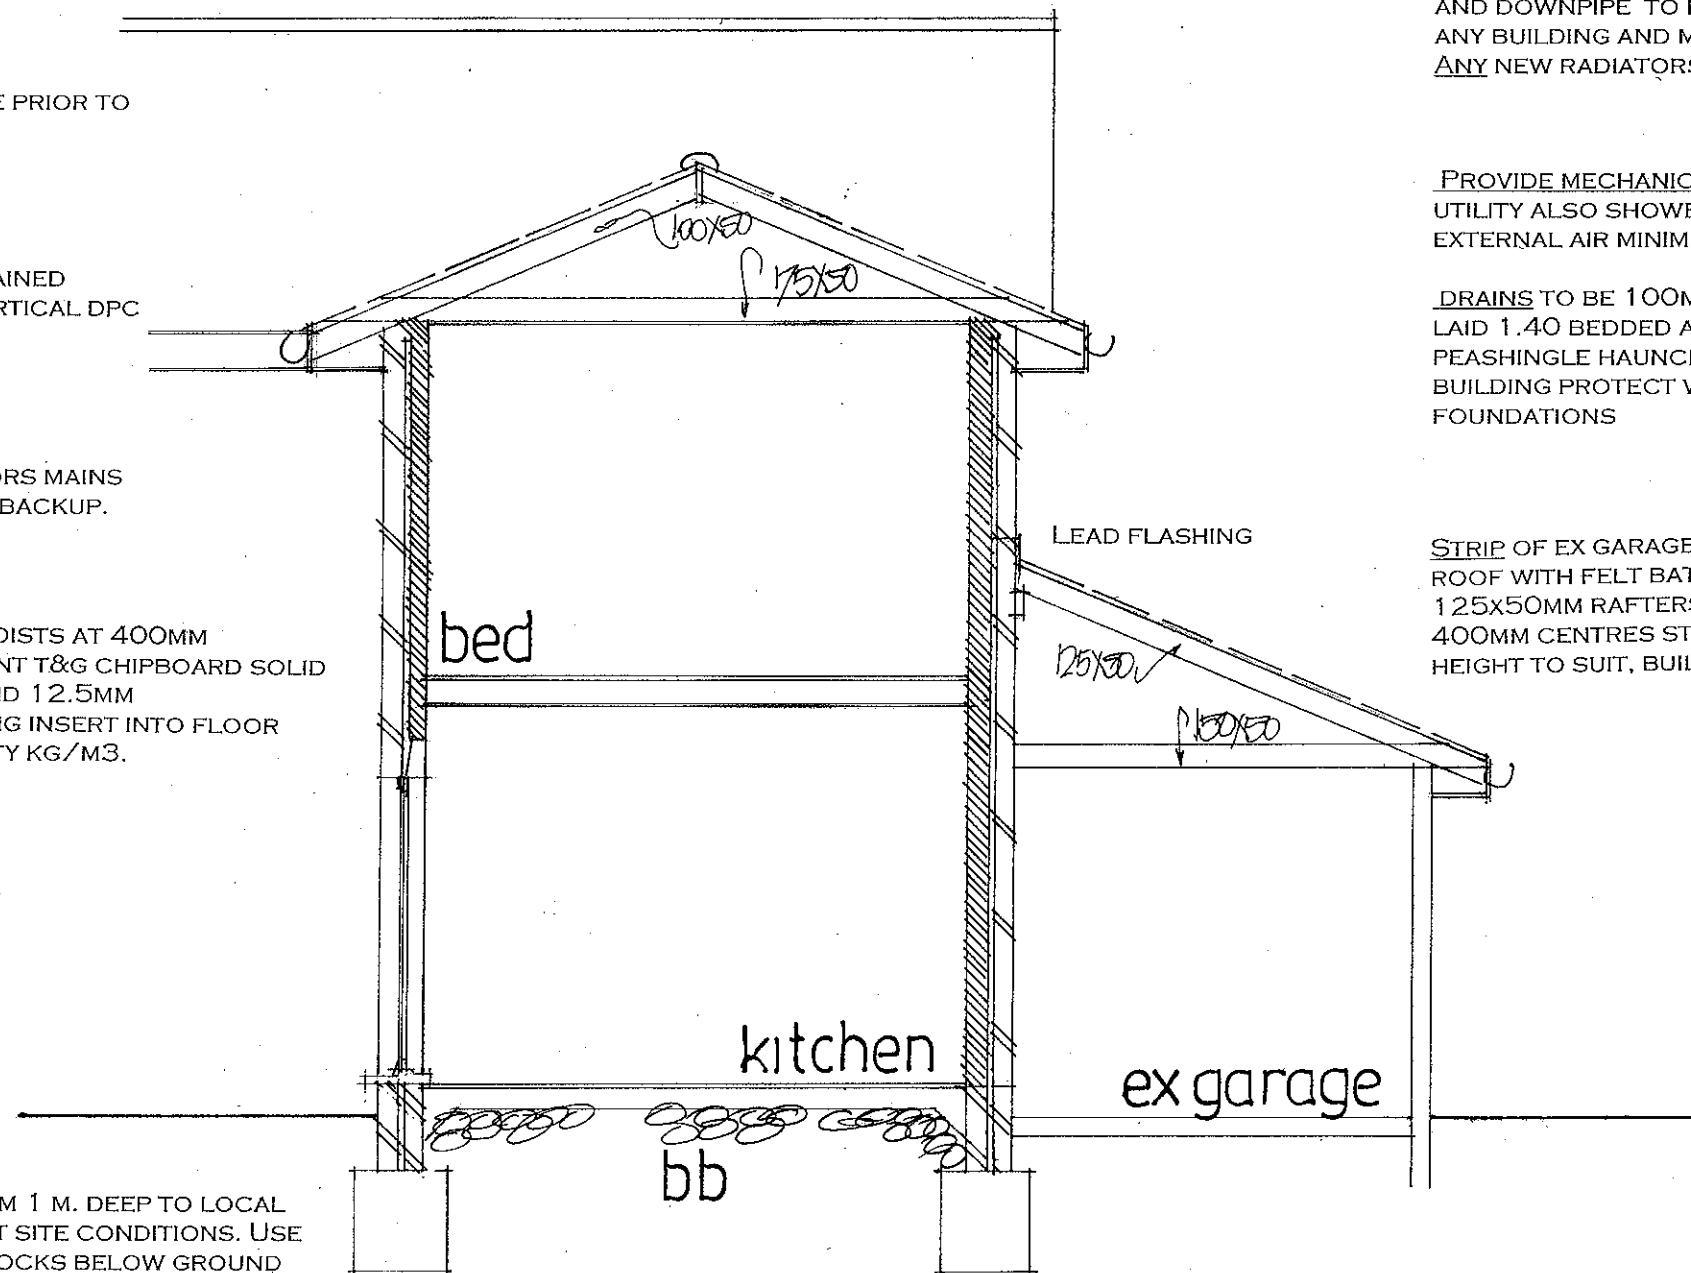

date july 2013
scale 1:50

SECTION DRAWING

PETER J. WALKER MRICS
CHARTERED SURVEYOR
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9 AN

TEL: 02392 467571