



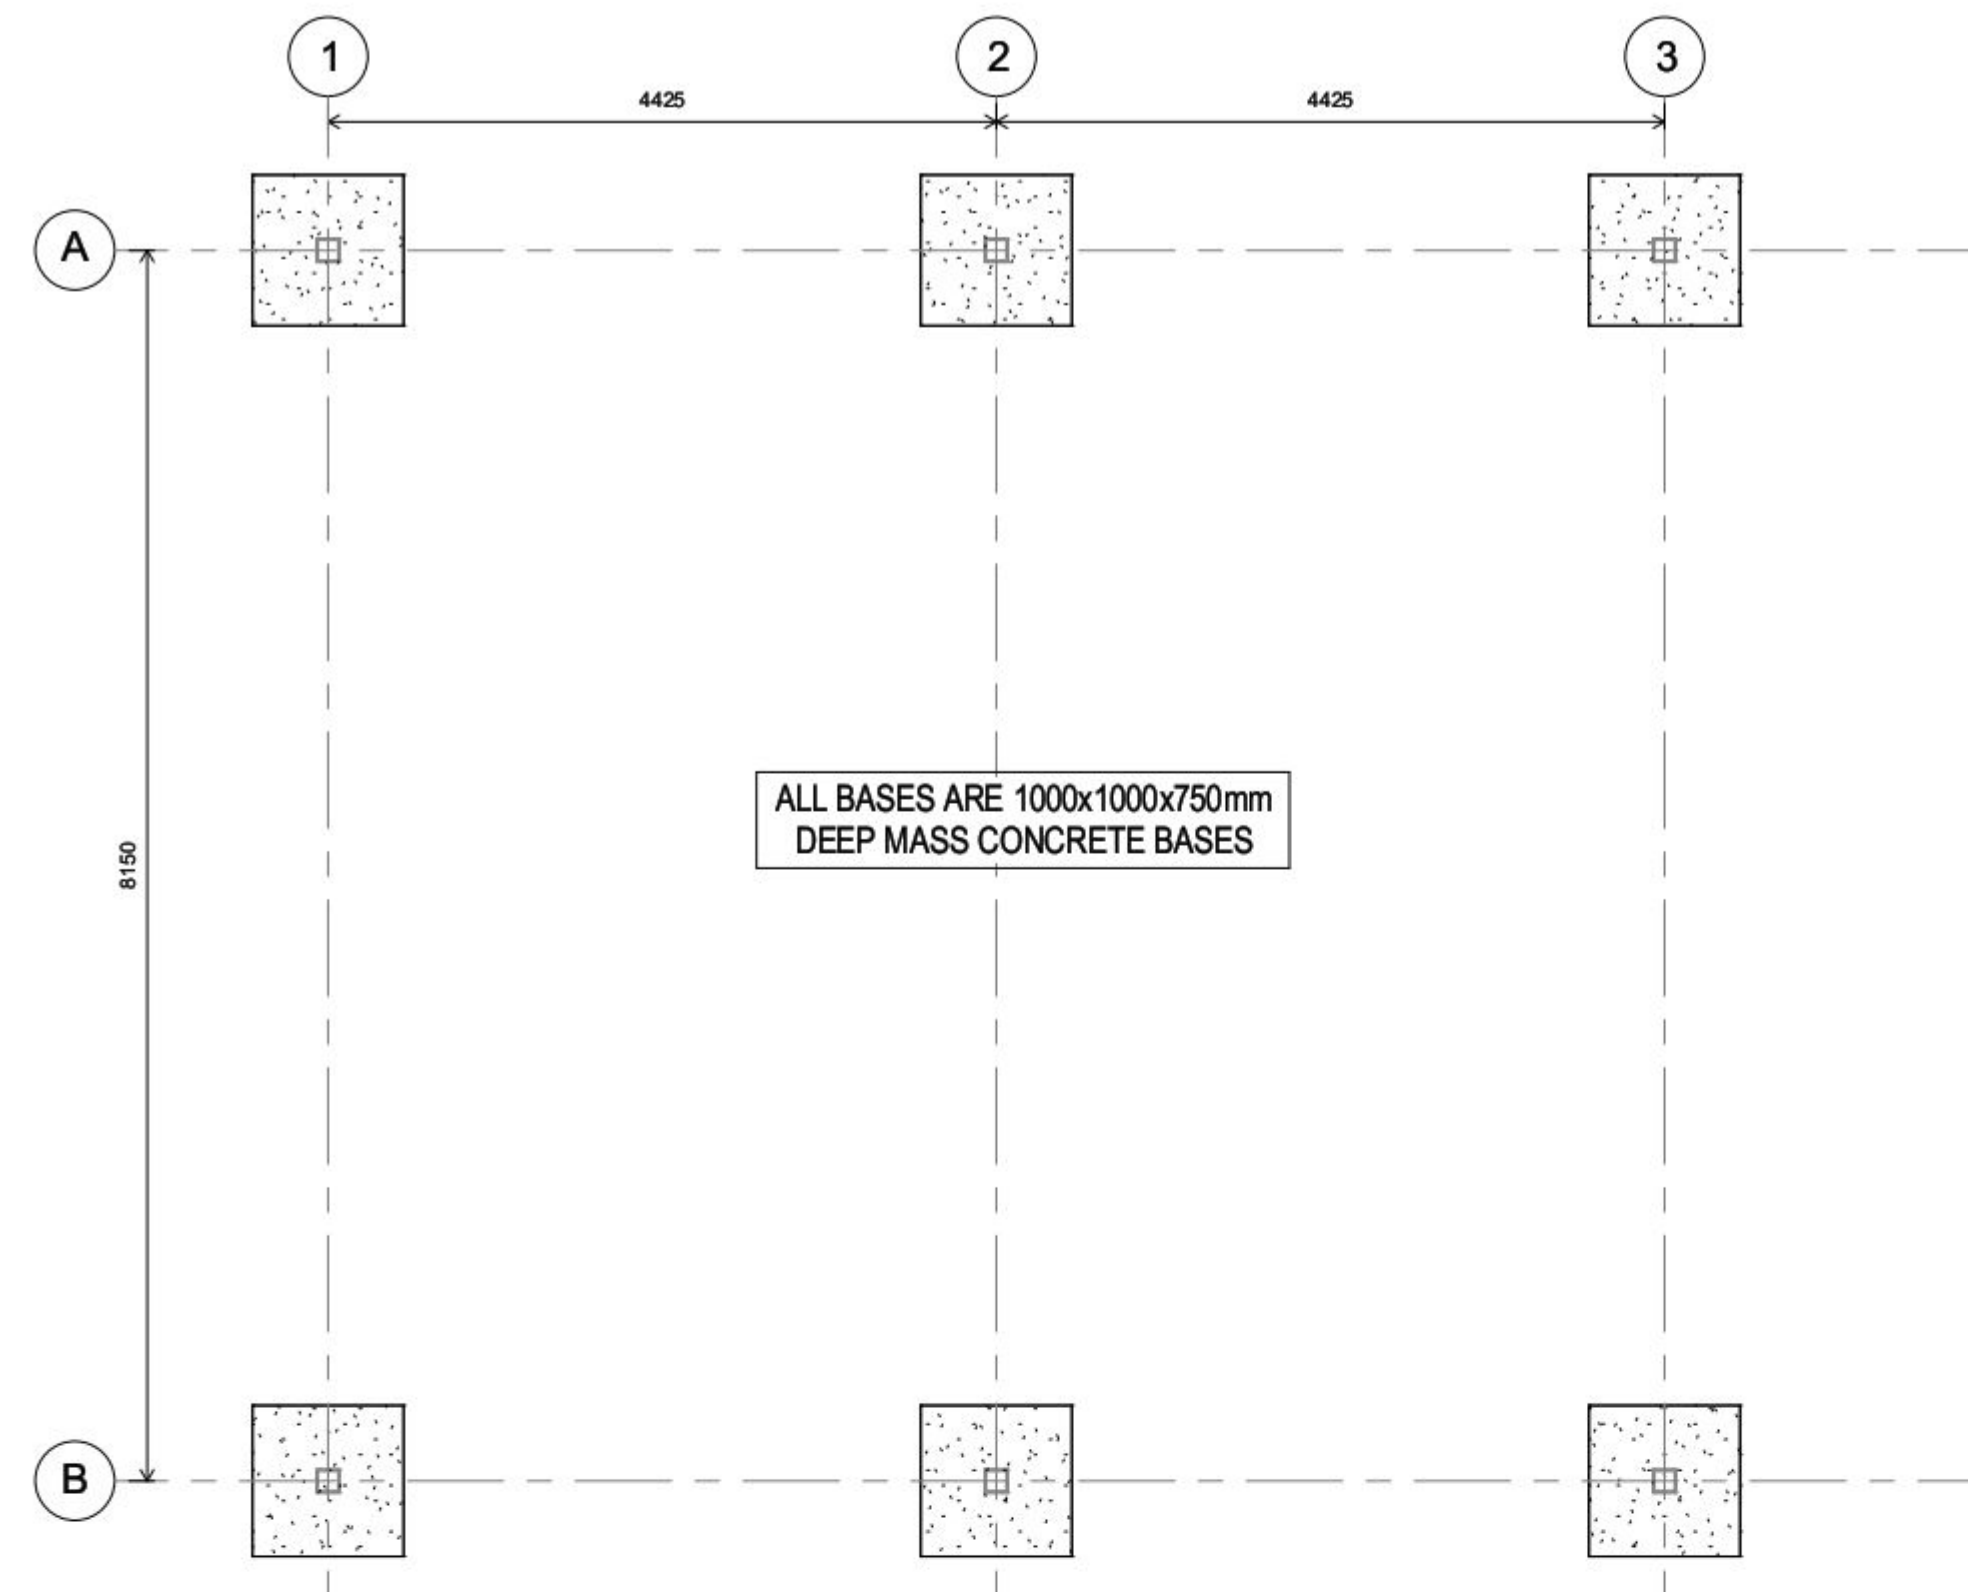


1 Foundation GA
1 : 50

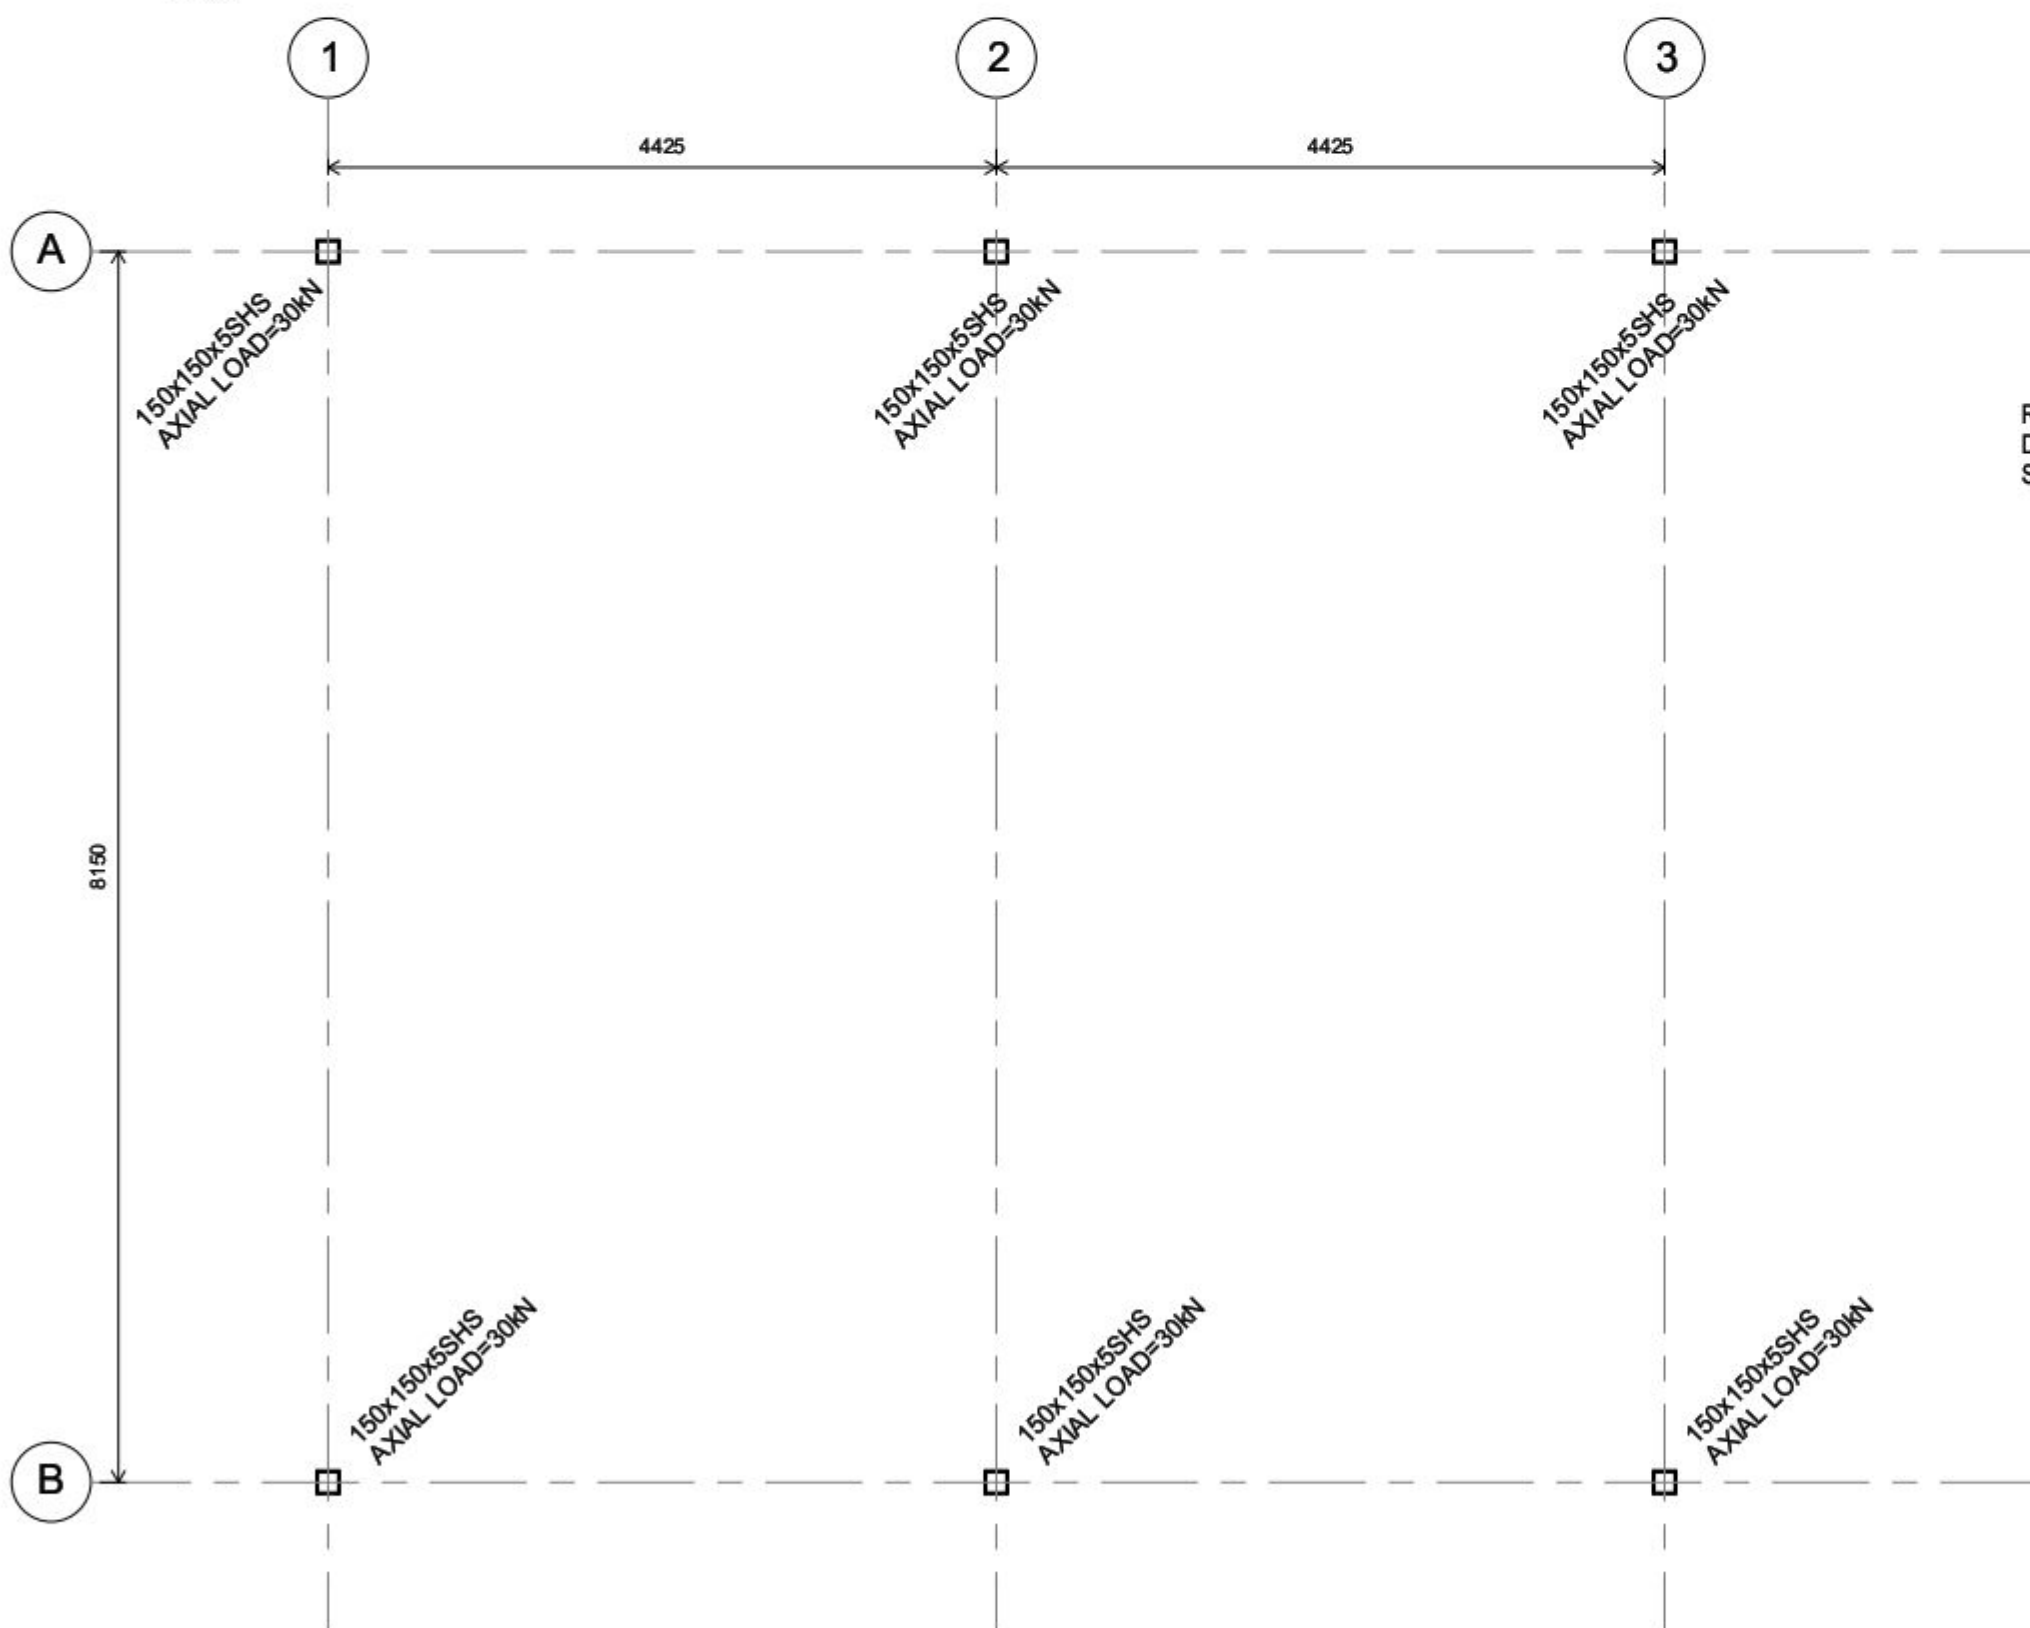


2 Column GA
1 : 50

PLATE THICKNESS AND BOLT SIZE TO BE DETERMINED BY THE STEELWORK FABRICATOR.

4 No. SSOX HOLDING DOWN BOLTS
Min. BOLTS TO BE M16x300mm LONG

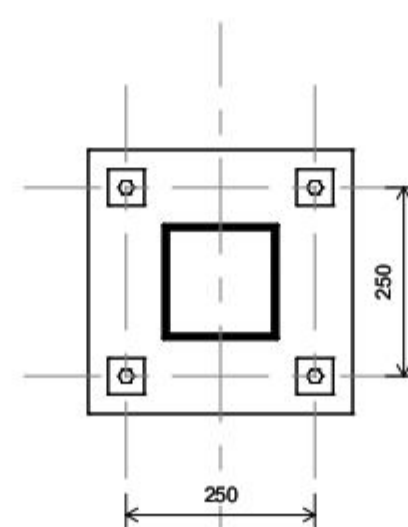


7 Baseplate Detail
1 : 10

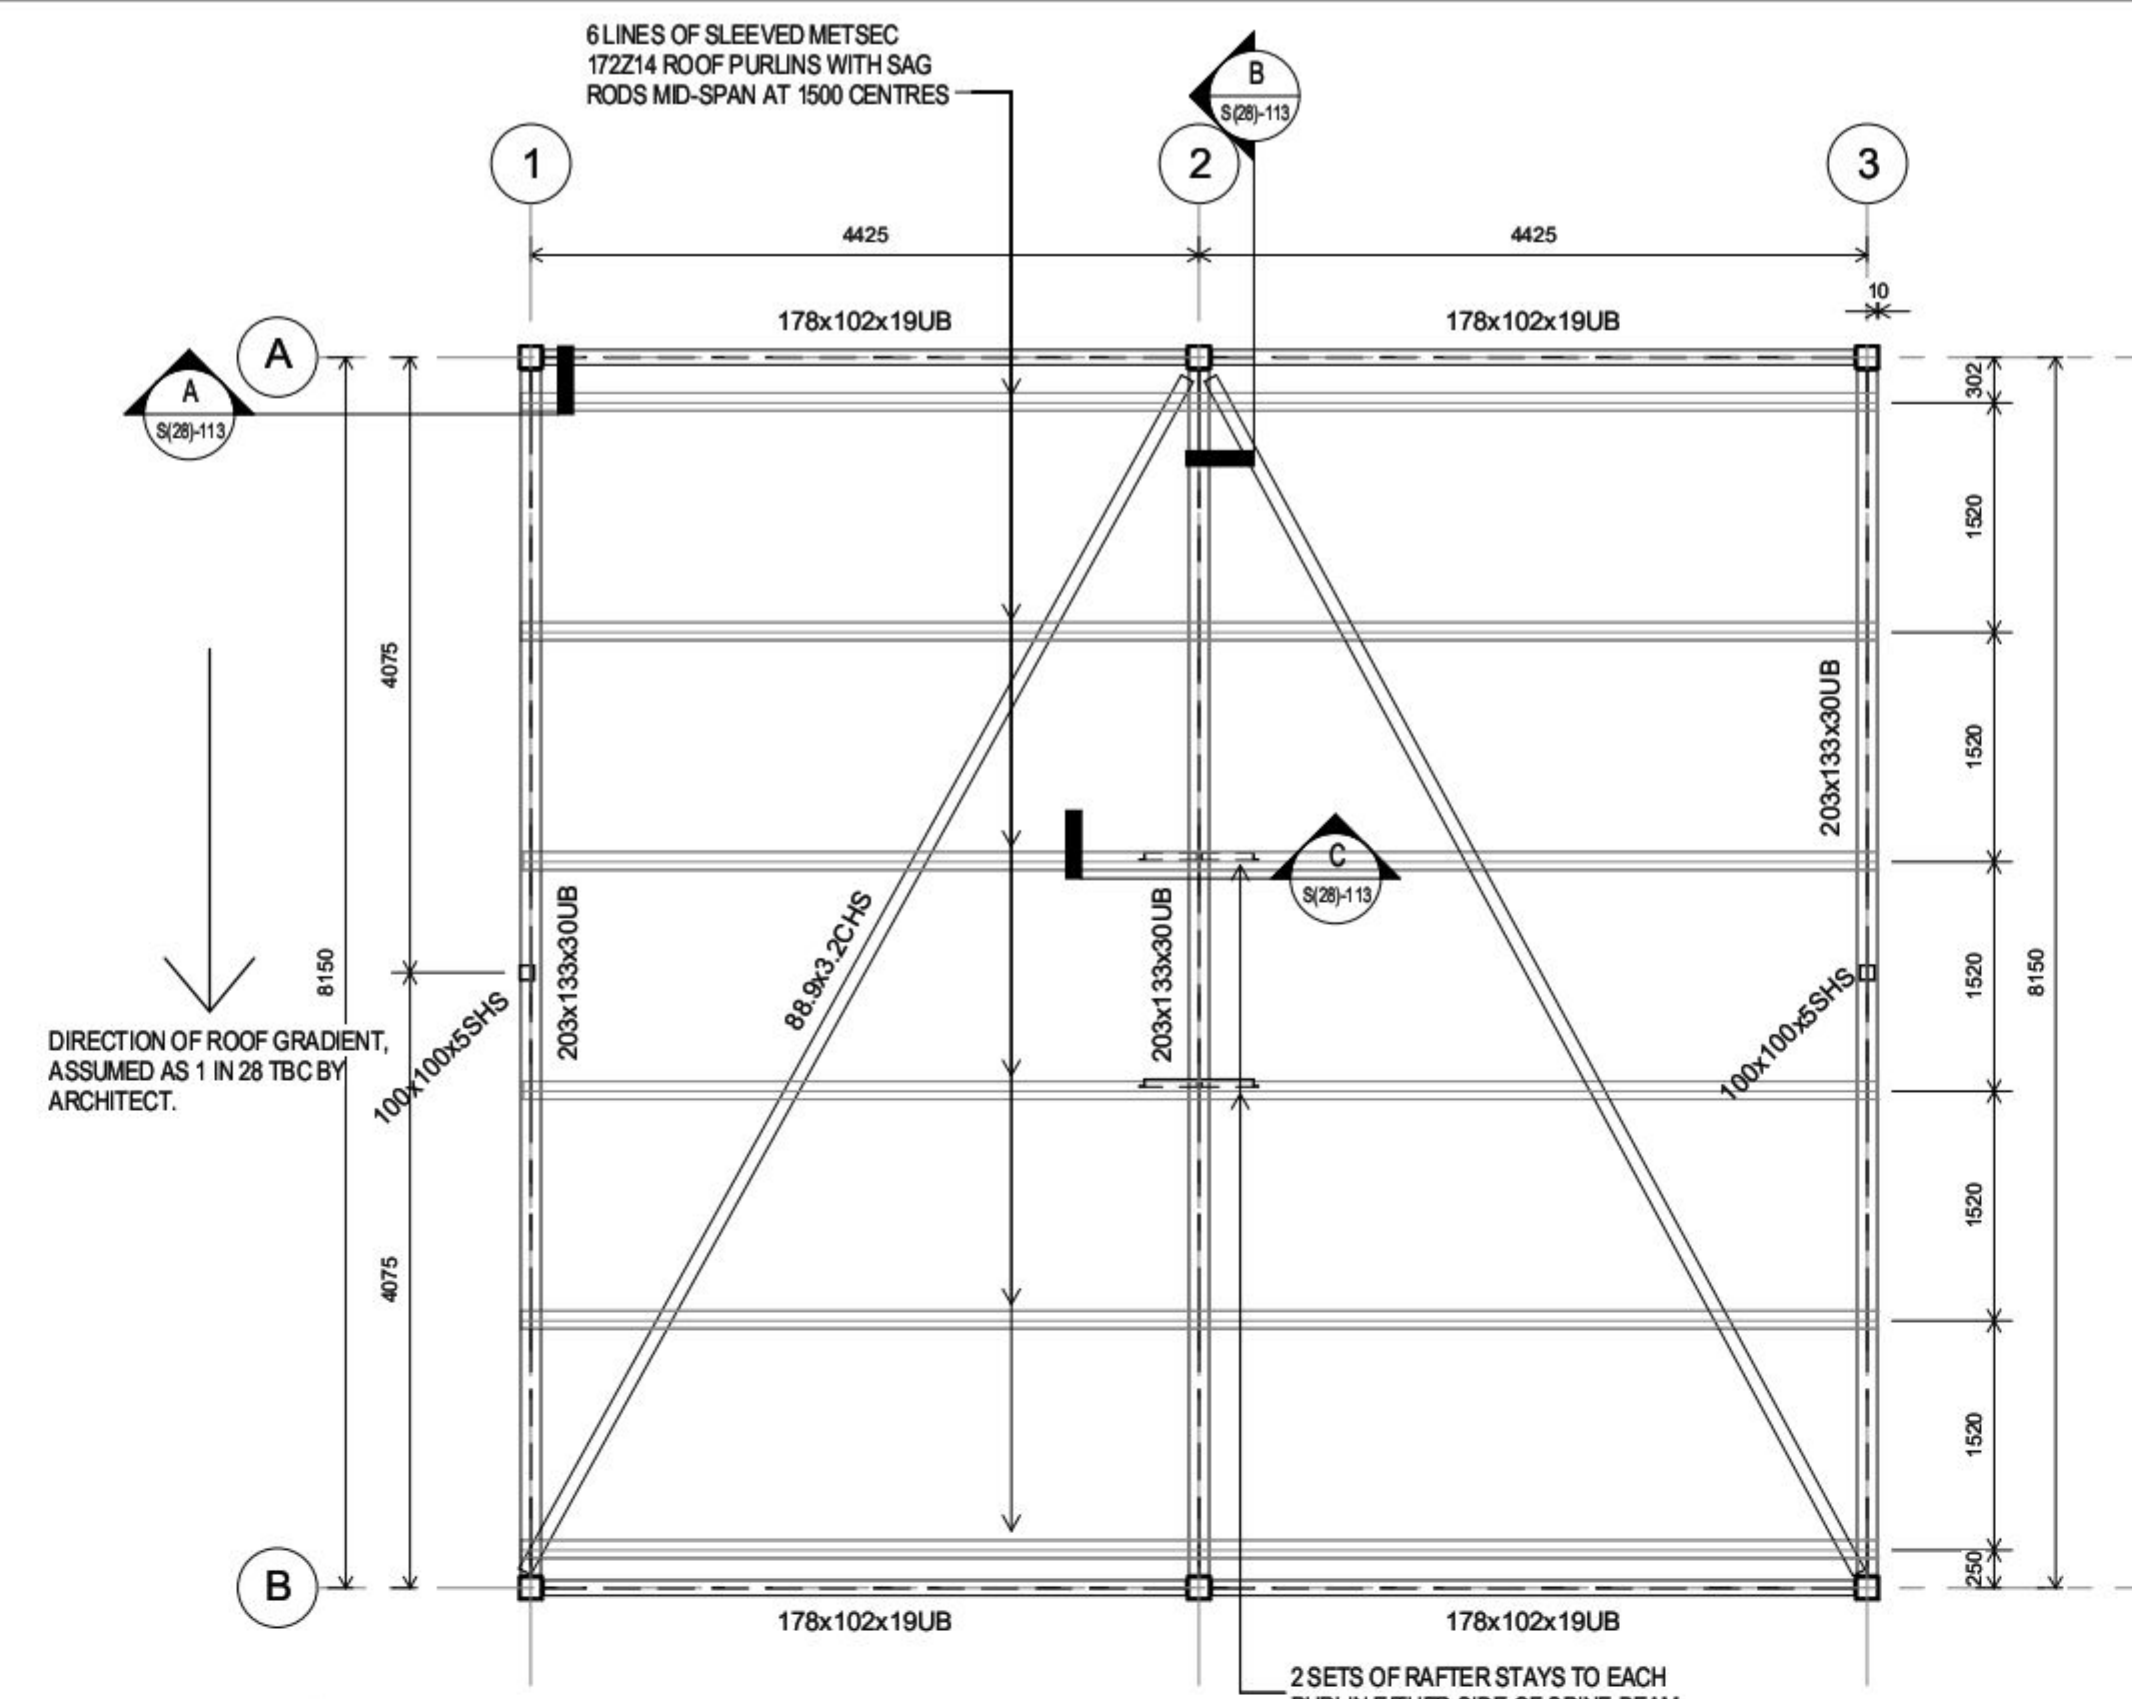


3 Roof GA
1 : 50


ALL ROOF BEAM CONNECTIONS TO VERTICAL POSTS (BOTH DIRECTIONS) TO BE DESIGNED TO SUPPORT THE FOLLOWING VERTICAL LOAD AND MOMENT :-
V=30kN
M=30kNm

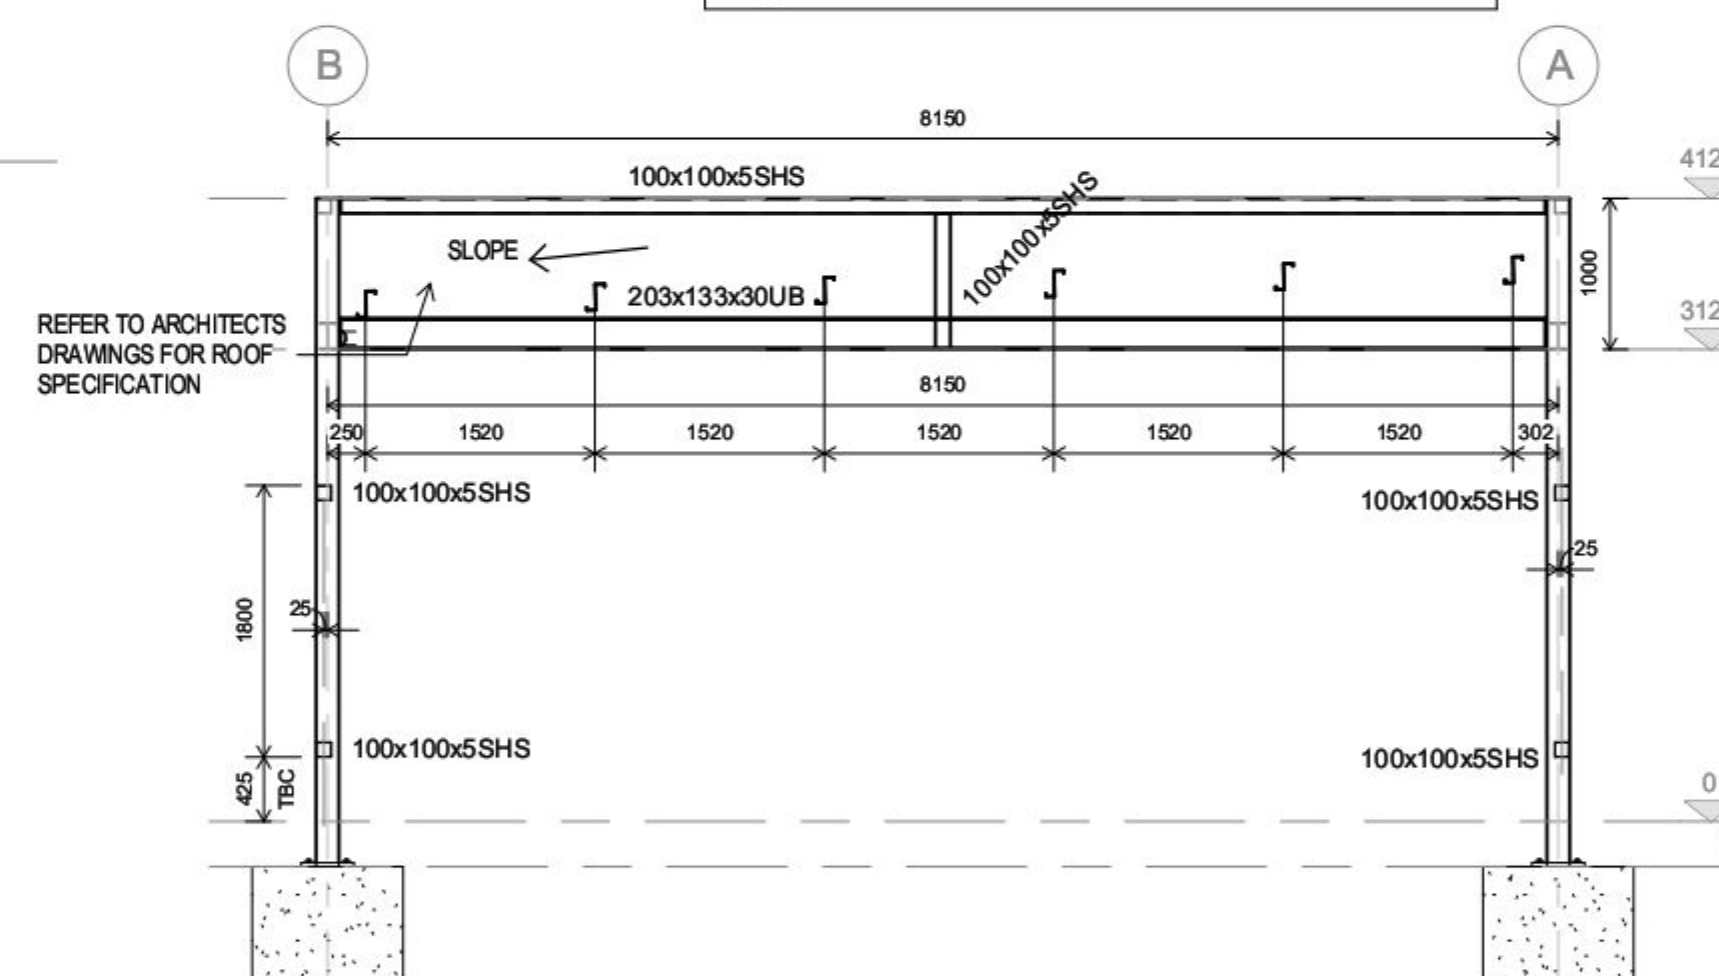


4 Elevation Grid 1/3
1 : 50

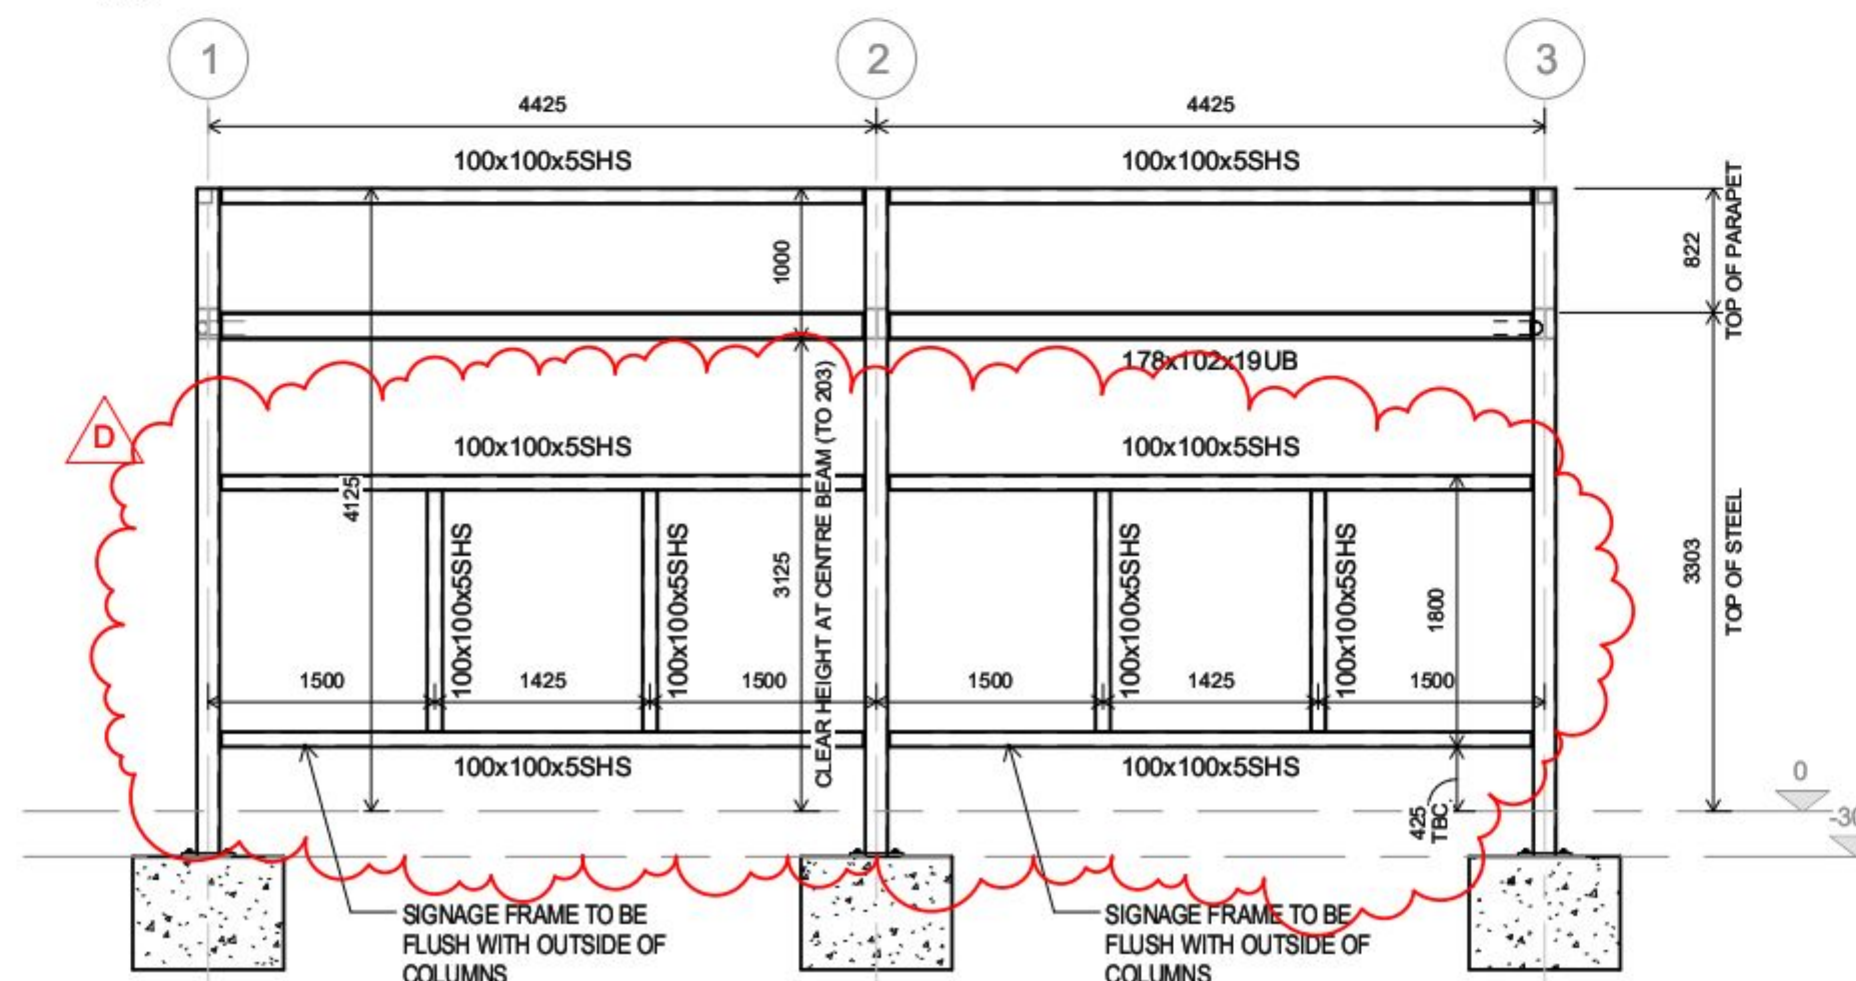

5 Elevation Grid A/B
1 : 50

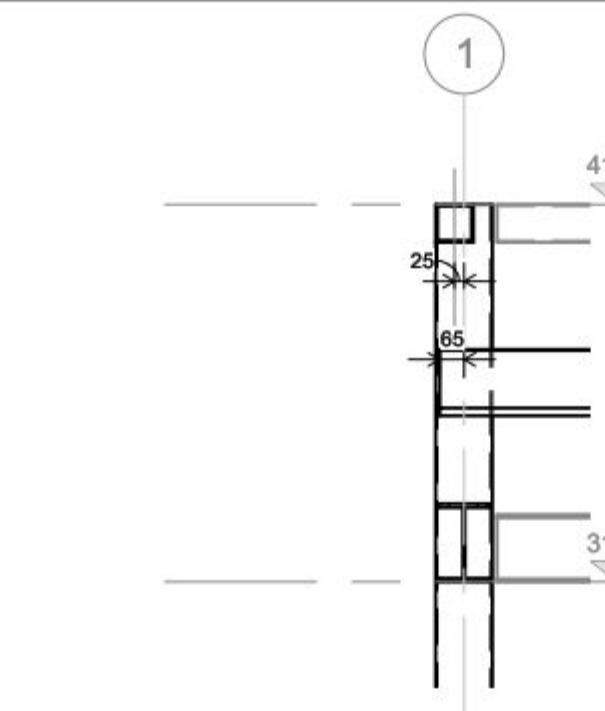

A Detailed Section A
1 : 20

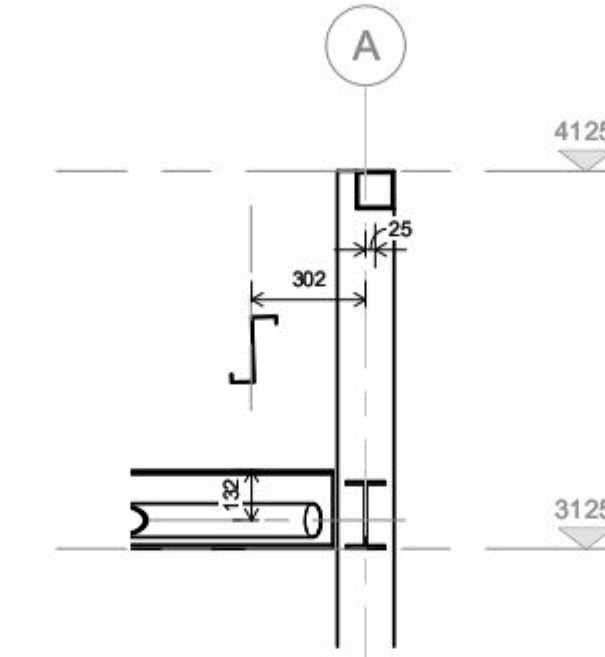

B Detailed Section B
1 : 20

STRUCTURAL STEELWORK NOTES (MJM DESIGN)

- ALL STEELWORK TO BE IN ACCORDANCE WITH MJM CONSULTING ENGINEERS NBS-SECTION G10
- ALL STEELWORK SUBJECT TO NORMAL TEMPERATURES TO HAVE MINIMUM GRADE OF S355 (INTERNAL STEELWORK) & S355JO (EXTERNAL STEELWORK) TO BS EN 10025, DESIGNED & FABRICATED TO BS 5950
- ALL STEELWORK TO RECEIVE A PROTECTIVE COATING SYSTEM AS INDICATED BELOW, IN ACCORDANCE WITH MJM CONSULTING ENGINEERS NBS-SECTION G10-000 :-

STEELWORK LOCATION	PROTECTION SYSTEM
INTERNAL	CLAUSE 641
EXTERNAL - NON-GALVANISED	CLAUSE 644
EXTERNAL - GALVANISED	CLAUSE 620


- ALL BELOW GROUND STEELWORK TO BE ENCASED IN MINIMUM 100mm CONCRETE BY MAIN CONTRACTOR
- GROUTING OF COLUMN BASES TO BE IN ACCORDANCE WITH MJM CONSULTING ENGINEERS NBS-SECTION G10-443
- ANY CLADDING SUPPORT MEMBERS NOT SHOWN ON THESE DRAWINGS TO BE SUPPLIED BY CLADDING SUB-CONTRACTOR

FOUNDATIONS


- ALL CONCRETE WORK IS TO BE IN ACCORDANCE WITH MJM CONSULTING ENGINEERS NBS-SPECIFICATION SECTION E
- RELEVANT CONCRETE MIX DESIGN:-

CONCRETE ELEMENT	DESIGN CHEMICAL CLASS	SPEC. CLAUSE No.
BURRED CONC	DC-1	130C

- ALL FOUNDATION CONCRETE TO BE C28/35
- FOUNDATION DESIGN BASED ON AN ASSUMED BEARING PRESSURE OF 50kN/m²
- ALL FOUNDATIONS TO BE LOCATED ON GRID INTERSECTIONS

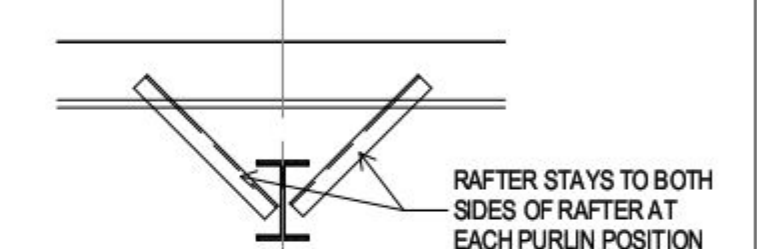

C Typical Section Through Rafter Stays
1 : 20

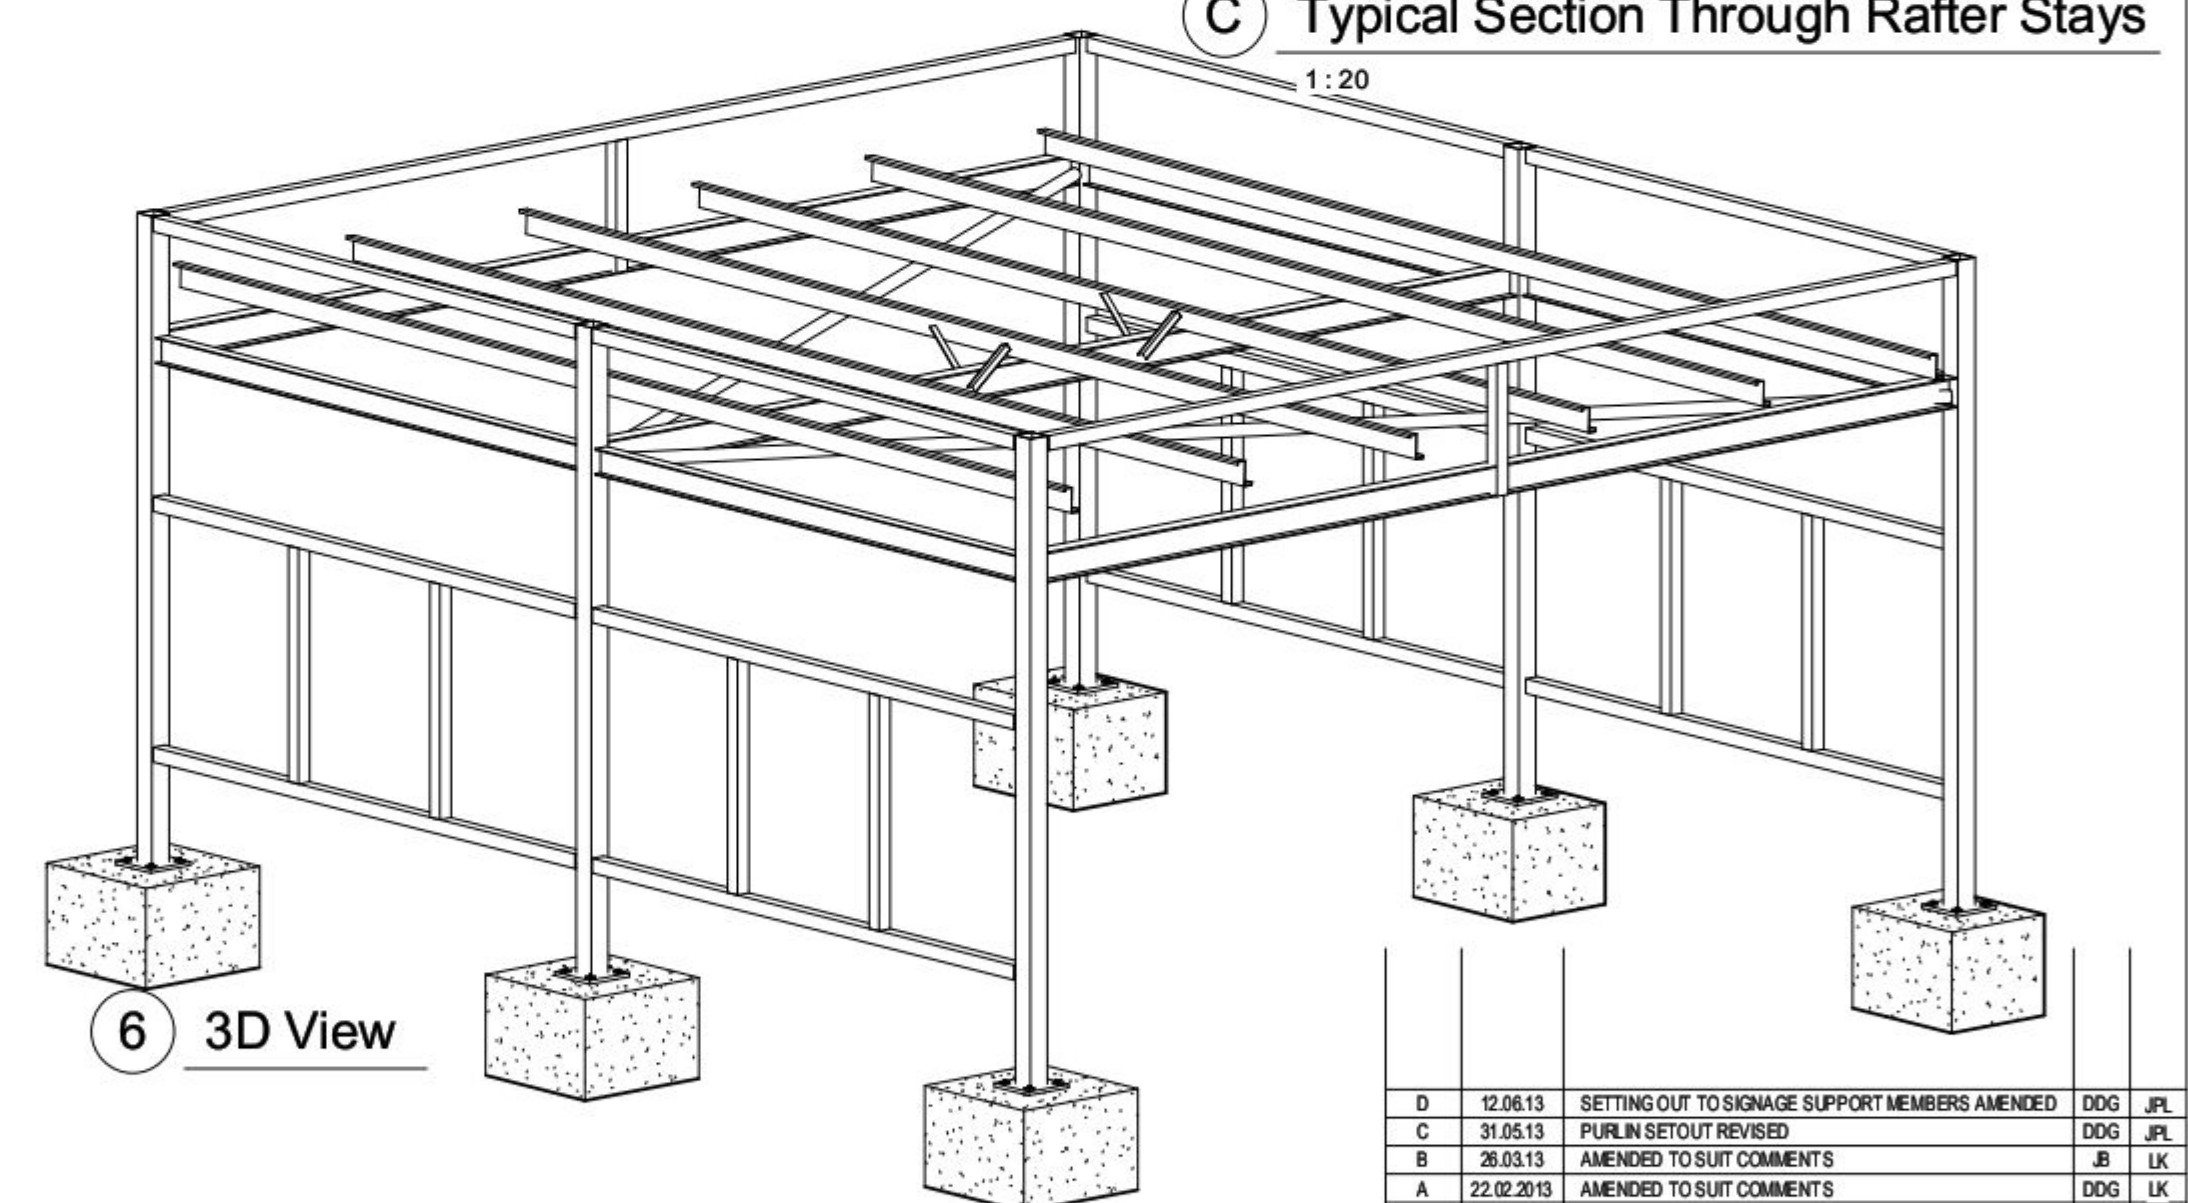

6 3D View

NOTE
FOUNDATION LEVELS AND COLUMNS LENGTHS TO BE DETERMINED BY SITE SPECIFIC LEVELS (Min. 300mm BELOW GROUND)

THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS DRAWINGS

THE DESIGN OF THE CANOPY IS BASED ON A STORE LOCATED IN A COSTAL REGION WITH A WIND SPEED OF 27m/s AND AN ALLOWABLE GROUND BEARING PRESSURE OF 50kN/m²

Rev	Date	Amendment	DDG	JPL
D	12.06.13	SETTING OUT TO SIGNAGE SUPPORT MEMBERS AMENDED	DDG	JPL
C	31.05.13	PURLIN SETOUT REVISED	DDG	JPL
B	26.03.13	AMENDED TO SUIT COMMENTS	JB	LK
A	22.02.13	AMENDED TO SUIT COMMENTS	DDG	LK

Drawing Status

CONSTRUCTION

MJM CONSULTING ENGINEERS LTD
Southgate House
Southgate, Wakefield
United Kingdom, WF1 1TL
Tel: 01924 811000 Fax: 01924 811118
E-mail: info@mjm.co.uk
Web: www.mjm.co.uk
Company Registration Number: 3146094
CIVIL & STRUCTURAL GEOTECHNICAL & ENVIRONMENTAL TRAFFIC & HIGHWAYS

Project
ASDA
Click and Collect Canopy

Client
ASDA
part of the WAL-MART family

Dwg Title
Canopy GA Plans and Details - Grocery Collection Option Three

Scale	As indicated @A1	DDG	LK	JPL
2x SCALE @A3				
Date	Feb' 2013	Path	W:\DATA\6000\0518 - Asda Click and Collect\Drawings\03-3-MJM- Grocery Collection - Option Three.dwg	
Project No	5530	Dwg No	S(28)-113	Rev
				D

THIS DRAWING MAY NOT BE COPIED WITHOUT PRIOR WRITTEN PERMISSION