
NOTES

1. All works to be in accordance with the WRc guide "Sewers for Adoption – 6th Edition" and specific requirements of Southern Water.
2. 150mm diameter pipework to be extra strength vitrified clay to BS EN 295 on class S bed & surround.
3. 225mm diameter pipework to be extra strength vitrified clay to BS EN 295 or concrete class M to BS 5911 on class S bed & surround.
4. 300mm diameter and greater pipework to be concrete class M to BS 5911 on class B bed & haunch.
5. Where cover to pipes is less than 1.2m concrete bed and surround should be used.

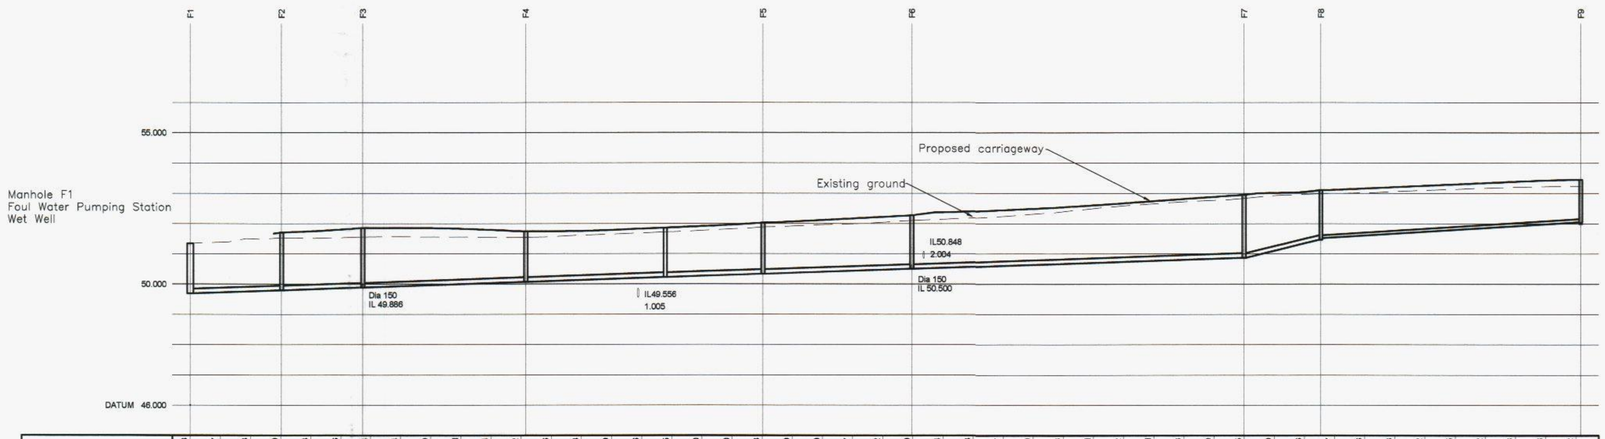

| | | |