


NOTE CHECK ALL MEASUREMENTS ON SITE PRIOR TO THE COMMENCEMENT OF WORK.

SINGLE STACK PLUMBING TO BS 5572 USE 75MM DEEP SEAL TRAPS PROVIDE RODDING ACCESS AT ALL CHANGES IN DIRECTION AND AT BASE OF STACK WHICH IS TO TERMINATE MIN 900MM ABOVE THE NEAREST OPENING WINDOW.

PROPOSED ALTERATIONS AND ADDITIONS THE RETREAT, CROFT LANE, HAYLING ISLAND, HANTS.

SUPERSEDED

EXISTING INSPECTION CHIMNEY TO BE FITTED WITH A
E. FULLY OPENABLE WINDOW FOR ESCAPE PURPOSES

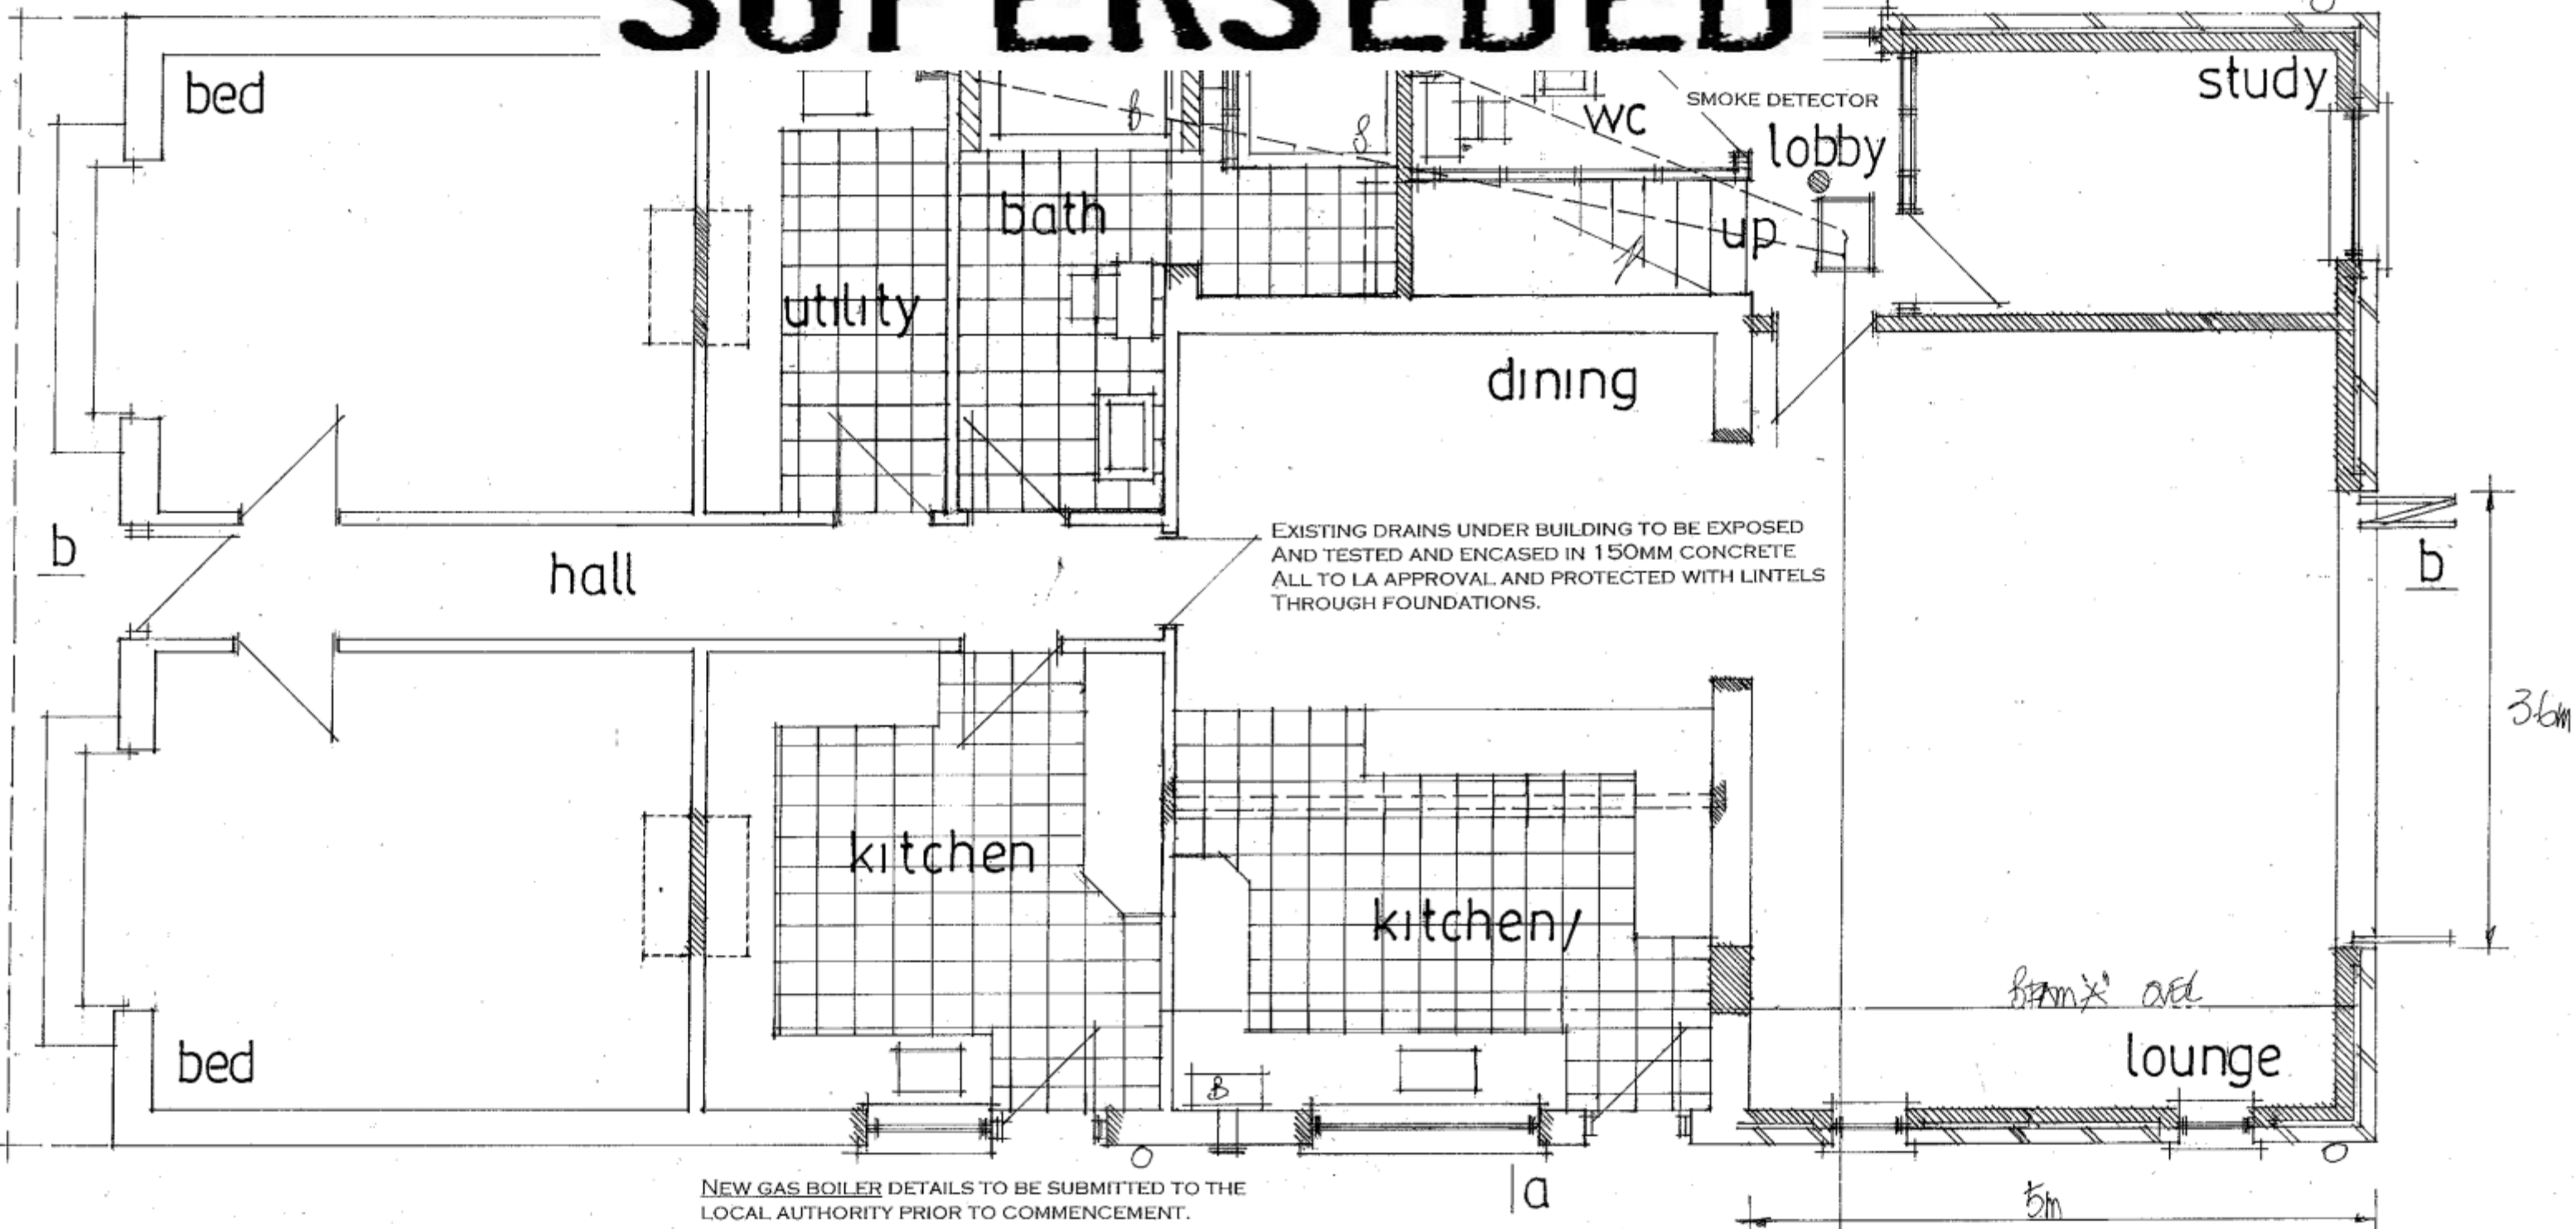

TAKE DOWN EXISTING CHIMNEY STACKS COMPLETE MAKE GOOD AS REQUIRED.

DRAINS TO BE 100MM DIAMETER APPROVED PLASTIC LAID 1.40 BEDDED AND SURROUNDED IN 150MM PEASHINGLE HAUNCH IN 150MM CONCRETE UNDER BUILDING PROTECT WITH LINTELS THROUGH FOUNDATIONS

PROPOSED GROUND FLOOR

date may 2013
scale 1:50

PETER J. WALKER MRICS
CHARTERED SURVEYOR
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9 AN

TEL: 02392 467571