PERMIT

# PROPOSED TWO STOREY SIDE ADDITION
# 11A, ST. MARYS ROAD, HAYLING ISLAND, HANTS.
# FOR MR & MRS STEVENS.

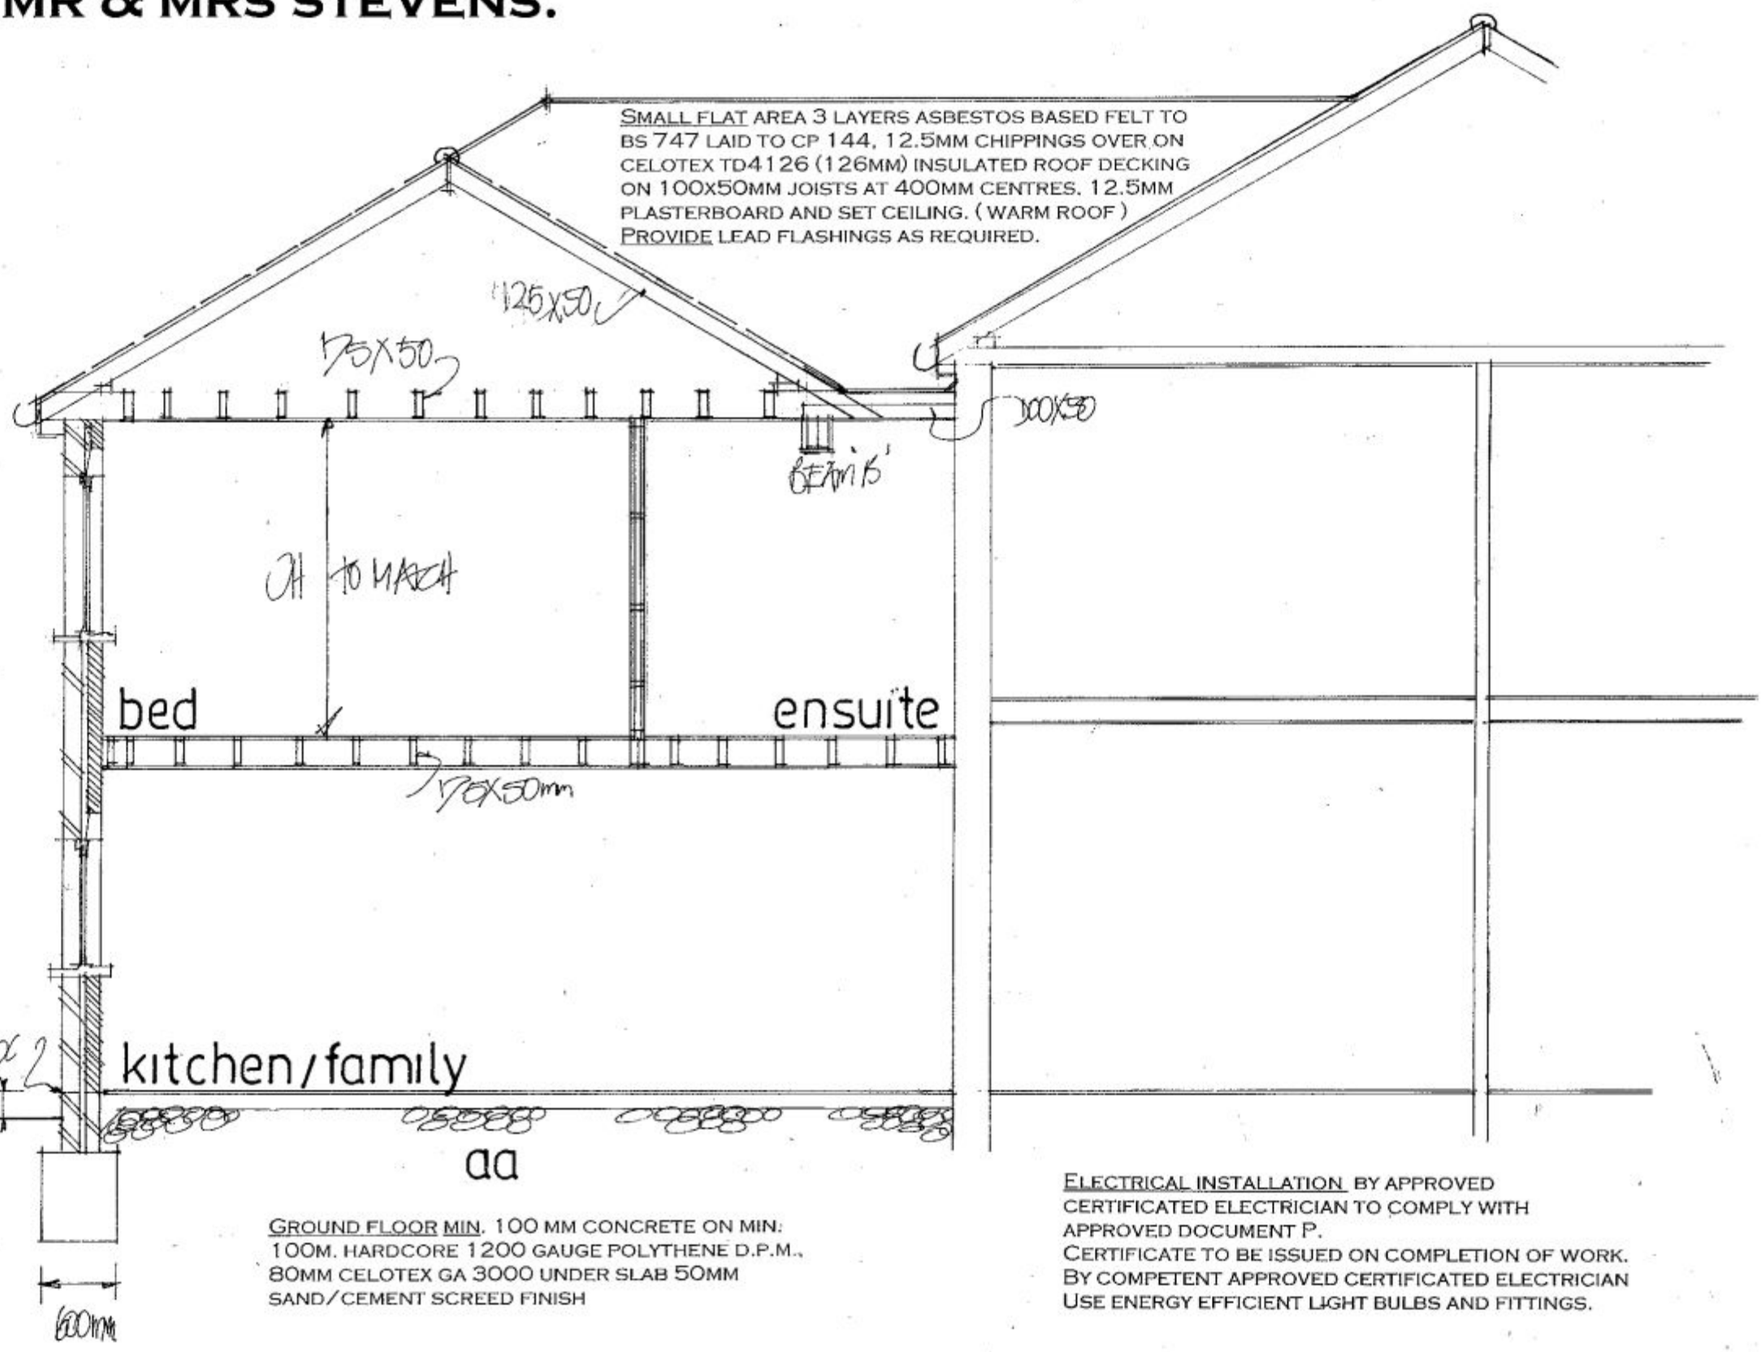


WALLS 100MM BLOCKWORK RENDER EXTERNALLY TO MATCH 100MM CAVITY WITH 50MM CELOTEX CLIPPED TO 100MM CELCON SOLAR BLOCKS INTERNALLY RENDER AND SET TIE WALLS WITH APPROVED STAINLESS STEEL WALL TIES EVERY 750MM HORIZONTALLY AND 450MM VERTICALLY

CATNIC LINTELS OVER ALL OPENINGS, SIZE IN ACCORDANCE WITH THE MANUFACTURERS SPAN TABLES MINIMUM 150MM END BEARINGS.

STRAP DOWN NEW ROOFS AND FIRST FLOOR JOISTS WITH MILD STEEL ANCHORS MINIMUM CROSS SECTION 30MMX5MM AND AT 1.2M CENTRES.
CLOSE TOP OF NEW CAVITY WALLS WITH BRICKWORK.

WINDOWS TO BE DOUBLE GLAZED WITH LOW EMISSIVITY GLASS, MINIMUM 16 MM GAP BETWEEN PANES AND TO GIVE 1/20TH OF THE FLOOR AREA AS OPENING. PROVIDE 10,000 MM SQ. TRICKLE VENTS TO ALL NEW ROOMS. ANY LOW LEVEL GLAZING TO CRITICAL AREAS IN DOORS/WINDOWS/SIDELIGHTS ETC. TO BE SAFETY GLASS TO B.S 6206

FOUNDATIONS TO BE MINIMUM 1 M. DEEP TO LOCAL AUTHORITY APPROVAL TO SUIT SITE CONDITIONS. USE ONLY CLASS A CONCRETE BLOCKS BELOW GROUND LEVEL. FOUNDATIONS ALSO TO COMPLY WITH NHBC PRACTICE NOTE WITH REGARD TO ANY TREES.
NOTE TRENCH FILL FOUNDATIONS IF REQUIRED.

GROUND FLOOR MIN. 100 MM CONCRETE ON MIN: 100M. HARDCORE 1200 GAUGE POLYTHENE D.P.M., 80MM CELOTEX GA 3000 UNDER SLAB 50MM SAND/CEMENT SCREED FINISH

ELECTRICAL INSTALLATION BY APPROVED CERTIFICATED ELECTRICIAN TO COMPLY WITH APPROVED DOCUMENT P.
CERTIFICATE TO BE ISSUED ON COMPLETION OF WORK.
BY COMPETENT APPROVED CERTIFICATED ELECTRICIAN
USE ENERGY EFFICIENT LIGHT BULBS AND FITTINGS.

date jan 2011
scale 1·50

NOTE CHECK ALL MEASUREMENTS ON SITE PRIOR TO THE COMMENCEMENT OF WORK.

PETER J. WALKER MRICS
CHARTERED SURVEYOR
182 SEAFRONT, HAYLING ISLAND, HANTS
PO11 9 AN

TEL: 02392 467571