


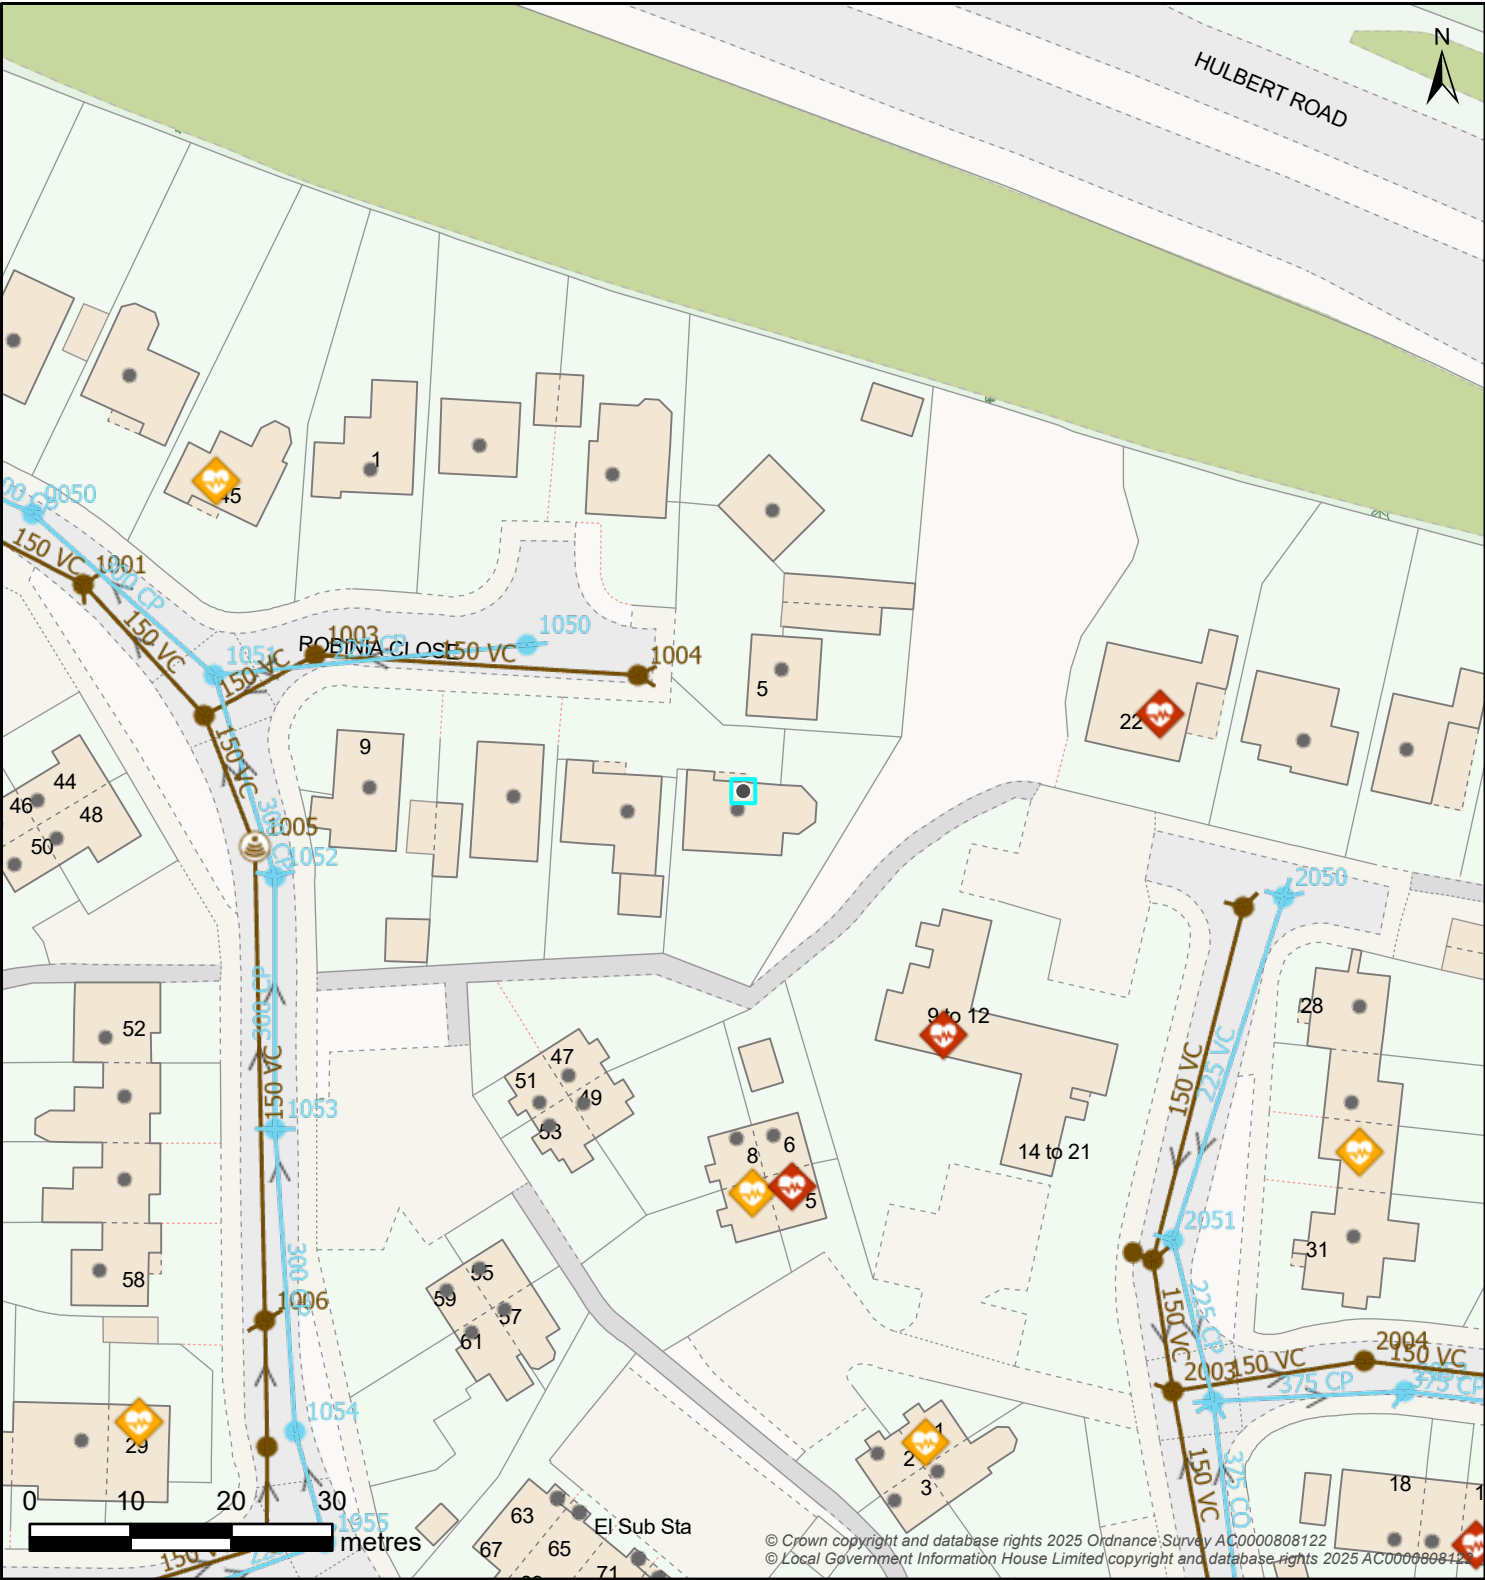

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box		Break Pressure Tank		Capped End		Hydrant		
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	Washout Hydrant			
Pressure Monitoring		Service Reservoir		Meter		Valve – Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve	Stop Tap		
Site				Valve – Flow				
Abstraction Point	Supply Works	AV Air Valve	NRV Non-Return Valve	WO Washout Empty Valve				
Booster Station	Transfer Station	Valve – Pressure			Pipe Bridge			
Surface Reservoir	Underground Source	PRV Pressure Reducing Valve	PSV Pressure Sustaining Valve	= = Pipe Bridge				
Water Pipe				Water Area				
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area				
Distribution	Raw	Discolouration						
Non-Potable	Private							

Map Title: SW Print

Printed By: Lia.Loversidge
Date Printed: 17/06/2025
Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

