


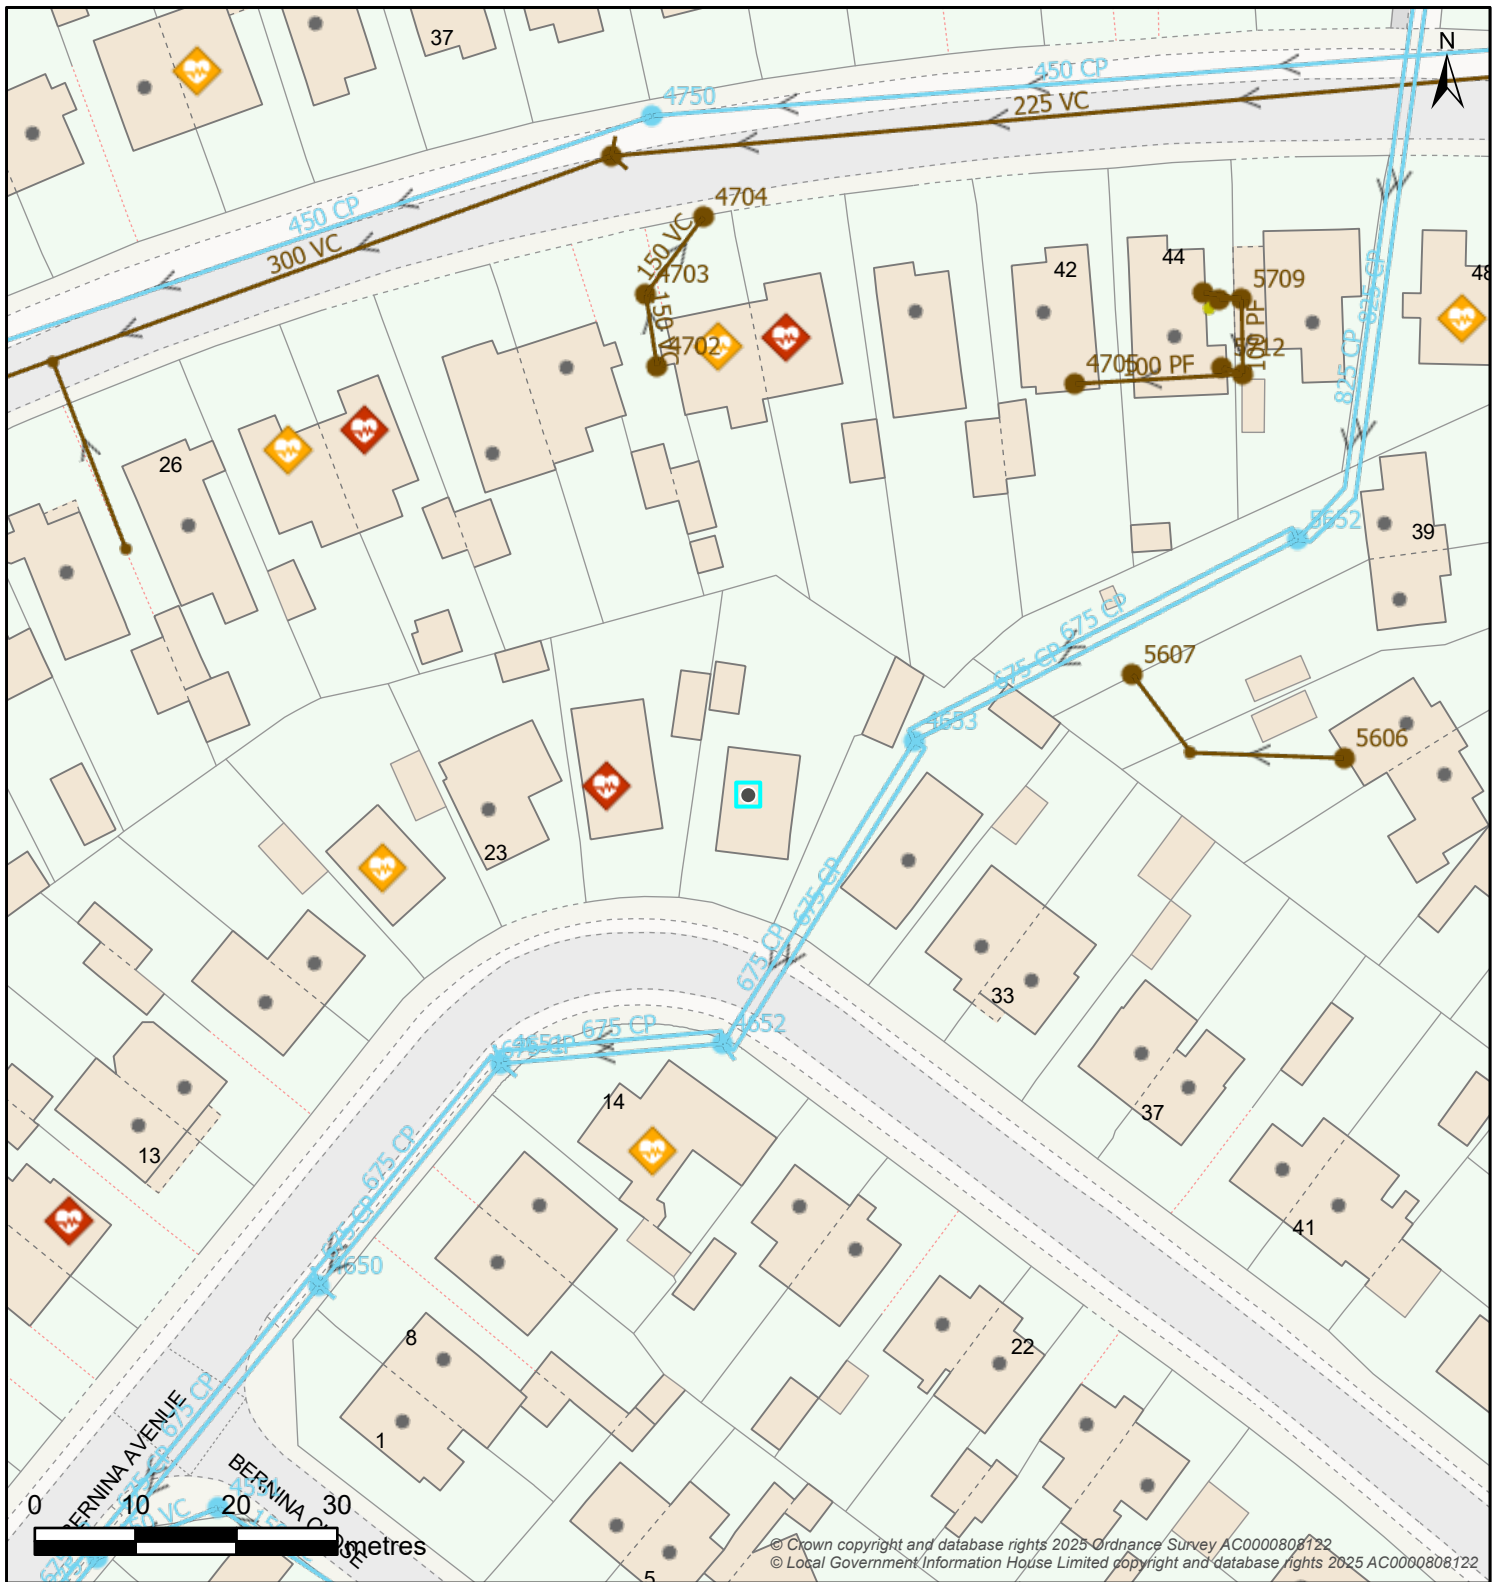

© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box	Break Pressure Tank	Capped End	Hydrant		
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	WOH Washout Hydrant
Pressure Monitoring	Service Reservoir		Meter	Valve - Controllable	
Logger	Covered	Tower	Meter	Open Valve	Closed Valve Stop Tap
Site		Valve - Flow			
Abstraction Point	Supply Works	AV Air Valve	NRV Non-Return Valve	WO Washout Empty Valve	
Booster Station	Transfer Station	Valve - Pressure			Pipe Bridge
Surface Reservoir	Underground Source	PRV Pressure Reducing Valve	PSV Pressure Sustaining Valve	Pipe Bridge	
Water Pipe			Water Area		
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area	
Distribution	Raw	Discolouration			
Non-Potable	Private				

Map Title: SW Print

Printed By: Lia.Loversidge

Date Printed: 17/06/2025

Map Scale: 750

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

