










WINDOW SCHEDULE						
Element ID	WF-01	WF-02	WF-03	WF-04	WG-01	WG-02
External Elevation						
Height	1,041	1,200	906	533	895	815
Width	1,938	2,441	2,371	1,152	538	483
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated
Window Description	Refer to CTS Specfication	Refer to CTS Specfication	Refer to CTS Specfication	Refer to CTS Specfication	Refer to CTS Specfication	Refer to CTS Specfication
Window Area	2.02	2.93	2.15	0.61	0.48	0.39

Element ID	WG-03	WG-04	WG-05
External Elevation			
Height	1,131	794	851
Width	2,416	1,264	1,274
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	Refer to Technical Standards
Window Description	Refer to CTS Specfication	Refer to CTS Specfication	Refer to CTS Specfication
Window Area	2.73	1.00	1.08

DOOR SCHEDULE		
Element ID	DG-01	DG-02
External Elevation		
Height	2,100	2,100
Width	910	910
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated
Door Description	Refer to CTS Specfication	Refer to CTS Specfication
Door Area	1.91	1.91

All windows and doors require a sill or threshold.

All windows to have trickle vents, except wetrooms e.g. Kitchen, WC and Bathroom

All windows to meet FENSA and PAS24 compliance standards.

An opening light is to be provided to each first floor habitable room to allow for emergency egress. Minimum of 450x450mm, and have a minimum area of 0.33sqm.

Any glazing which is obscured as exsiting, must be reinstalled as obscured, satin privacy glass.

Dimensions are for cost purposed only

Handing of doors to math existing

Windows and doors to be measured on site.

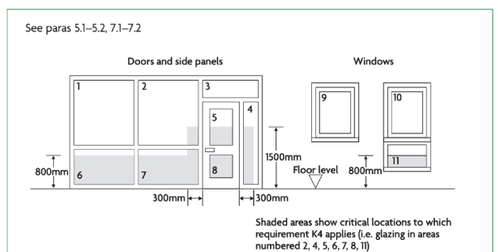


Diagram 5.1 Critical glazing locations in internal and external walls

K4: All windows and external dooes to meet AD K Section 5: Protection against impact with glazing requirements. Refer to Diagram 5.1 for critical glazing locations in internal and external walls.

PROPOSED

A3 Scales

Constructive Thinking Studio
Liverpool Science Park IC 1
131 Mount Pleasant
L3 5TF

www.constructivethinking.co.uk
+44 (0) 151 705 3433
bim@constructivethinking.co.uk

CONSTRUCTIVE THINKING

Safety Health and Environmental Information

In addition to the hazard/risks normally associated with the types of work detailed on this drawing take note of the below. It is assumed that all works on this drawing will be carried out by a competent contractor working, where appropriate, to an appropriate method statement.

This document and its design content is copyright ©. It shall be read in conjunction with all other associated project information including models, specifications, schedules and related consultants documents. Do not scale from documents. All dimensions to be checked on site. Immediately report any discrepancies, errors or omissions on this document to the Originator. If in doubt ASK.

Demolition/Adapation Risks

Risk of fragile render, existing cladding and rainwater goods collapsing. Contractor to ensure operatives wear PPE and carry out works carefully. For Further information see Risk Register.

Construction Risks

Risk of injury to operatives through working from height, tripping hazards, etc. Care to be taken while working on site and appropriate PPE to be worn. For further information see Risk Register.

Maintenance/Cleaning Risks

Cleaning windows from height. Appropritate equipment to be used. PPE to be worn. For Further information see Risk Register.

Revision	Date	By	Check
	21/03/2025		

Client **TGP**

Project **TGP- Portsmouth**

Status **Stage Approval Subject to Building Control - A1 - LFS**

Drawings Window Schedule, Door Schedule

File 24 Passingham Walk_(AC28)

Window and Door Schedule

24 Passingham Walk PO8 8JH

Drawing Number
7083 -CTS- 03 - 24 -L-A-4413

Revision
P06