
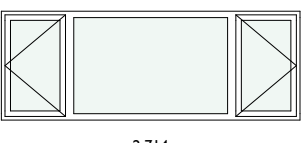



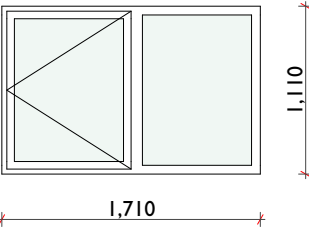
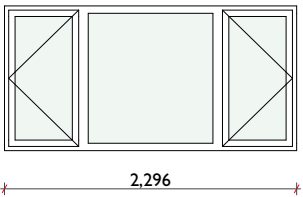

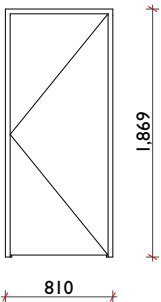
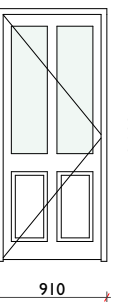


WINDOW SCHEDULE						
Element ID	WF-01	WF-02	WF-03	WF-04	WG-01	WG-02
External Elevation						
Height	989	989	927	889	1,168	1,110
Width	1,792	2,714	2,296	1,208	1,792	1,710
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated
Window Description	Refer to CTS Specifications	Refer to CTS Specifications	Refer to CTS Specifications	Refer to CTS Specifications	Refer to CTS Specifications	Refer to CTS Specifications
Window Area	1.77	2.68	2.13	1.07	2.09	1.90

Element ID	WG-03	WG-04
External Elevation		
Height	1,137	558
Width	2,296	732
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated
Window Description	Refer to CTS Specifications	Refer to CTS Specifications
Window Area	2.61	0.41

DOOR SCHEDULE		
Element ID	DG-01	DG-02
External Elevation		
Height	1,869	2,100
Width	810	910
Thermal Performance	1.2 W/m2K or better; A1 Fire Rated	1.2 W/m2K or better; A1 Fire Rated
Door Description	Refer to CTS Specifications	Refer to CTS Specifications
Door Area	1.51	1.91

All windows and doors require a sill or threshold.

All windows to have trickle vents, except wetrooms e.g. Kitchen, WC and Bathroom

All windows to meet FENSA and PAS24 compliance standards.


An opening light is to be provided to each first floor habitable room to allow for emergency egress. Minimum of 450x450mm, and have a minimum area of 0.33sqm.

Any glazing which is obscured as exsiting, must be reinstalled as obscured, satin privacy glass.

Dimensions are for cost purposed only

Handing of doors to math existing

Windows and doors to be measured on site.

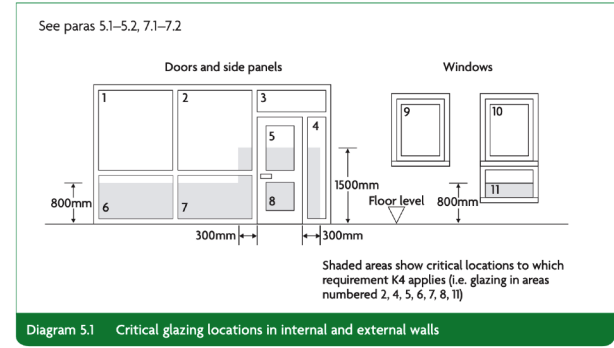

K4: All windows and external dooes to meet AD K Section 5: Protection against impact with glazing requirements. Refer to Diagram 5.1 for critical glazing locations in internal and external walls.

PROPOSED

A3

Scales

Constructive Thinking Studio

Liverpool Science Park IC 1

131 Mount Pleasant

L3 5TF

www.constructivethinking.co.uk

+44 (0) 151 705 3433

bim@constructivethinking.co.uk

Safety Health and Environmental Information

In addition to the hazard/risks normally associated with the types of work detailed on this drawing take note of the below. It is assumed that all works on this drawing will be carried out by a competent contractor working, where appropriate, to an appropriate method statement.

This document and its design content is copyright ©. It shall be read in conjunction with all other associated project information including models, specifications, schedules and related consultants documents. Do not scale from documents. All dimensions to be checked on site. Immediately report any discrepancies, errors or omissions on this document to the Originator. If in doubt ASK.

Demolition/Adaption Risks

<complete within project info-building details>

Construction Risks

<complete within project info-building details>

Maintenance/Cleaning Risks

<complete within project info-building details>

Revision	Date	By	Check
	21/03/2025	FN	LFS

Client

TGP

Project

TGP - Portsmouth

Status

Stage Approval Subject to Building Control - A1 - LFS

Drawings

Window Schedule, Door Schedule

File

31 Pyle Close_(AC28)

Window and Door Schedule

31 Pyle Close

Drawing Number

7083 -CTS- 02 - 31 -L-A-4413

Revision

P06